


PRIMARY 480V

A ϕ B ϕ C ϕ GND

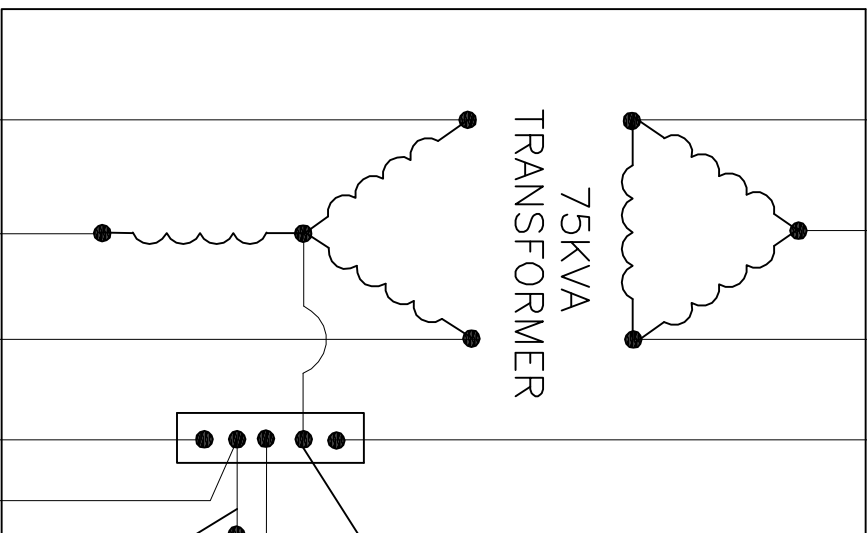

NEUTRAL

BOND TO METAL
BLDG FRAME PER
NEC 250.

BONDING JUMPER

A ϕ B ϕ C ϕ N GND

SECONDARY 120/208V

TRANSFORMER NOTES:

TRANSFORMER SHALL BE A 480V - 208Y/120V KVA (AS SCHEDULED) DRY TYPE, WITH NEMA 3R ENCLOSURE.