
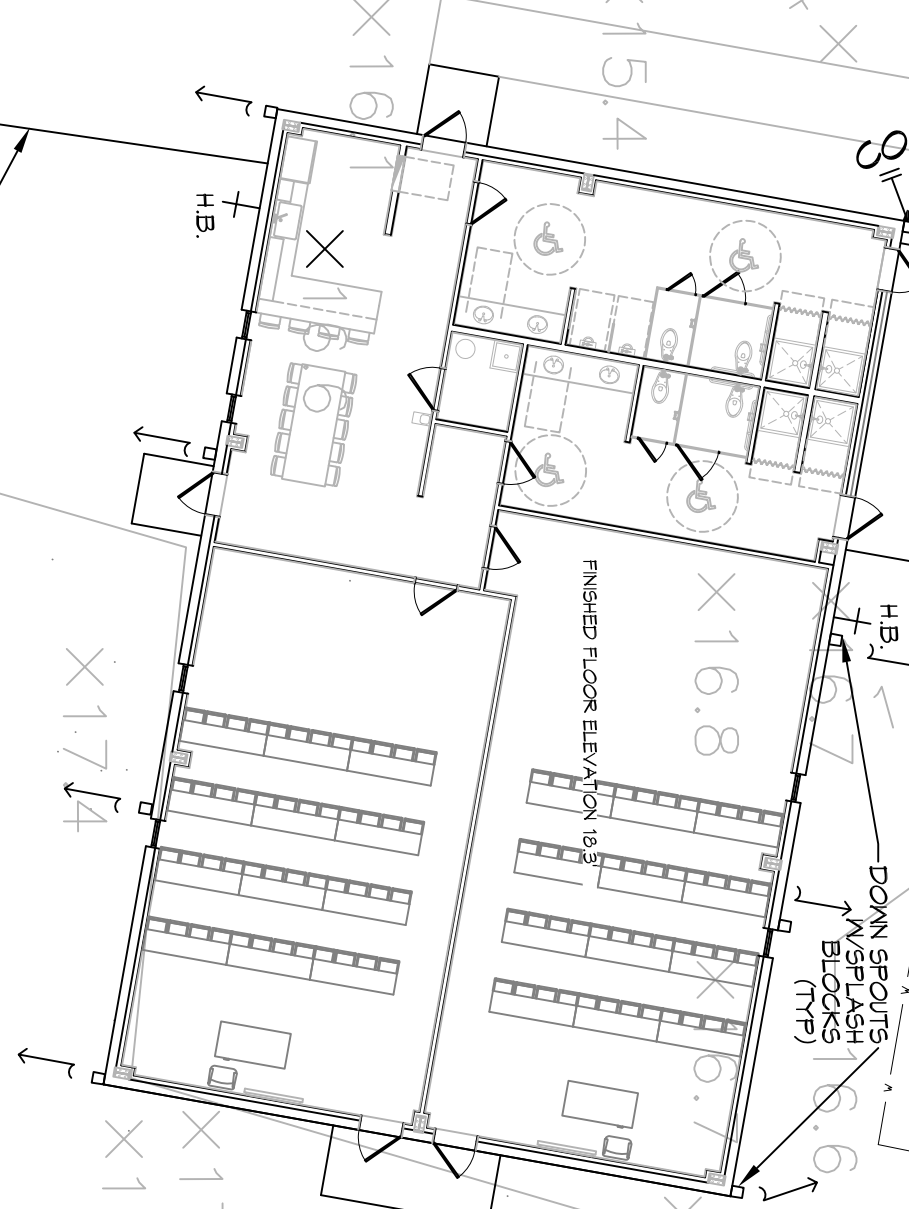


EXISTING 6" WATERLINE (FIELD VERIFY)

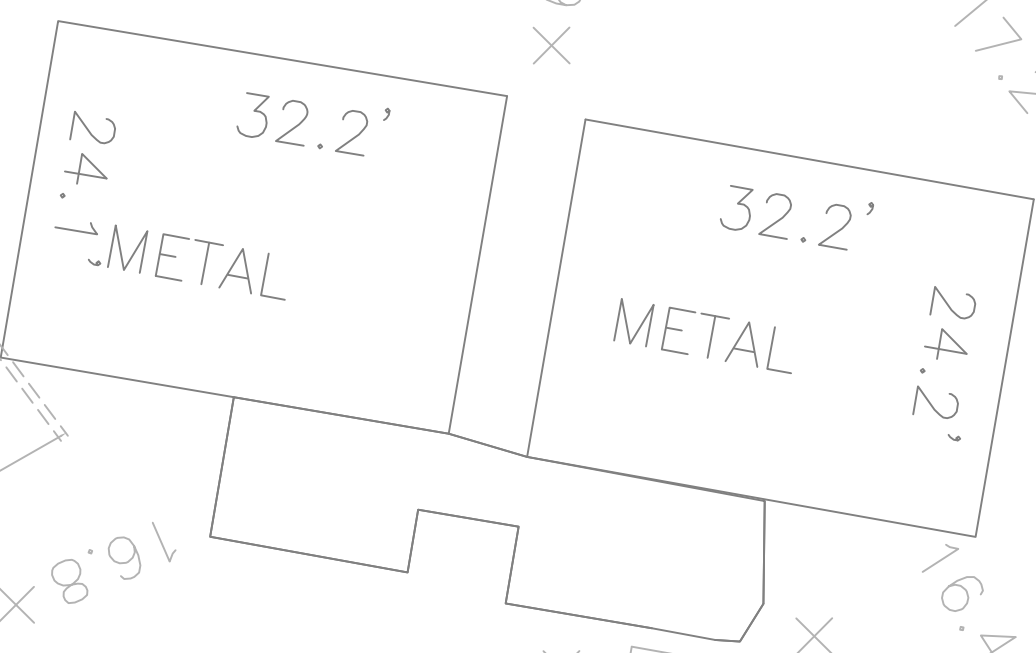


PROVIDE TWO (2) 4" SCHEDULE 40 PVC CONDUIT BELOW GRADE AND SCH 80 PVC CONDUIT ABOVE GRADE WITH SUITABLE FISH WIRE.

FINISHED FLOOR ELEVATION 16.3

DOWN SPOUTS W/SPLASH BLOCKS (TYP)

EXIT LINES

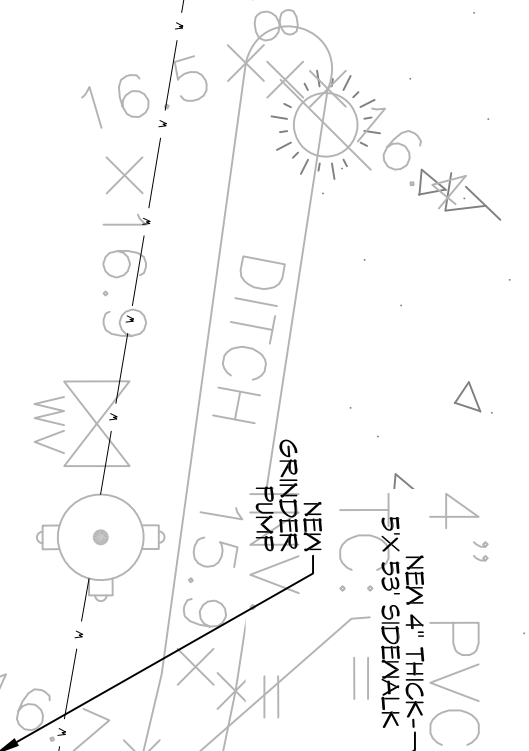

DITCH

NEW 4" THICK 5x5 SIDEWALK

NEW 4" THICK 6x8 SIDEWALK

NEW 5" THICK 10x22 PAD

FIRE TRAINING AREA

4" PVC

DELTA SCALE: N.T.S.

