

D

C

B

A

1

2

3

4

5

OPERATIONS/MAINTENANCE 2440/2441 FIRE ALARM SYSTEM LEGEND

| QTY | SYMBOL | DEVICE | PART NUMBER | BACK BOX | MOUNTING SPECIFICATIONS |
|-----|--------|---|-------------|---------------------------|-------------------------------|
| 1 | [FACP] | FIRE ALARM CONTROL PANEL | NFS2-640 | | SURFACE |
| 1 | [TR] | FIRE ALARM TRANSCENER | MONACO BT | | SURFACE |
| 1 | [FAA] | FIRE ALARM ANNUNCIATOR PANEL | LCD-80 | | SURFACE |
| 8 | [E] | ADDRESSABLE MANUAL PULL STATION | NBG-12LX | 4" SQ 1 GANG RING | MOUNT AT 48" TO CENTER |
| 4 | [S] | INTELLIGENT ADDRESSABLE SMOKE DETECTOR | ZMB | 4" SQUARE | CEILING FLUSH MOUNT |
| 2 | [D] | INTELLIGENT ADDRESSABLE DUCT PHOTO DETECTOR | FSP-861/DST | | SURFACE MOUNT TO DUCT |
| 2 | [R] | ADDRESSABLE RELAY MODULE | FRM-1 | 4" SQ 2.125" DEEP | |
| 1 | [D] | ADDRESSABLE DUAL MONITOR MODULE | FDL-1 | 4" SQ 2.125" DEEP | |
| 12 | [S] | WALL MOUNT SPEAKER STROBE | SFSW | 4" SQUARE W/1.5" EXT RING | MOUNT AT 80" A.F.F. TO BOTTOM |
| 8 | [S] | CEILING MOUNT SPEAKER STROBE | SFSC | 4" SQUARE W/1.5" EXT RING | FLUSH MOUNT |
| 8 | [S] | CLEAR FIRE STROBE | SW | 4" SQUARE | MOUNT AT 80" A.F.F. TO BOTTOM |
| 1 | [S] | CLEAR FIRE STROBE-WEATHER PROOF | SMK W/ WPBB | 4" SQUARE | MOUNT AT 80" A.F.F. TO BOTTOM |
| 12 | [S] | SPEAKER | SFC | 4" SQUARE W/1.5" EXT RING | CEILING MOUNT |
| 7 | [S] | SPEAKER-WEATHERPROOF | SIH-15S | WBB/SHP | MOUNT AT 80" A.F.F. TO BOTTOM |
| 1 | [TS] | SPRINKLER SYSTEM TAMPER SWITCH | | | |
| 1 | [FS] | SPRINKLER SYSTEM FLOW SWITCH | | | |

BOAT STORAGE 2442 FIRE ALARM SYSTEM LEGEND


| QTY | SYMBOL | DEVICE | PART NUMBER | BACK BOX | MOUNTING SPECIFICATIONS |
|-----|--------|--|-------------|----------------|-------------------------------|
| 1 | [FACP] | FIRE ALARM CONTROL PANEL | SFP-5UD | | SURFACE |
| 2 | [E] | ADDRESSABLE MANUAL PULL STATION | NBG-12LOB | WP BB INCLUDED | MOUNT AT 48" TO CENTER |
| 1 | [S] | INTELLIGENT ADDRESSABLE SMOKE DETECTOR | ZMB | 4" SQUARE | CEILING FLUSH MOUNT |
| 5 | [HQ] | HORN STROBE | P2BK | WP BB INCLUDED | MOUNT AT 80" A.F.F. TO BOTTOM |
| 1 | [FS] | SPRINKLER SYSTEM FLOW SWITCH | | | |
| 1 | [TS] | SPRINKLER SYSTEM TAMPER SWITCH | | | |




NICET CERTIFICATION
 LARRY K. COOK
 LEVEL IV / CERTIFICATION #79228
 FIRE ALARM PROTECTION / FIRE ALARM SYS
 EXPIRATION DATE: MARCH 01, 2011

PRE-FINAL SUBMISSION
 MAY 15, 2009
NOT FOR CONSTRUCTION

| SYM | DESCRIPTION | DATE | APPR |
|-----|-------------|------|------|
| | | | |
| | | | |
| | | | |

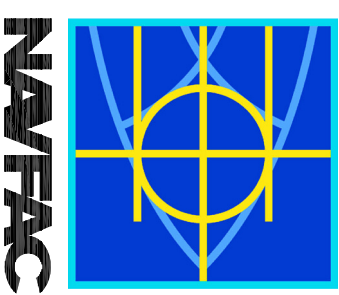

SCHLAFLY ENGINEERING, LLC
 121 SOUTH GENOIS STREET
 NEW ORLEANS, LA 70119
 PHONE: 504-882-4347
 FAX: 504-882-7980
M. KIMBALL SCHLAFELY, P.E.
 LA REG 27699

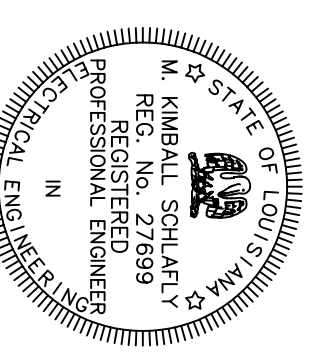

STATE OF LOUISIANA
 M. KIMBALL SCHLAFELY
 REG. NO. 27699
 PROFESSIONAL ENGINEER
 IN
 ELECTRICAL ENGINEERING

DES. K. SQUADRY / DRW. K. SQUADRY
 REVIEWED BY: R. WILISE
 P.N./CHK. T. ARBER
 CHIEF ENGR./ARCH. P. DAMON

DEPARTMENT OF THE NAVY
 NAVAL FACILITIES ENGINEERING COMMAND
 NAVAL FACILITIES ENGINEERING COMMAND SOUTHEAST
 NAVAL AIR STATION JACKSONVILLE
 MISSISSIPPI
 JOHN C. STENNIS SPACE CENTER
SOF RIVERINE AND COMBATANT CRAFT OPERATIONS FACILITY
BLDG 2440 1ST FLOOR PLAN - FIRE ALARM

SCALE: NONE
 DRAWING NO. N62467-05-D-0096
 SHEET XXX OF XXX
FA1.0

1

2

3

4

5

A

B

C

D