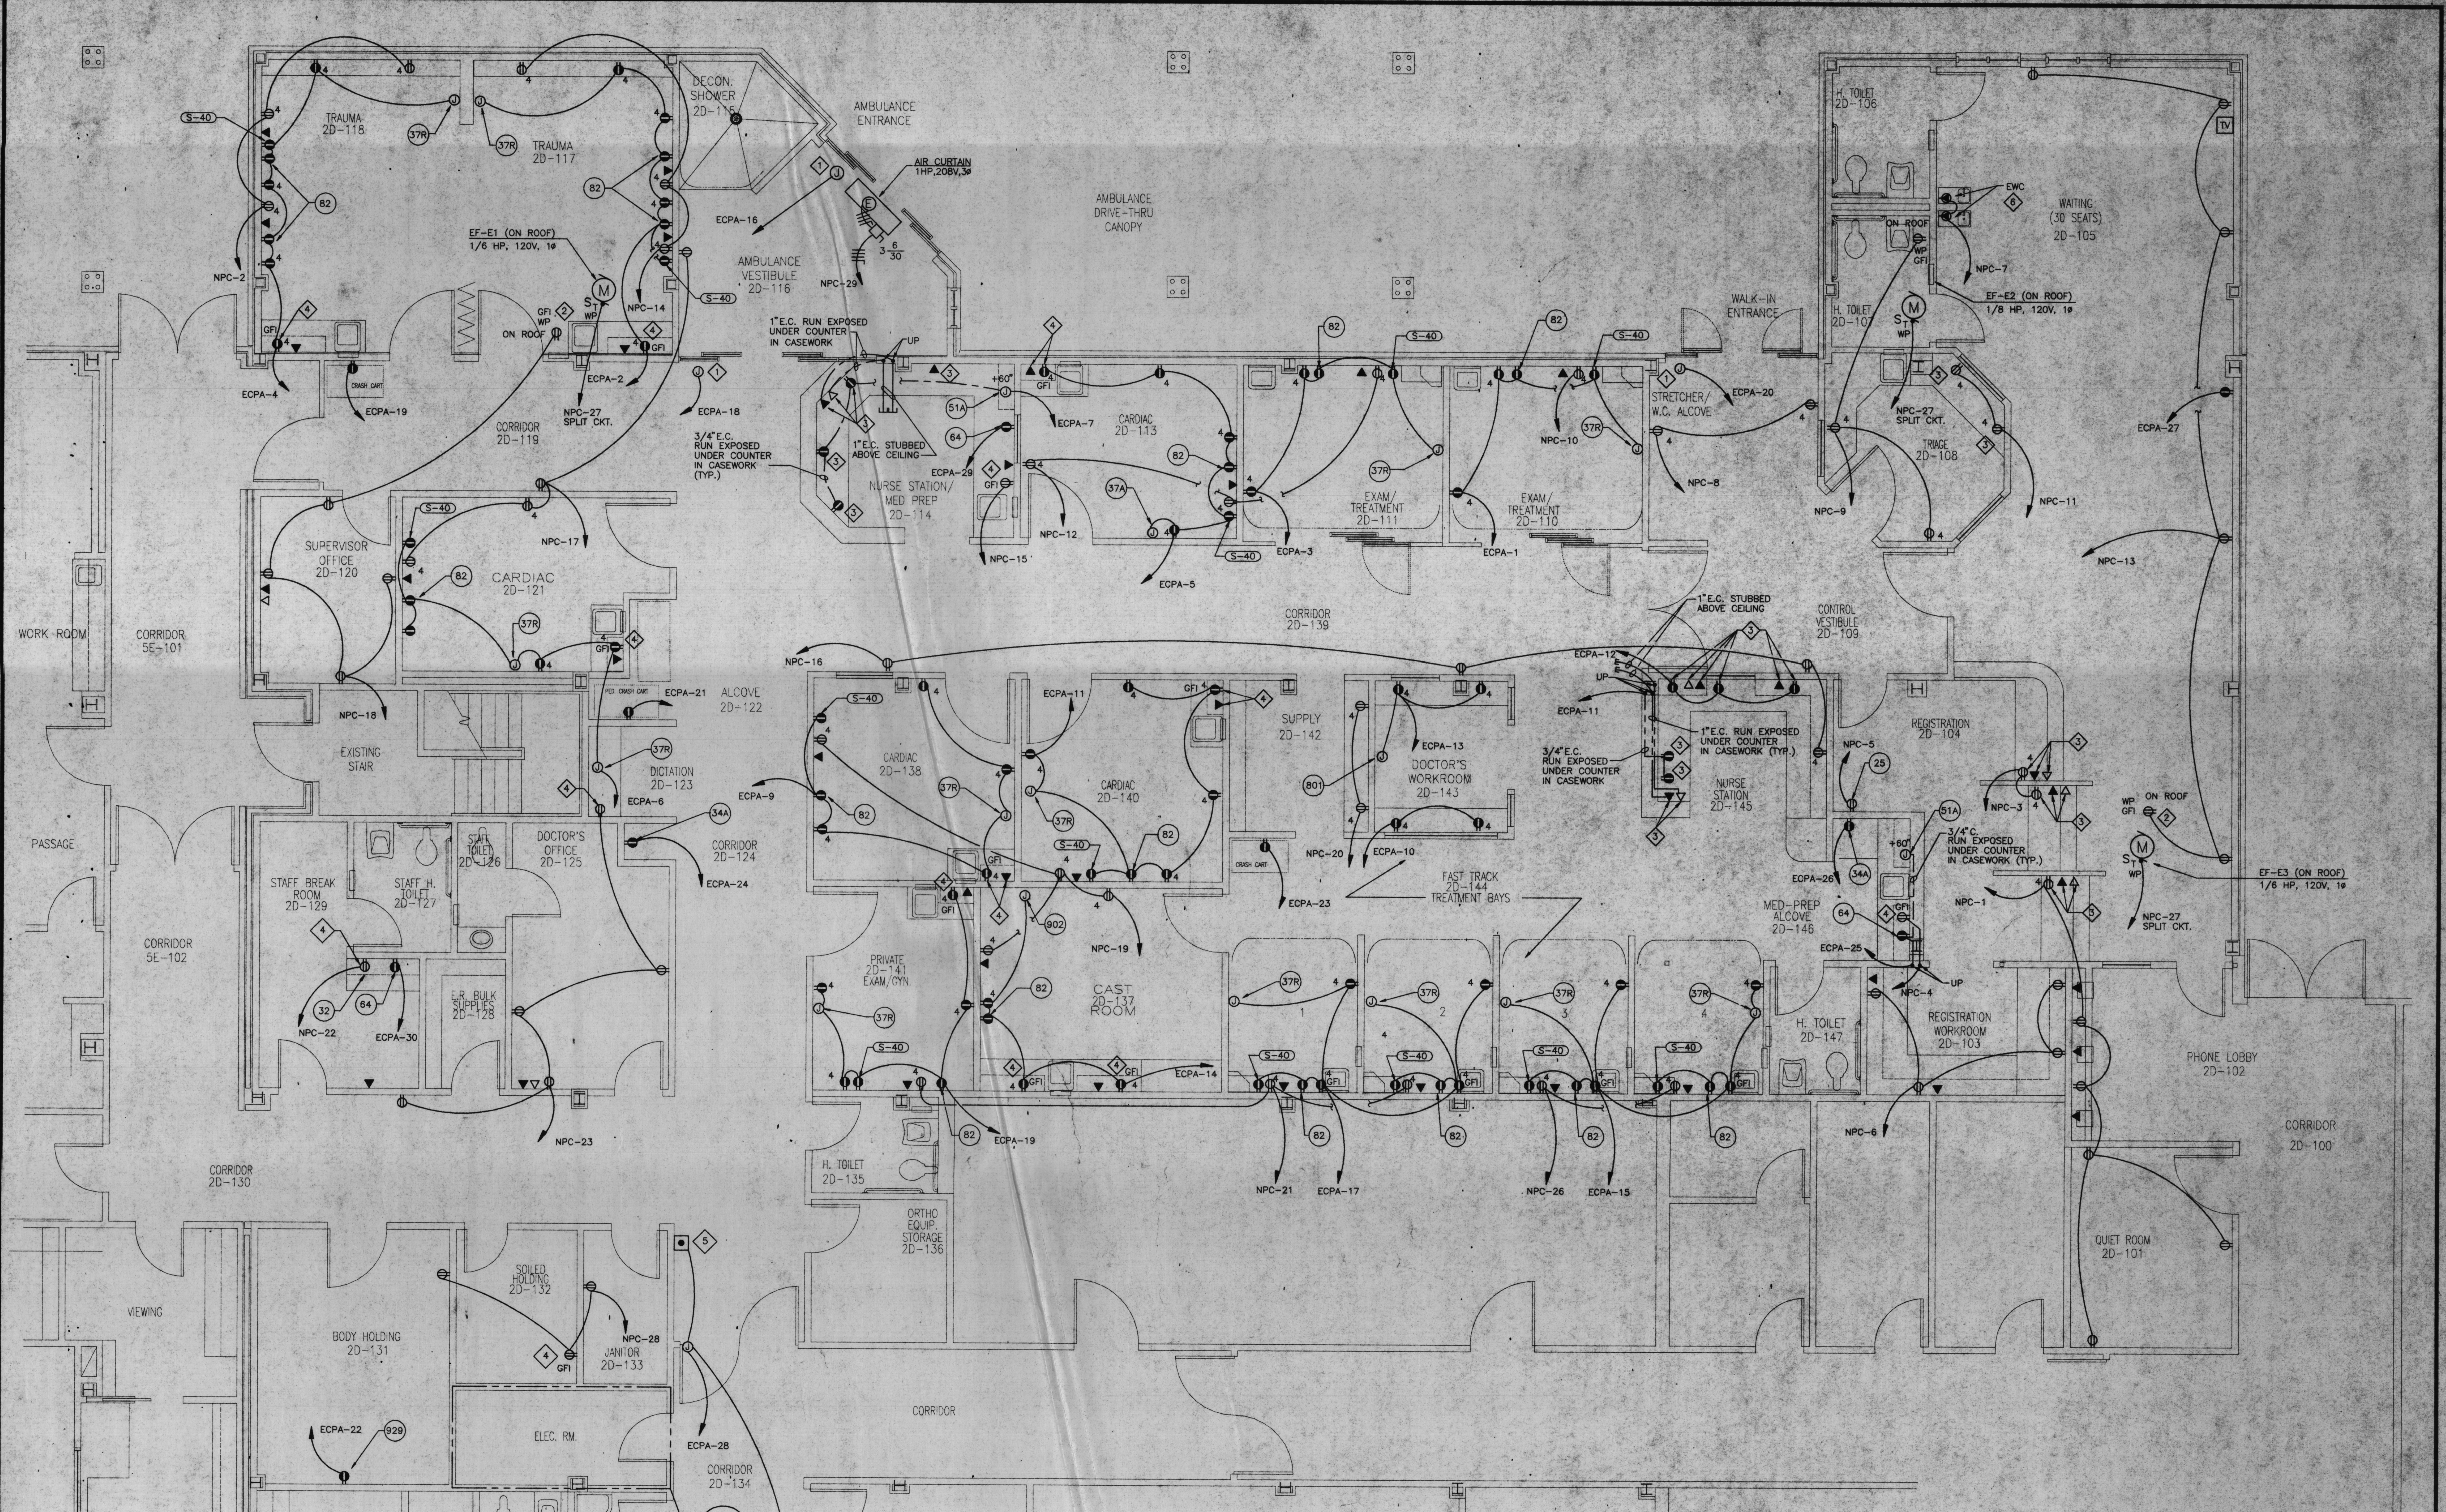

SPECIFIC NOTES:

1. JUNCTION BOX ABOVE CEILING FOR POWER CONNECTION TO SLIDING DOORS. COORDINATE WORK WITH DOOR VENDOR.
2. FOR RECEPTACLES MOUNTED ON ROOF DO NOT MOUNT RECEPTACLE ON EQUIPMENT, PROVIDE GALVANIZED UNISTRUT RACK.
3. PROVIDE 1" BUSHED HOLE WITH GROMMET IN COUNTERTOP FOR CORD AND PLUG CONNECTED EQUIPMENT, DATA AND TELEPHONE CABLES ETC.
4. INSTALL DUPLEX RECEPTACLE, MIN. 4" ABOVE COUNTERTOP BACKSPLASH.
5. PUSHBUTTON CONTROL FOR AUTOMATIC DOOR. COORDINATE EXACT REQUIREMENTS WITH DOOR MANUFACTURER.
6. DEVICE SHALL BE SIMPLEX RECEPTACLE TO SERVE EWC. COORDINATE EXACT MOUNTING WITH EWC PRIOR TO ROUGH-IN.

GENERAL ELECTRICAL NOTE:

SEE ARCHITECTURAL ELEVATIONS FOR DEVICE LOCATIONS ON HEADWALLS.

1 PARTIAL FLOOR PLAN-ER-POWER

E1.3.4

1/4"=1'-0"

N

GRAPHIC SCALE IN FEET

1/4"=1'-0" 4 0 4 8

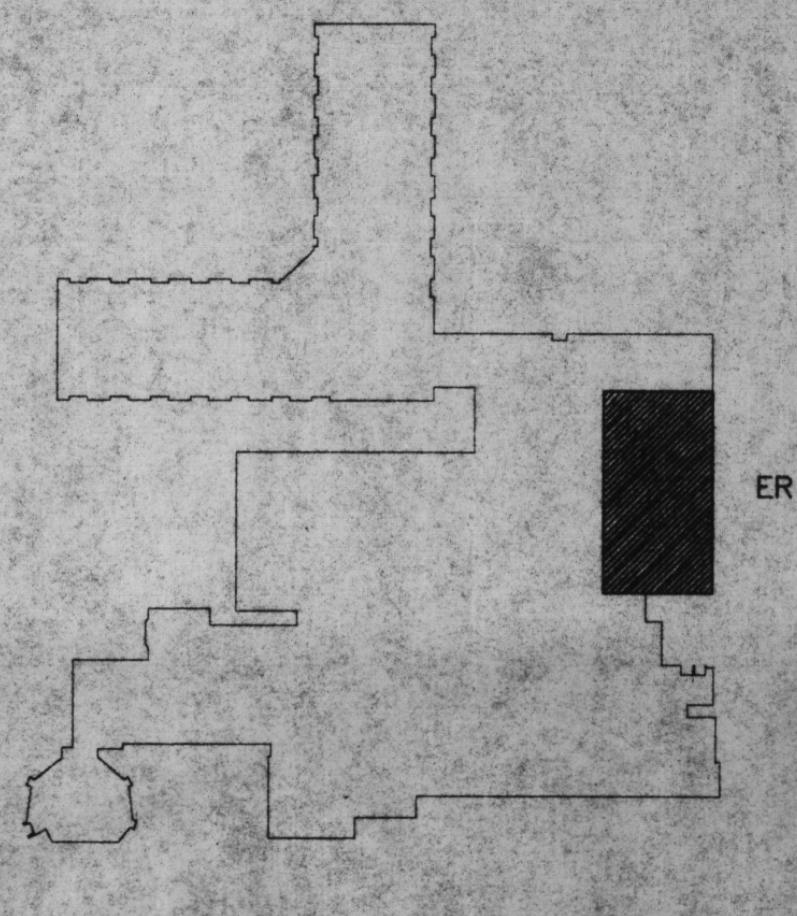

KEY PLAN

MARRERO COUVILLON & ASSOCIATES, INC.
CONSULTING ENGINEERS
BATON ROUGE–NEW ORLEANS–LAFAYETTE
JOB NO. SMH94.012 DWG. N194 S15 T035

LIFE SAFETY PHASE 1C LAB/ER RENOVATIONS
SLIDELL MEMORIAL HOSPITAL
1001 GAUSE BLVD. SLIDELL, LA.

JOHN T. CAMPO & ASSOCIATES, INC.
ARCHITECTS • PLANNERS
THE LYKES CENTER, SUITE 2018 300 POYDRAS STREET
NEW ORLEANS, LA 70130 (504) 568-9912

ISSUE DATES

DATE	ISSUED TO	USE RESTRICTION
9/27	META	FINAL REVIEW
11/23	CLIENT	FOR BIDDING

REVISIONS

DATE	BY	DESCRIPTION

☐ PROGRESS PRINT
NOT FOR CONSTRUCTION.

☐ PARTIAL RELEASE
ONLY TO EXTENT NOTED HEREON, PARTS OF THIS DRAWING ARE RELEASED BY THE ARCHITECT FOR CONSTRUCTION.

DATE

☒ FULL RELEASE
THIS DRAWING IS FULLY RELEASED BY THE ARCHITECT FOR CONSTRUCTION OF THIS PROJECT ONLY.

DATE NOVEMBER 23, 1994

ALL RIGHTS RESERVED NOT TO BE COPIED OR REPRODUCED WITHOUT EXPRESSED WRITTEN CONSENT OF JOHN T. CAMPO & ASSOCIATES, INC.

COPYRIGHT © JOHN T. CAMPO & ASSOCIATES, INC., 1993

JOB NUMBER
9215–16M

DRAWN BY
D.B.P.

CHECKED BY
S.S.S.

JOHN W. COUVILLON
REG. No. 11860

SHEET
E1.3.4
OF SHEETS