KEYNOTES

26.402	RECEPTACLE & DATA PORTS RECESSED IN WALL FOR MONITORS. USE AN ARLINGTON INDUSTRIES RECESSED DOUBLE GANG ELECTRICAL BOX (TVBS505) TO MOUNT STANDARD DUPLEX RECEPTACLE, DATA PORTS, AND WALL PLATE AT HEIGHT INDICATED.
26.407	EQUIPMENT DISCONNECT SWITCHES SHALL BE SUPPLIED AND PREWIRED FOR CONNECTION TO COOLER/FREEZER/STORAGE PACKAGE. ELECTRICAL CONTRACTOR SHALL MAKE ALL FINAL CONNECTIONS. E.C. SHALL COORDINATE CIRCUIT BREAKER WITH MANUFACTURER FOR PROPER FEEDER SIZING TO PANELBOARD.
26.417	PROVIDE ELECTRICAL DOOR STRIKE AND ASSOCIATED PUSH BUTTONS PER MANUFACTURER'S RECOMMENDATIONS. LOCATE PUSH BUTTONS UNDER DESK COUNTER.
26.418	ALL 120V ELECTRICAL POWER TO CAR OR TRUCK CASHIER AREAS MILLWORK SHALL ENTER FROM AN 8" X 8" SURFACE-MOUNTED JUNCTION BOX AT 24" AFF. HOLD TIGHT TO EXTERIOR WALL, OR THROUGH FLOOR AS INDICATED ON PLAN.
26.419	CASH REGISTER & CPU SHALL HAVE QUAD RECEPTACLES ON DEDICATED CIRCUIT WITH ISOLATED GROUND. STUB UP CONDUITS AT FUEL DESK IN THE DEAD CORNER OF MILLWORK CABINETS. LOCATE RECEPTACLE UNDER FIXED SHELF OF MILLWORK. LOCATE AFTER MILLWORK CABINETS HAVE BEEN INSTALLED. FIELD VERIFY FINAL LOCATIONS PRIOR TO ROUGH-INS.
26.420	PROVIDE J-BOX SET HORIZONTALLY AT 60" AFF, WITH 1/2" CONDUIT TO ATTIC WITH CONTINUATION TO ELEC. ROOM, FOR E.S.O. CONNECTION. FUEL CONTRACTOR SHALL PROVIDE WIRING AND MAKE FINAL CONNECTION.
26.422	PROVIDE CEILING-MOUNTED RECEPTACLE FOR WALL-MOUNTED NETWORK ROUTER.

KEYNOTES

26.423	GENERAL CONTRACTOR SHALL PROVIDE AND INSTALL "ON-OFF-AUTO" SWITCH TO SERVE AS THE SITE LIGHTING MANUAL OVERRIDE SWITCH. CONNECT TO 120V CONTACTOR COIL TO OVERRIDE PHOTOCELL CONTROL. REFERENCE LIGHTING CONTACTOR DETAIL FOR ADDITIONAL INFORMATION.
26.425	USB RECEPTACLE, MOUNT AT HEIGHT INDICATED ON DRAWINGS. RECEPTACLES SHALL HAVE DUAL USB CHARGING PORTS (HUBBEL USB15X2).
26.427	CONNECT CIRCUIT TO ISO-FUEL PANEL "FP" AT "SITE CONTROLLER" LOCATION. VERIFY WITH FUEL EQUIPMENT SUPPLIER.
26.430	WRAP CONDENSATE LINES WITH HEAT TAPE AND PROVIDE 120V CONNECTION. REFER TO HEAT TAPE MANUFACTURER.
26.431	J-BOX FOR CONNECTION TO DOOR HEAT TRACE. BOX LOCATION SHALL NOT INTERFERE WITH DOOR OPERATION. FINAL CONNECTION TO HEAT TRACE SHALL BE BY OTHERS.
26.432	PROVIDE CONTROL CIRCUIT AND 3/4" CONDUIT TO CONDENSING UNIT ON ROOF. REFERENCE ROOF POWER PLAN FOR ADDITIONAL INFORMATION.
26.433	ALL CONDUIT AND WIRE FOR WALK-INS SHALL BE DONE OUTSIDE OF WALK-INS AND ALL PENETRATIONS SHALL BE SEALED PER THE NEC.
26.434	E.C. SHALL PROVIDE (2)#12 AND (1)#12 GROUND IN 1/2" CONDUIT FOR 208V/1P ELECTRIC DEFROST CIRCUIT FROM CONDENSING UNIT. REFERENCE ROOF POWER PLAN FOR ADDITIONAL INFORMATION.
26.448	FIRE ALARM CONTROL PANEL (FACP): * G.C. TO PROVIDE AND INSTALL FACP, REF FIRE ALARM SPECIFICATION SECTION. * COMMERCIAL FIRE INC SHALL BE THE SOLE FIRE ALARMING MONITORING PROVIDER, NO SUBSTITUTIONS. * G.C. TO OBTAIN BIDS FROM COMMERCIAL FIRE INC, NO SUBSTITUTIONS. * G.C. TO COORDINATE INSTALLATION OF DEDICATED PHONE LINE TO FIRE ALARM CONTROL PANEL. * COMMERICAL FIRE, INC. CONTACT: ED GREER 1.800.241.1277 X148 ED.GREER@COMMERCIALFIRE.COM
26.499	LAPC. UNINTERRUPTIBLE POWER MANAGER. E.C. SHALL PROVIDE HARDWIRE CONNECTION TO LAPC AND EXTEND CIRCUITRY FROM LAPC TO CIRCUITS. REFERENCE LAPC WIRING DETAIL AND LAPC CIRCUIT SCHEDULE FOR ADDITIONAL INFORMATION.

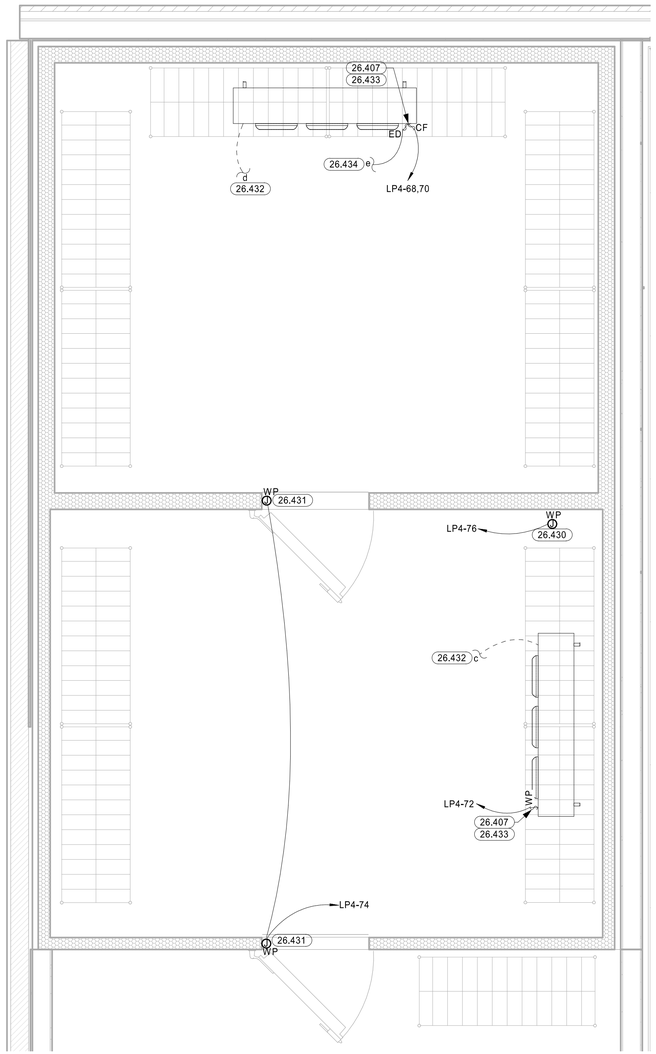

3 ENLARGED COOLER / FREEZER POWER PLAN
1/2" = 1'-0"

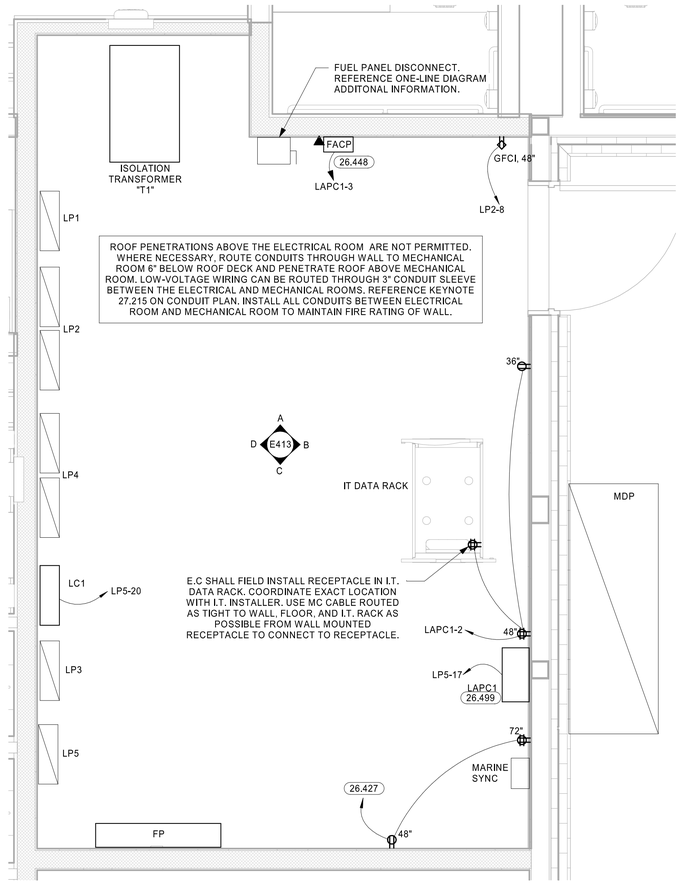

2 ENLARGED ELECTRICAL ROOM POWER PLAN
1/2" = 1'-0"

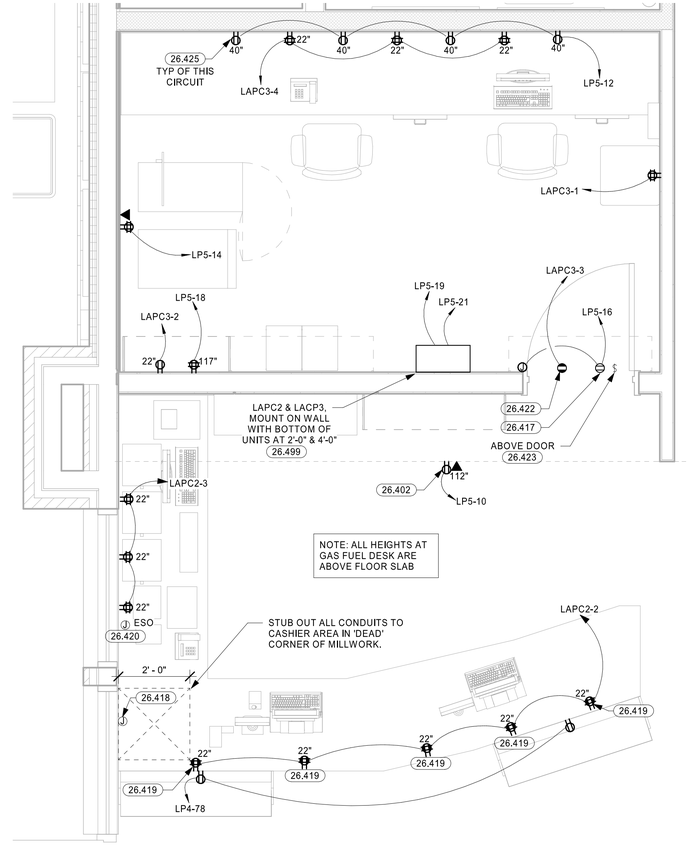

1 ENLARGED FUEL DESK / OBSERVATION POWER PLAN
1/2" = 1'-0"

HFA
HARRISON FRENCH & ASSOCIATES, LTD
t 479.273.7780
1705 S. Walton Blvd., Suite 3
Bentonville, Arkansas 72712
www.hfa-ae.com

STIPULATION FOR REUSE
THIS DRAWING WAS PREPARED FOR USE ON THE PROJECT AT NICHOLSON, MS
IT IS NOT TO BE REUSED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE EXPRESS WRITTEN CONSENT OF HARRISON FRENCH & ASSOCIATES, LTD. ANY REUSE WITHOUT SUCH CONSENT SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY OR LEGAL EXPOSURE TO HARRISON FRENCH & ASSOCIATES, LTD. AND THE ARCHITECT AND ENGINEERS EXECUTING THE DRAWINGS. FOR EXAMPLE ON ANOTHER PROJECT OR EXTENSION TO THIS PROJECT. LICENSED ARCHITECTS AND ENGINEERS. REPRODUCTION OF THIS DRAWING FOR ANY PURPOSE WHATSOEVER IS NOT AUTHORIZED AND MAY BE CONTRARY TO LAW.

Love's

STORE NUMBER: 860
I-59, EXIT 1
NICHOLSON, MS 39466
JOB NUMBER: 03-23-30009
TIER 1 180

ISSUE BLOCK

CHECKED BY:	CAR
DRAWN BY:	SED
DOCUMENT DATE:	2/7/2023
PROTO:	TIER 1 180
PROTO CYCLE:	Q4 - 2022

JAIME CASTANEDA LICENSED PROFESSIONAL ENGINEER 28109 ARKANSAS
2023.02.07 14:23:07-06'00'

ENLARGED POWER PLANS

SHEET: E412

2/7/2023 1:06:34 PM
C:\Users\sam.dempster\Documents\2021 Revit Projects\Loves_Nicholson_MS_MEP_T2_180_v21_HFA.Sam.Dempster.rvt
456b1413-ENLARGED POWER PLANS