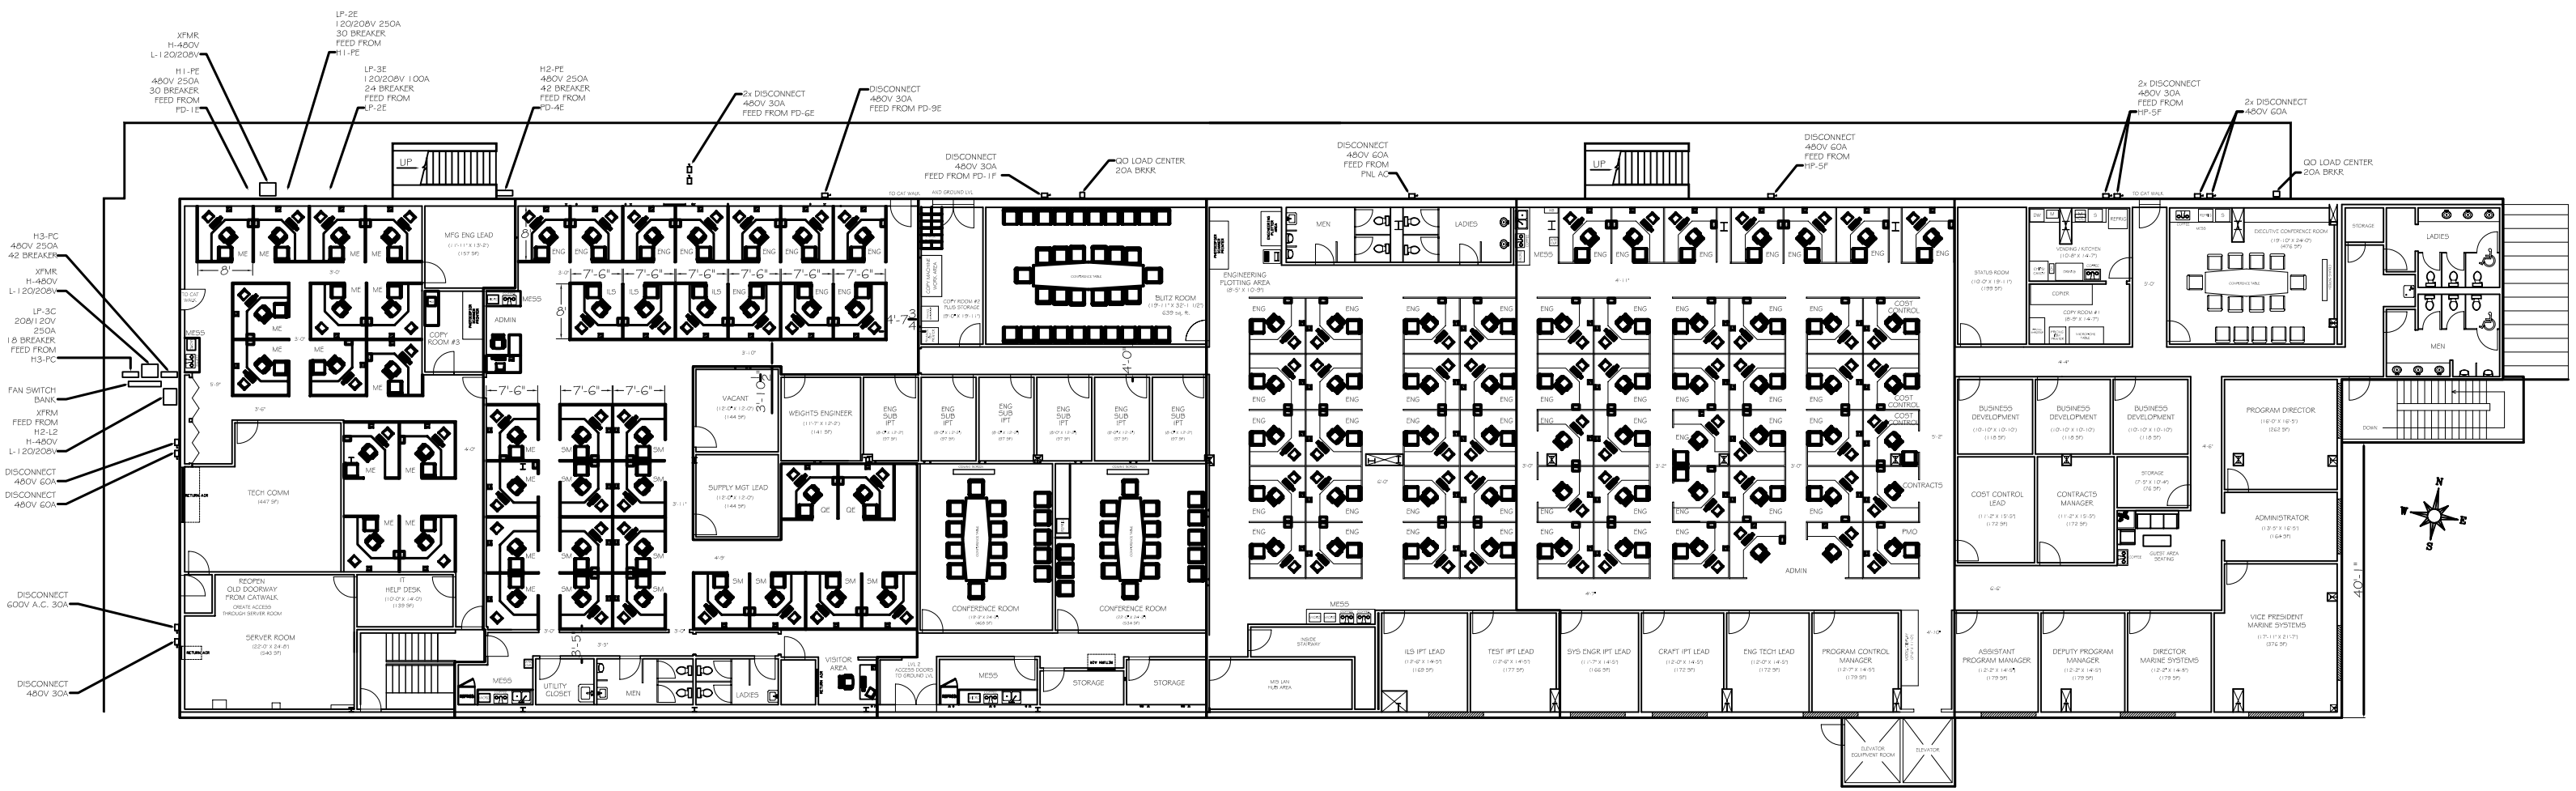
XFMR H-480V L-120/208V
LP-2E 120/208V 250A 30 BREAKER FEED FROM H1-PE
H1-PE 480V 250A 30 BREAKER FEED FROM PD-1E
LP-3E 120/208V 100A 24 BREAKER FEED FROM P-2E
H2-PE 480V 250A 42 BREAKER FEED FROM PD-4E
2x DISCONNECT 480V 30A FEED FROM PD-6E
DISCONNECT 480V 30A FEED FROM PD-9E
DISCONNECT 480V 30A FEED FROM PD-1F
QO LOAD CENTER 20A BRKR
DISCONNECT 480V 60A FEED FROM PNL AC
DISCONNECT 480V 60A FEED FROM HP-5F
2x DISCONNECT 480V 30A FEED FROM HP-5F
2x DISCONNECT 480V 60A
QO LOAD CENTER 20A BRKR
H3-PC 480V 250A 42 BREAKER
XFMR H-480V L-120/208V
LP-3C 208/120V 250A 18 BREAKER FEED FROM H3-PC
FAN SWITCH BANK
XFRM FEED FROM H2-L2 H-480V L-120/208V
DISCONNECT 480V 60A
DISCONNECT 480V 60A
DISCONNECT 600V A.C. 30A
DISCONNECT 480V 30A
UP
DOWN
MFG ENG LEAD
COPY ROOM #3
ADMIN
MESS
TECH COMM
REOPEN OLD DOORWAY FROM CATWALK
SERVER ROOM
IT HELP DESK
VACANT
WEIGHTS ENGINEER
SUPPLY MGT LEAD
CONFERENCE ROOM
BLITZ ROOM
ENGINEERING PLOTTING AREA
MEN
LADIES
COST CONTROL
CONTRACTS
PMO
ADMIN
STATLO ROOM
COPY ROOM #1
EXECUTIVE CONFERENCE ROOM
STORAGE
BUSINESS DEVELOPMENT
COST CONTROL LEAD
CONTRACTS MANAGER
PROGRAM DIRECTOR
ADMINISTRATOR
VICE PRESIDENT MARINE SYSTEMS
ASSISTANT PROGRAM MANAGER
DEPUTY PROGRAM MANAGER
DIRECTOR MARINE SYSTEMS
ILS IPT LEAD
TEST IPT LEAD
SYS ENGR IPT LEAD
CRAFT IPT LEAD
ENG TECH LEAD
PROGRAM CONTROL MANAGER
UTILITY CLOSET
VISITOR AREA
ELEVATOR EQUIPMENT ROOM
ELEVATOR
N
E
S
W