




9 EXISTING FRONT ELEVATION
SCALE: 1/8" = 1'-0"

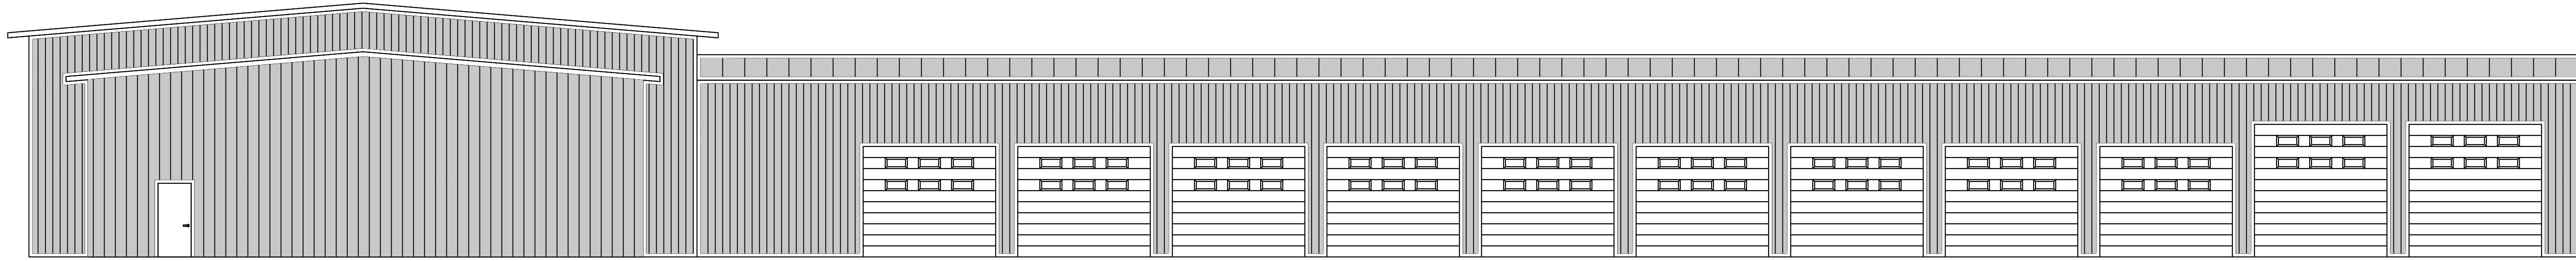

10 EXISTING SIDE ELEVATION
SCALE: 1/8" = 1'-0"

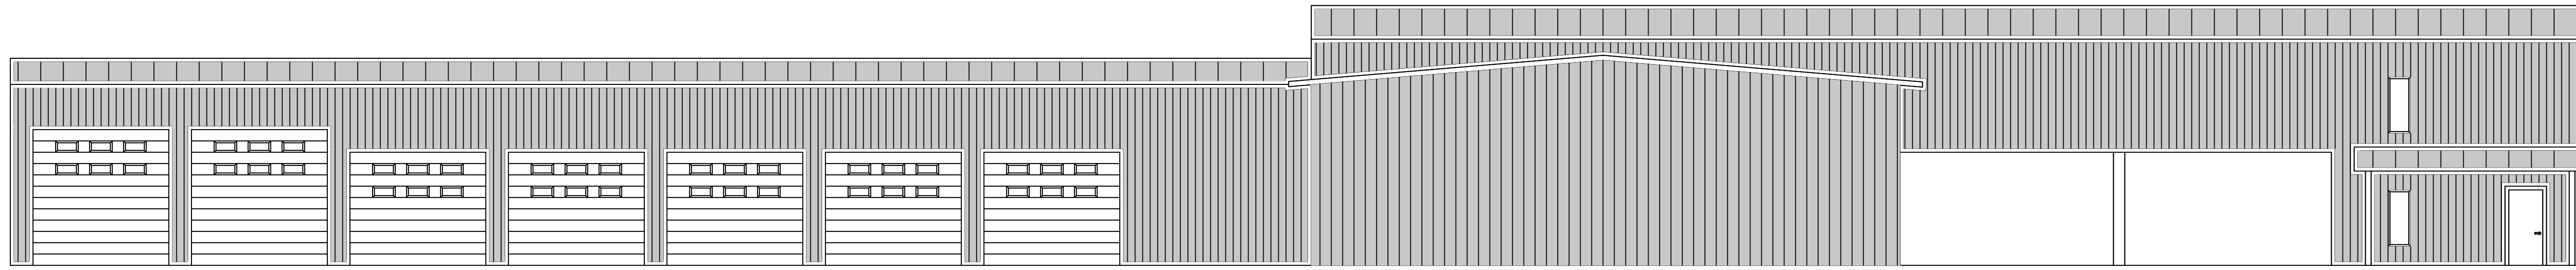

11 EXISTING REAR ELEVATION
SCALE: 1/8" = 1'-0"

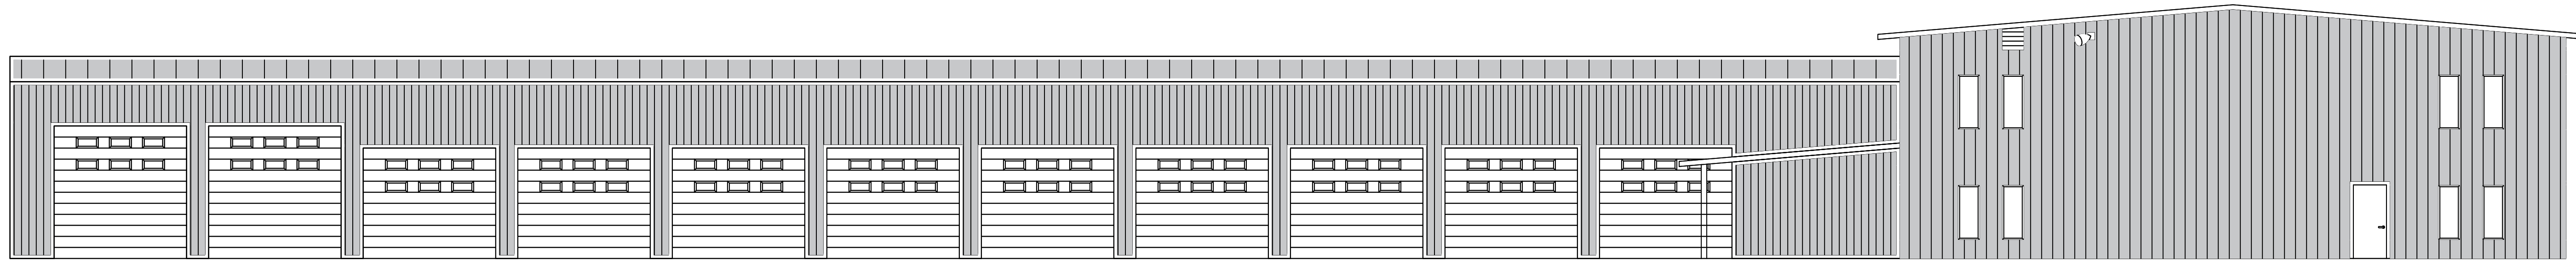

12 EXISTING SIDE ELEVATION
SCALE: 1/8" = 1'-0"

DAMMON
ENGINEERING, INC.
LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Misch, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

#	DESCRIPTION	DATE


SEAL:

NEW SERVICE AREA
LEGACY BUICK GMC SLIDELL
249 E HONNE BEACH RD,
SLIDELL, LA 70458
JOB No: 2477 | DATE: 11-05-2023
DRAWN BY: CKD | CHECKED BY: JMS

SHEET TITLE:
EXISTING
BUILDING
ELEVATIONS

DRAWING NUMBER:
A102
SHEET No: 5 of 10

D:\Projects\2023\11-05-2023\Legacy Buick GMC Slidell\11-05-2023.dwg
 PLOT DATE: 11/05/2023 10:00:00 AM
 PLOT BY: JMS
 PLOT SCALE: 1/8" = 1'-0"
 PLOT SIZE: 11x17
 PLOT ORIENTATION: Landscape
 PLOT RANGE: 0,0,0,0
 PLOT PENS: 1,2,3,4,5,6,7,8,9,10,11,12,13,14,15,16,17,18,19,20,21,22,23,24,25,26,27,28,29,30,31,32,33,34,35,36,37,38,39,40,41,42,43,44,45,46,47,48,49,50,51,52,53,54,55,56,57,58,59,60,61,62,63,64,65,66,67,68,69,70,71,72,73,74,75,76,77,78,79,80,81,82,83,84,85,86,87,88,89,90,91,92,93,94,95,96,97,98,99,100,101,102,103,104,105,106,107,108,109,110,111,112,113,114,115,116,117,118,119,120,121,122,123,124,125,126,127,128,129,130,131,132,133,134,135,136,137,138,139,140,141,142,143,144,145,146,147,148,149,150,151,152,153,154,155,156,157,158,159,160,161,162,163,164,165,166,167,168,169,170,171,172,173,174,175,176,177,178,179,180,181,182,183,184,185,186,187,188,189,190,191,192,193,194,195,196,197,198,199,200,201,202,203,204,205,206,207,208,209,210,211,212,213,214,215,216,217,218,219,220,221,222,223,224,225,226,227,228,229,230,231,232,233,234,235,236,237,238,239,240,241,242,243,244,245,246,247,248,249,250,251,252,253,254,255,256,257,258,259,260,261,262,263,264,265,266,267,268,269,270,271,272,273,274,275,276,277,278,279,280,281,282,283,284,285,286,287,288,289,290,291,292,293,294,295,296,297,298,299,300,301,302,303,304,305,306,307,308,309,310,311,312,313,314,315,316,317,318,319,320,321,322,323,324,325,326,327,328,329,330,331,332,333,334,335,336,337,338,339,340,341,342,343,344,345,346,347,348,349,350,351,352,353,354,355,356,357,358,359,360,361,362,363,364,365,366,367,368,369,370,371,372,373,374,375,376,377,378,379,380,381,382,383,384,385,386,387,388,389,390,391,392,393,394,395,396,397,398,399,400,401,402,403,404,405,406,407,408,409,410,411,412,413,414,415,416,417,418,419,420,421,422,423,424,425,426,427,428,429,430,431,432,433,434,435,436,437,438,439,440,441,442,443,444,445,446,447,448,449,450,451,452,453,454,455,456,457,458,459,460,461,462,463,464,465,466,467,468,469,470,471,472,473,474,475,476,477,478,479,480,481,482,483,484,485,486,487,488,489,490,491,492,493,494,495,496,497,498,499,500,501,502,503,504,505,506,507,508,509,510,511,512,513,514,515,516,517,518,519,520,521,522,523,524,525,526,527,528,529,530,531,532,533,534,535,536,537,538,539,540,541,542,543,544,545,546,547,548,549,550,551,552,553,554,555,556,557,558,559,560,561,562,563,564,565,566,567,568,569,570,571,572,573,574,575,576,577,578,579,580,581,582,583,584,585,586,587,588,589,590,591,592,593,594,595,596,597,598,599,600,601,602,603,604,605,606,607,608,609,610,611,612,613,614,615,616,617,618,619,620,621,622,623,624,625,626,627,628,629,630,631,632,633,634,635,636,637,638,639,640,641,642,643,644,645,646,647,648,649,650,651,652,653,654,655,656,657,658,659,660,661,662,663,664,665,666,667,668,669,670,671,672,673,674,675,676,677,678,679,680,681,682,683,684,685,686,687,688,689,690,691,692,693,694,695,696,697,698,699,700,701,702,703,704,705,706,707,708,709,710,711,712,713,714,715,716,717,718,719,720,721,722,723,724,725,726,727,728,729,730,731,732,733,734,735,736,737,738,739,740,741,742,743,744,745,746,747,748,749,750,751,752,753,754,755,756,757,758,759,760,761,762,763,764,765,766,767,768,769,770,771,772,773,774,775,776,777,778,779,780,781,782,783,784,785,786,787,788,789,790,791,792,793,794,795,796,797,798,799,800,801,802,803,804,805,806,807,808,809,810,811,812,813,814,815,816,817,818,819,820,821,822,823,824,825,826,827,828,829,830,831,832,833,834,835,836,837,838,839,840,841,842,843,844,845,846,847,848,849,850,851,852,853,854,855,856,857,858,859,860,861,862,863,864,865,866,867,868,869,870,871,872,873,874,875,876,877,878,879,880,881,882,883,884,885,886,887,888,889,890,891,892,893,894,895,896,897,898,899,900,901,902,903,904,905,906,907,908,909,910,911,912,913,914,915,916,917,918,919,920,921,922,923,924,925,926,927,928,929,930,931,932,933,934,935,936,937,938,939,940,941,942,943,944,945,946,947,948,949,950,951,952,953,954,955,956,957,958,959,960,961,962,963,964,965,966,967,968,969,970,971,972,973,974,975,976,977,978,979,980,981,982,983,984,985,986,987,988,989,990,991,992,993,994,995,996,997,998,999,1000

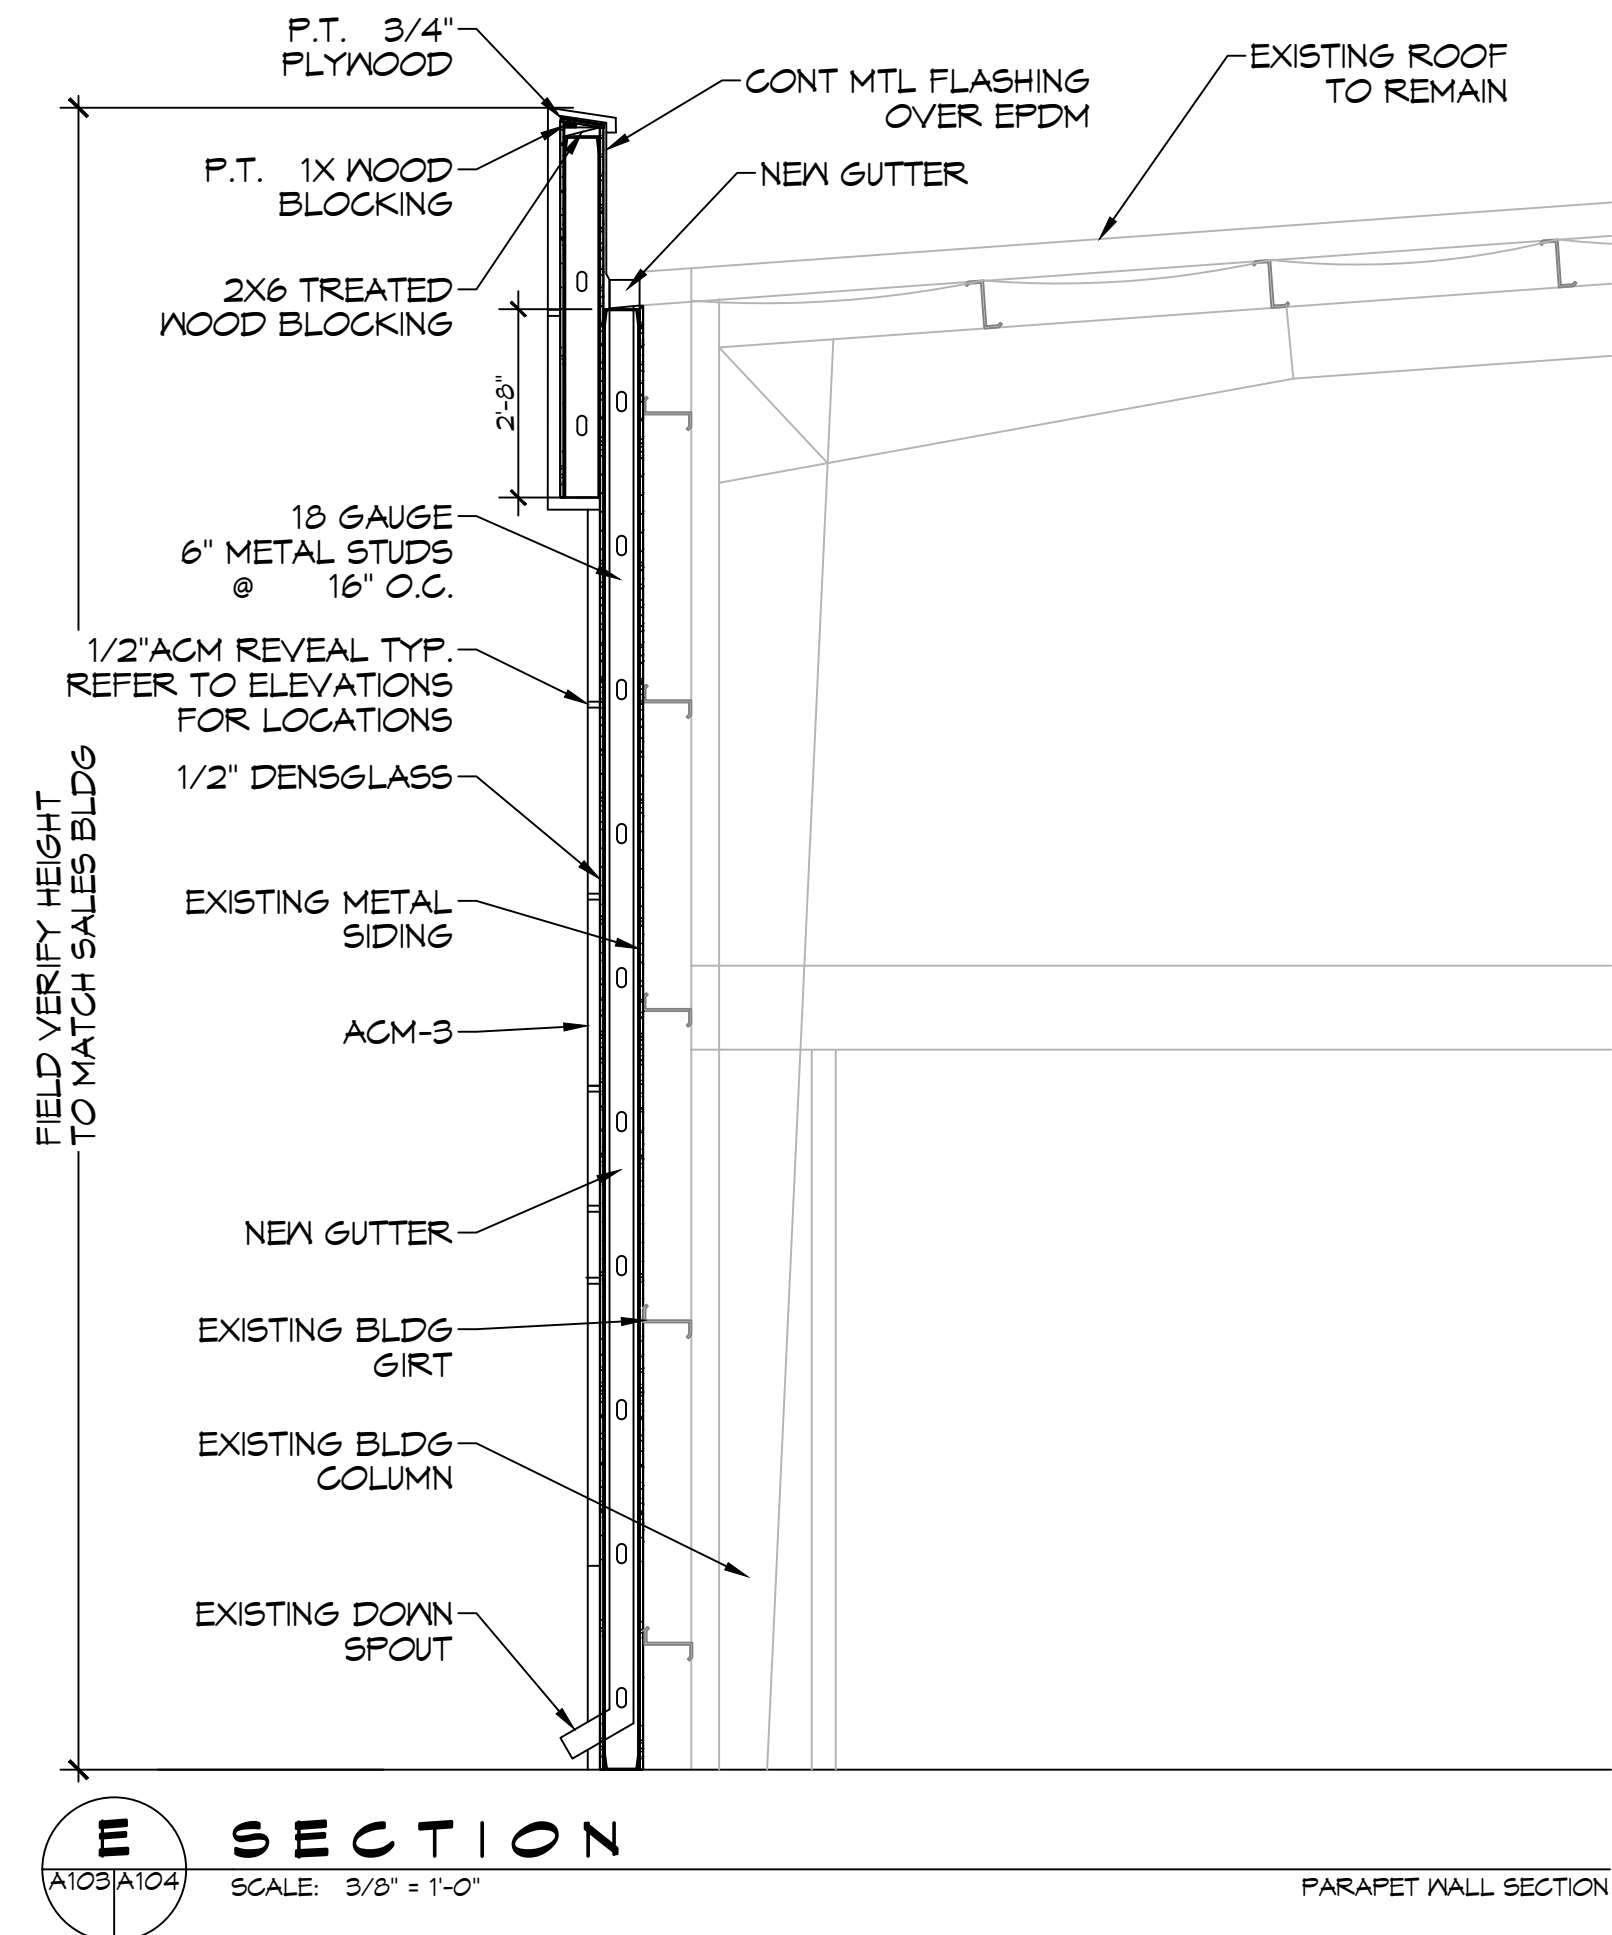


E SECTION
SCALE: 3/8" = 1'-0"
PARAPET WALL SECTION


UL DESIGN NO. U425

(For Exterior Walls, Ratings Applicable For Exposure To Fire On Interior Face Only (See Items 4 and 5)
Bearing Wall Rating: 45 Min., 1, 1 1/2 or 2 Hr. (See Items 2 and 4)

INTERIOR OR EXTERIOR WALL (FIRE FROM EITHER SIDE), SEE TBL 1

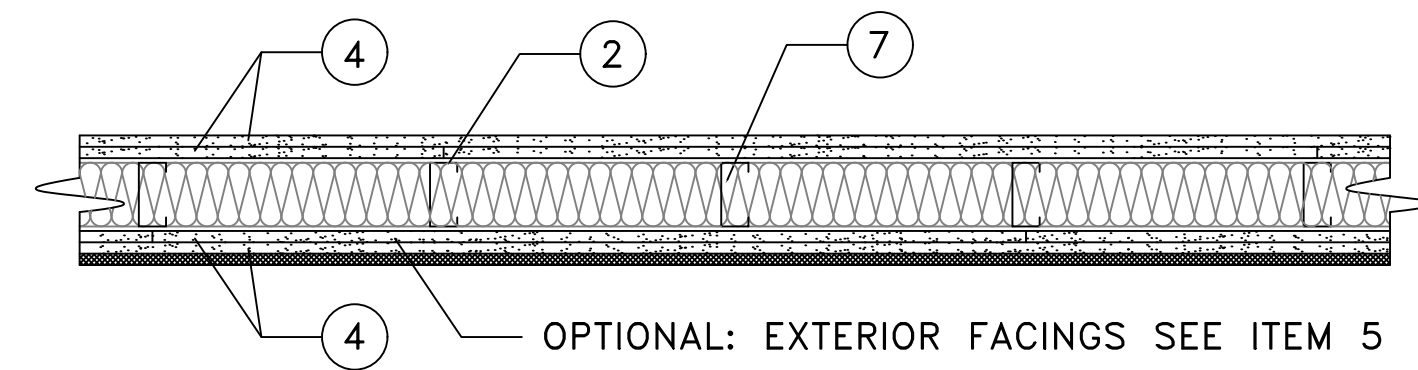

EXTERIOR WALL FIRE FROM INSIDE ONLY (SEE TBL 2)

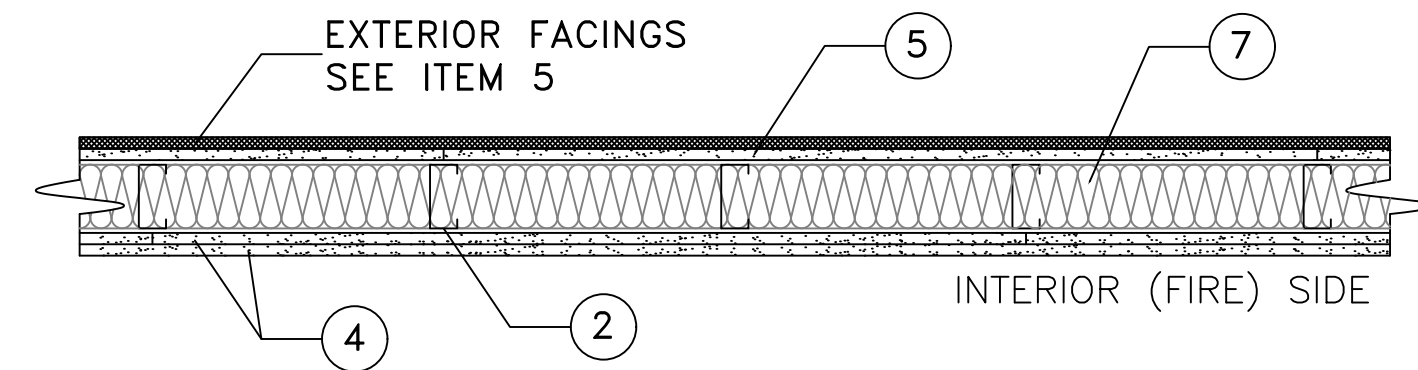

- 1 STEEL FLOOR AND CEILING TRACKS-- (Not shown)- Top and bottom tracks of wall assemblies shall consist of steel members, min No. 20 MSG (0.0324 in., min bare metal thickness) steel or min No. 20 MSG (0.036 in. thick) galv steel or No. 20 MSG (0.033 in. primed steel), that provide a sound structural connection between steel studs, and to adjacent assemblies such as a floor, ceiling, and/or other walls. Attached to floor and ceiling assemblies with steel fasteners spaced not greater than 24 in. O.C.
- 2 STEEL STUDS-- Min 3-1/2 in. wide, No. 20 MSG (0.0324 in., min bare metal thickness) corrosion protected cold formed steel studs designed in accordance with the current edition of the specification for the Design of Cold-Formed Steel Structural Members by the American Iron and Steel Institute. All design details enhancing the structural integrity of the wall assembly, including the axial design load of the studs, shall be as specified by the steel stud designer and/or producer, and shall meet the requirements of all applicable local code agencies. The max stud spacing of wall assemblies shall not exceed 24 in. O.C. (or 16 in. O.C. when Item 50 is used). Studs attached to floor and ceiling tracks with 1/2 in. long Type S-12 steel screws on both sides of studs or by welded or bolted connections designed in accordance with the AISI specifications.

See UL Spec for optional Framing Members

- 3 LATERAL SUPPORT MEMBERS--(Not shown)- Where required for lateral support of studs, support may be provided by means of steel straps, channels or other similar means as specified in the design of a particular steel stud wall system.
- 4 GYPSUM BOARD*-- Any 1/2 in. thick UL Classified Gypsum Board that is eligible for use in Design No. X515. Any 5/8 in. thick UL Classified Gypsum Board that is eligible for use in Design Nos. L501, G512 or U305. Gypsum board bearing the UL Classification Marking as to Fire Resistance. Applied vertically with joints between layers staggered. Outer layer of 3 layer construction may be applied horizontally unless specified below. The thickness and number of layers and percent of design load for the 45 min, 1 hr, 1-1/2 hr and 2 hr ratings are as follows:--

Table 1: Interior or Exterior (Fire From Either Side)
WALLBOARD PROTECTION BOTH SIDES OF WALL-

RATING	# OF LAYERS & THKNS OF BOARD IN EACH LAYERS	% OF DESIGN LOAD
45 Min.	1 layer, 1/2 in. thick	100
1 hr.	1 layer, 5/8 in. thick	100
1 1/2 hr.	2 layers, 1/2 in. thick	100
2 hr.	2 layers, 5/8 in. thick or	100
2 hr.	3 layers, 1/2 in. thick	100
2 hr.	2 layers, 3/4 in. thick	100

Note: Exterior facings allowed for use with Item 5 are also allowed to be installed on one side of the above walls.

Table 2: Exterior (Fire From Inside Only)
WALLBOARD PROTECTION ON INTERIOR SIDE OF WALL - # OF LAYERS & THKNS OF BOARD IN EACH LAYERS

RATING	# OF LAYERS & THKNS OF BOARD IN EACH LAYERS	% OF DESIGN LOAD
45 min.	1 layer, 1/2 in. thick	100
1 hr.	2 layers, 1/2 in. thick	100
1 1/2 hr.	2 layers, 5/8 in. thick	100
2 hr.	3 layers, 1/2 in. thick	100
2 hr.	2 layers, 3/4 in. thick	100

AMERICAN GYPSUM CO -- CNX.R14196
SEE UL SPEC FOR COMPLETE LIST OF MANUFACTURERS
SEE UL SPEC FOR ALTERNATES TO ITEM #4

- 5 Gypsum Boards--For exterior walls, Rating from Interior Side Only - 1/2 or 5/8 in. thick classified or unclassified gypsum boards applied vertically and attached to studs and runner tracks with 1 in. long Type S-12 bugle head screws spaced 12 in. O.C. along studs and tracks. One of the following exterior facings are to be applied over the gypsum board.

- a. Siding, Brick, or Stucco -- Aluminum siding, steel siding, brick veneer, or stucco attached to studs over gypsum sheathing and meeting the requirements of local code agencies. When a min 3-3/4 in. thick brick veneer facing is used, the Exterior Wall Rating is applicable with exposure on either face. Brick veneer wall attached to studs with corrugated metal wall ties attached to each stud with steel screws, not more than each sixth course of brick. When a min 3-3/4 in. thick brick veneer facing is used, Foamed Plastic (Item 10) may be used.
- b. Cementitious Backer Units* -- 1/2 or 5/8 in. thick, attached vertically or horizontally to steel studs over gypsum sheathing with 1-5/8 in. long, Type S-12, corrosion resistant, wafer head steel screws, spaced 8 in. O.C. Studs spaced a max of 16 in. O.C. Joints covered with glass fiber mesh tape.
- UNITED STATES GYPSUM CO -- Type DCB
NATIONAL GYPSUM CO -- Type PermBase, or DuraBacker
- c. Fiber-Cement Siding -- Fiber-cement exterior sidings including smooth and patterned panel or lap siding.
- d. Molded Plastic* -- Solid vinyl siding mechanically secured to framing members in accordance with manufacturer's recommended installation details.
ALSIDE, DIV OF ASSOCIATED MATERIALS INC
- e. Wood Structural Panel or Lap Siding -- APA Rated Siding, Exterior, plywood, OSB or composite panels with veneer faces and structural wood core, per PS 1 or APA Standard PRP-103, including textured, rough sawn, medium density overlay, brushed, grooved and lap siding.
- f. Building Units* -- (Not Shown) -- 3 in. thick 18 x 24 in. cellular glass blocks, applied to the gypsum board (Item 5) with PC 80 adhesive or fastened with F anchors spaced a maximum 24 in. O.C. F anchors fastened to framing members with 1-1/4 in. long #6 drywall screws.
PITTSBURGH CORNING LLC -- FOAMGLAS® T3+ Block, FOAMGLAS® T4+ Block, FOAMGLAS® 93 Block, FOAMGLAS® F Block

- 6 FASTENERS-- (Not Shown) -- Screws used to attach wallboard to studs: self-tapping bugle head sheet steel type, spaced 12 in. First layer Type S-12 by 1 in. long for 1/2 and 5/8 in. thick wallboards and 1-1/4 in. long for 3/4 in. thick wallboard. Second layer Type S-12 by 1-5/8 in. long for 1/2 and 5/8 in. thick wallboards and 2-1/4 in. long for 3/4 in. thick wallboard. Third layer Type S-12 by 1-7/8 in. long. Fasteners when Item 46 is used: First layer #6 x 2 in. long drywall screw spaced 8 in. O.C. along the perimeter and 12 in. O.C. in the field. Second layer #6 x 4 in. long drywall screw spaced 8 in. O.C. along the perimeter and 12 in. O.C. in the field. Horizontal joints to be staggered 12 in. between layers.

SEE UL SPEC FOR ALTERNATES TO ITEM #7
ALSO SEE UL SPEC FOR ADDITIONAL ITEMS
8. Joint Tape and Compound
9. Furring Channels
10. Foamed Plastic
11. Cementitious Backer Units.
12. Wall and Partitions Facings and Accessories
13. Wall and Partitions Facings and Accessories

*Bearing the UL Classification Mark

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.8832
Chief Engineer: Brian Hirsch, PE
554 Old Spanish Trail
Slidell, LA 70458


REVISIONS	DATE
# DESCRIPTION	

SEAL:

NEW SERVICE AREA
LEGACY BUICK GMC SLIDELL
209 E HONNIE BEACH RD.
SLIDELL, LA 70458
JOB No: 11-05-2023
DATE: 2/4/24
DRAWN BY: CKD
CHECKED BY: JMS

SHEET TITLE:
PARAPET WALL SECTION
AND FIRE RATING PLAN

DRAWING NUMBER:
A104
SHEET No: 1 of 18

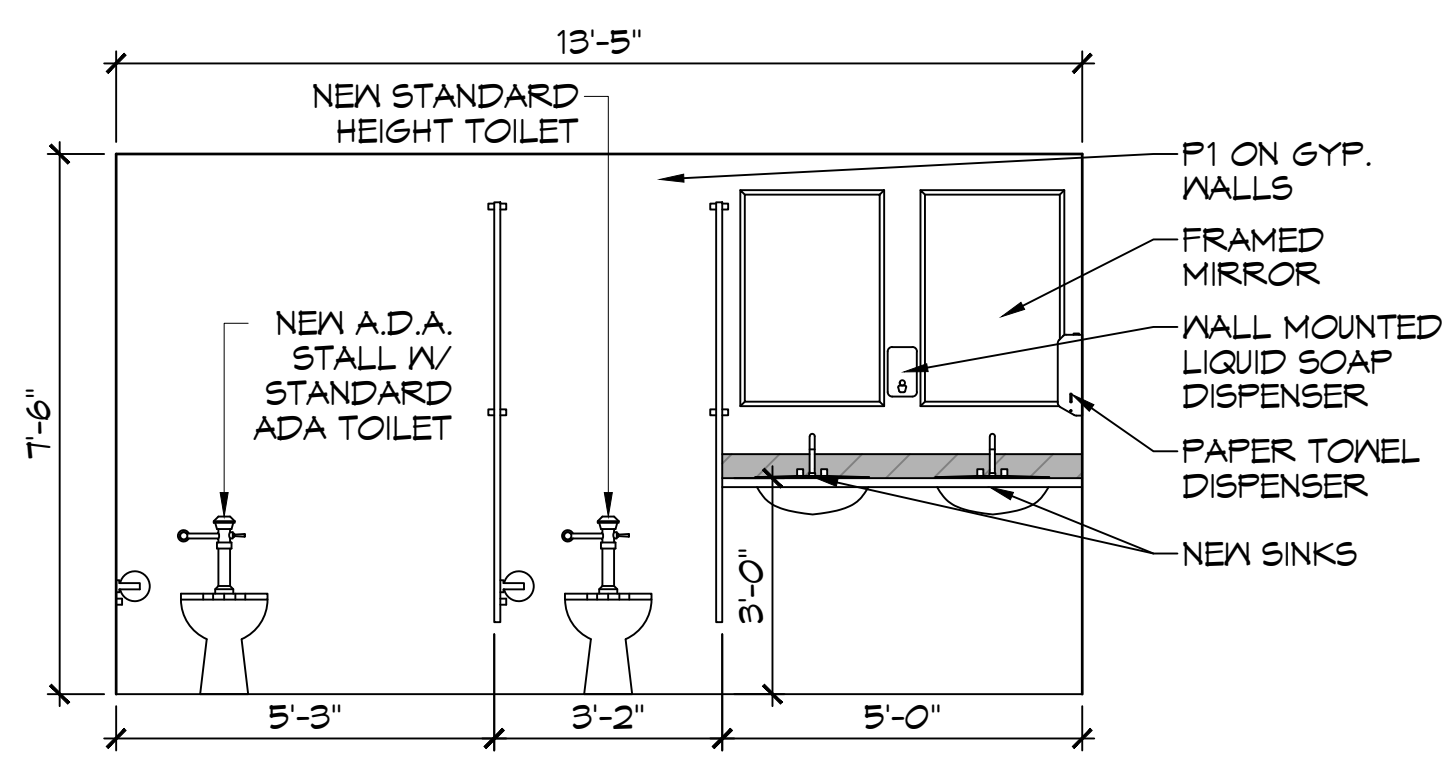

F WOMEN'S RESTROOM
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

HARDWARE SCHEDULE


ITEM	MANUFACTURER	NUMBER/FINISH	REMARKS
CONCEALED STANDARDS	CAPITOL HARDWARE	# 1125-3 (BRIGHT ZINC FINISH) OR EQUAL	MEDIUM DUTY 14 GAUGE STEEL (1/2" SLOTS @ 1" O.C.)
SHelf BRACKETS	CAPITOL HARDWARE	# 1706 (SATIN ZINCRO FINISH) OR EQUAL	LIGHT DUTY (FOR 6"-10" BRACKETS)
SHelf PINS	CAPITOL HARDWARE	# 86 (STOCK MILL ALUMINUM FINISH) OR EQUAL	(1/4" DIA. X 5/16")
DRaWER/PULL DOORS	HAFELE	# 115.61.601 (MATT STAINLESS STEEL FINISH) OR EQUAL	(4" L. WIRE PULL)
DRaWER SLIDES	KNAPT & VOEST	# 8500 OR EQUAL	FULL EXTENSION
GLIDE	HAFELE	# 650.04.300 OR EQUAL	(30MM)
GRoMMET W/ CAP	DOUG MOCKETT	# XG SERIES (BLACK FINISH) OR EQUAL	(FOR 3" DIA. HOLE)
DOOR HINGES	GRASS	# 1203-VZ8 OR EQUAL	(165 DEG. W/ RECESSED MOUNTING PLATE)

MILLWORK FINISH SCHEDULE


NO.	LOCATION	COLOR	DESCRIPTION	MANUFACTURER
PL1	COFFEE COUNTER	WOODGRAIN LAMINATE LIGHT ANIGRE-HP	HIGH PRESSURE LAMINATE	WWW.HERMANMILLER.COM
PL2	COFFEE COUNTER BASE	2202 (FORMERLY AX441) BRUSHED ALUMINUM MATTE FIN.	HIGH PRESSURE LAMINATE	FORMICA 1.800.FORMICA
GR1	COFFEE COUNTER	CELADOR BEIGE 3/4" THK. SQUARE EDGED	QUARTZ COMPOSITE	NEVAMAR PANOLAM INDUSTRIES 1.800.638.4380 WWW.NEVAMAR.COM

MILLWORK NOTES


1. VERIFY ALL FINAL SELECTION OF FINISHES WITH ARCHITECT AND INTERIOR DESIGNER BEFORE INSTALLATION.
2. TOE-KICKS @ ALL COUNTERS TO BE 4" HIGH.
3. COORDINATE MILLWORK WITH ELECTRICAL SO THAT NO CONFLICTS ARISE.
4. GRoMMETS SHALL BE PLACED AS REQUIRED FOR ELECTRICAL WIRING AND SHALL MATCH COUNTERTOP MATERIAL COLOR. VERIFY ALL LOCATIONS WITH ARCHITECT PRIOR TO INSTALLATION.
5. ALL INTERIOR DRAWERS SHALL BE MELAMINE.

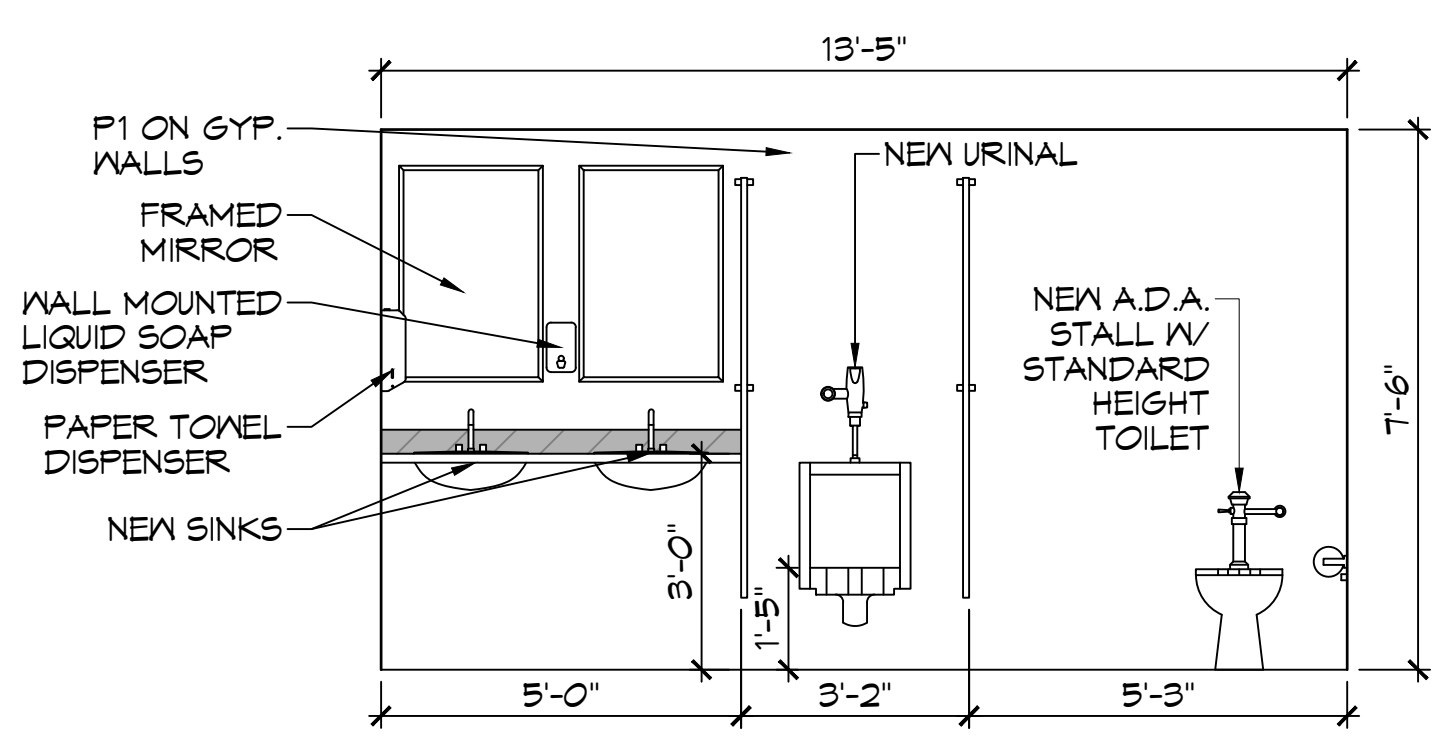


G MEN'S RESTROOM
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

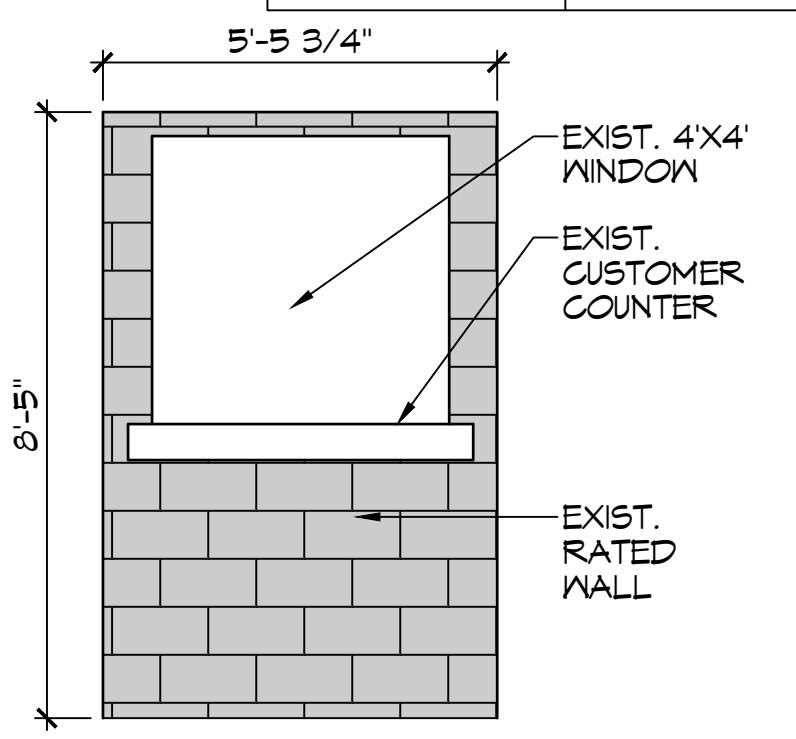

H PARTS COUNTER
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

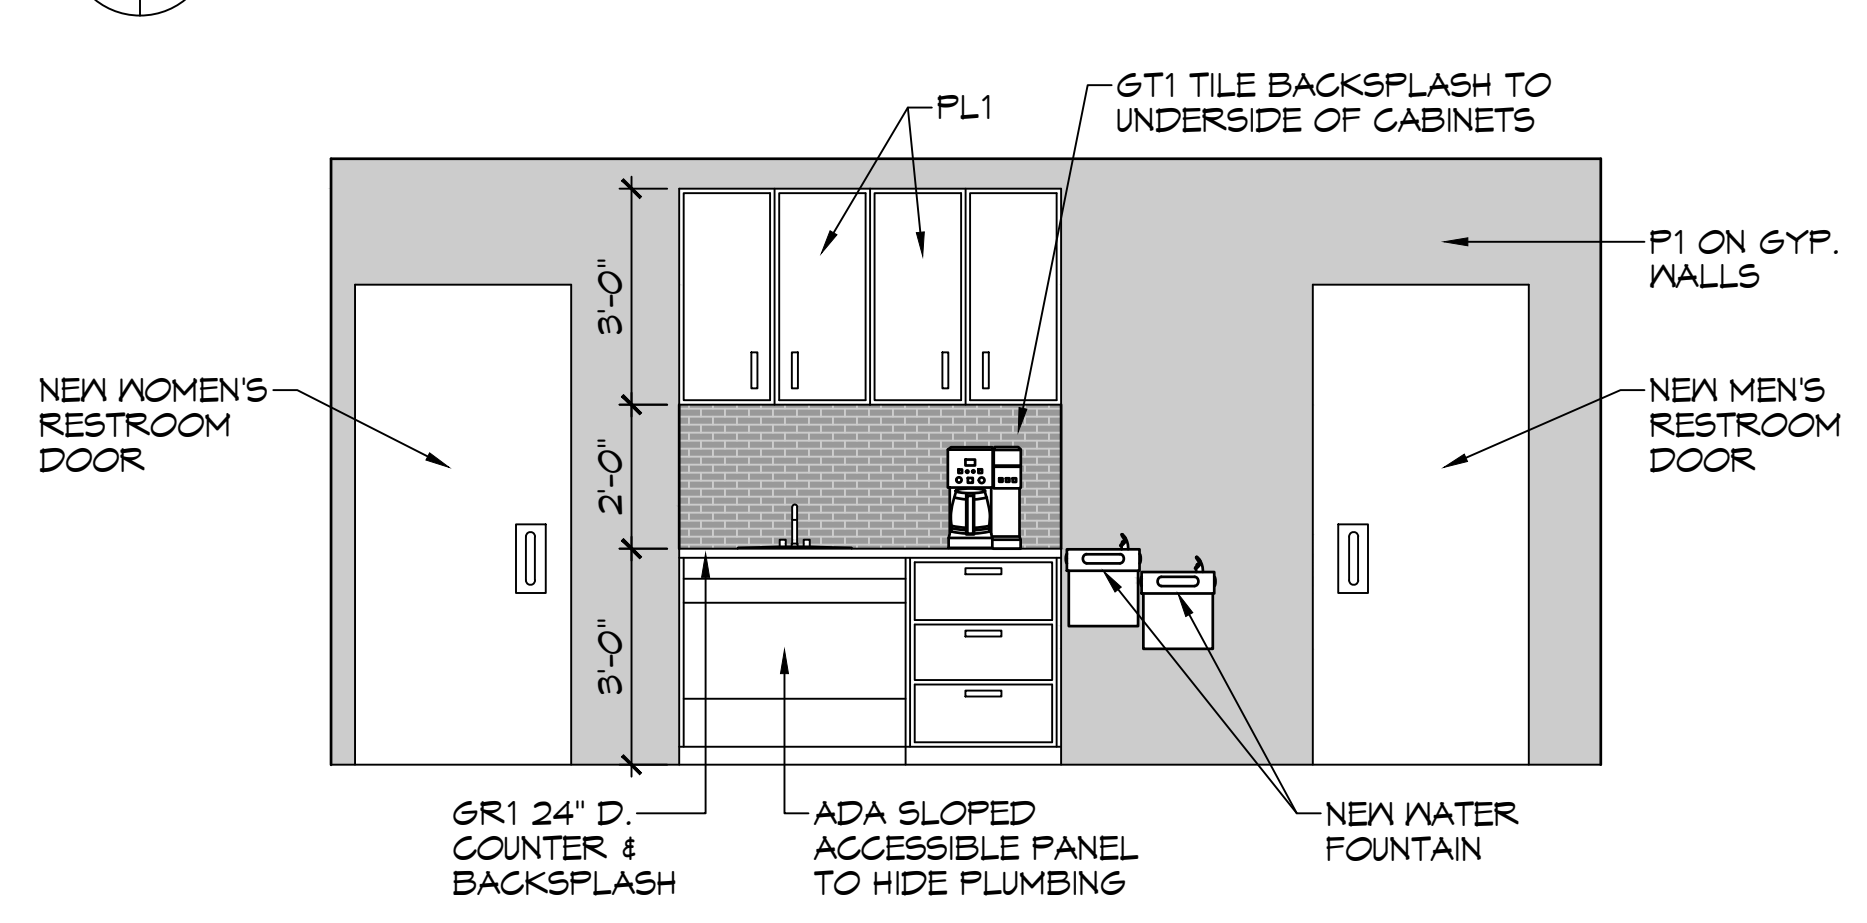


J COFFEE COUNTER/RESTROOMS
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

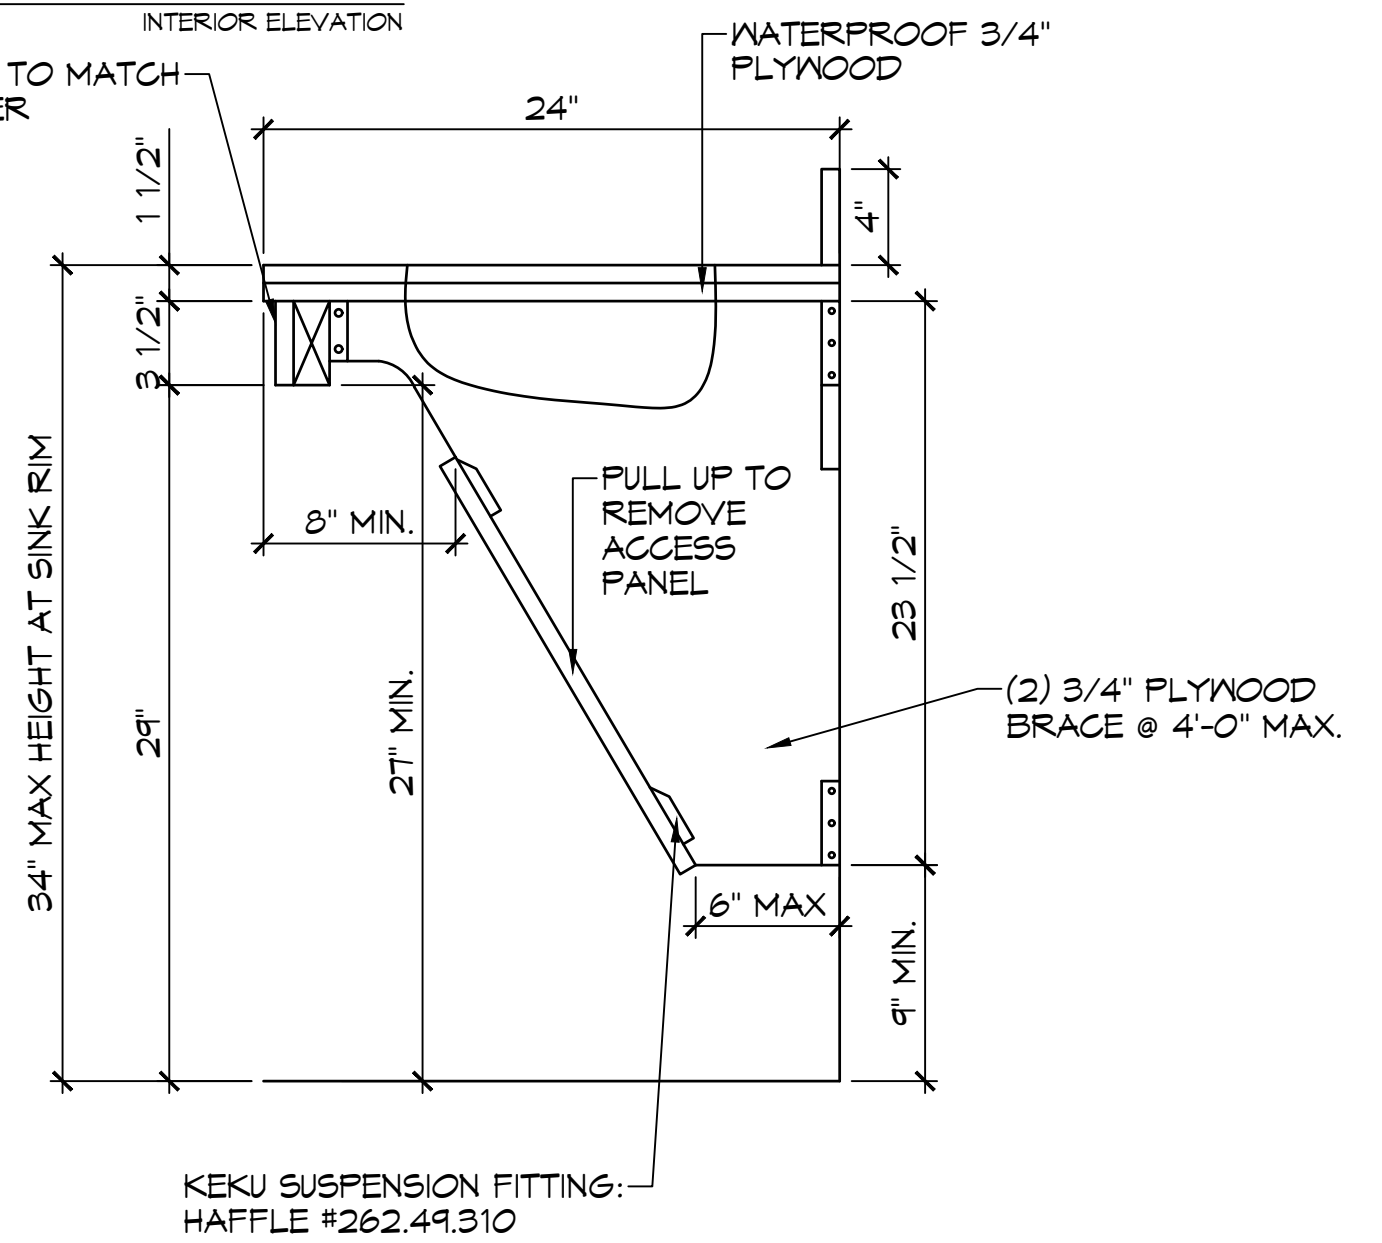


MILLWORK DETAIL


SCALE: 1-1/2" = 1'-0" INTERIOR ELEVATION

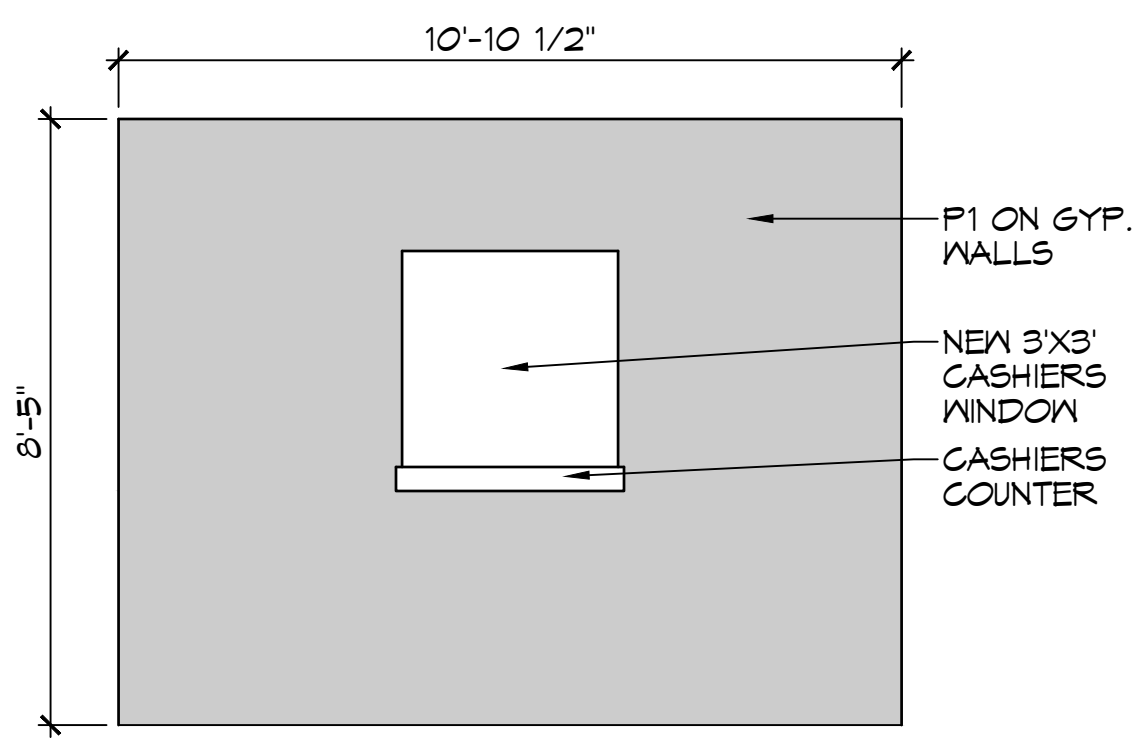

K CASHIERS COUNTER
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

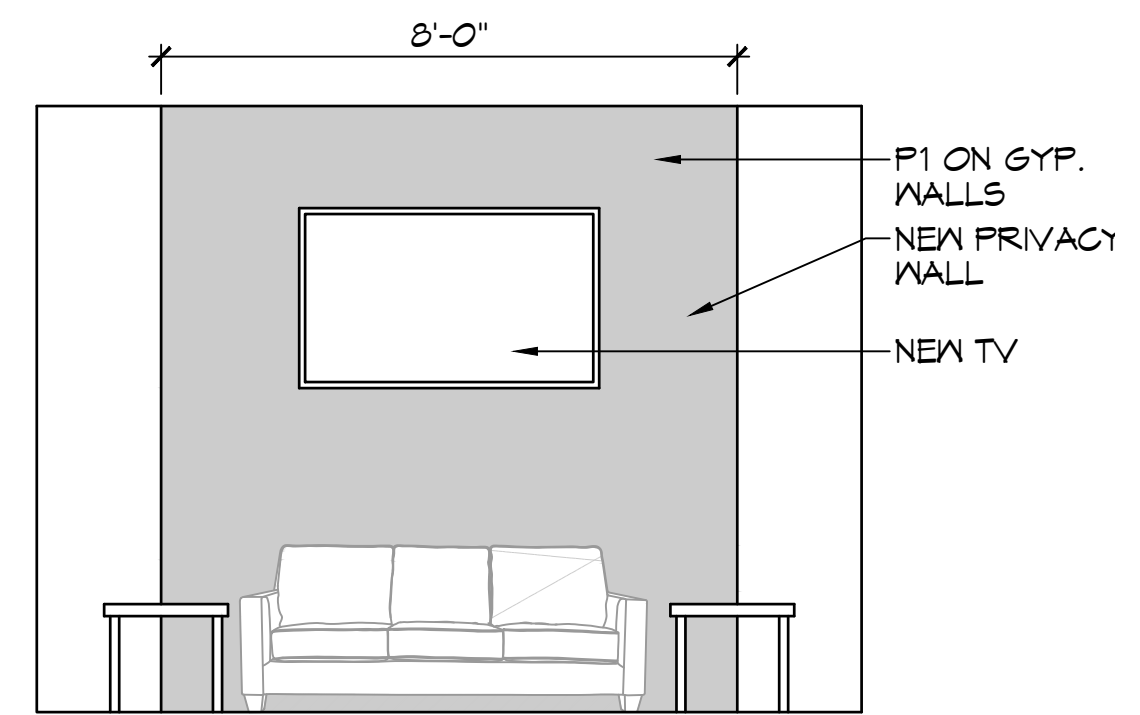

L CUSTOMER LOUNGE
SCALE: 3/8" = 1'-0" INTERIOR ELEVATION

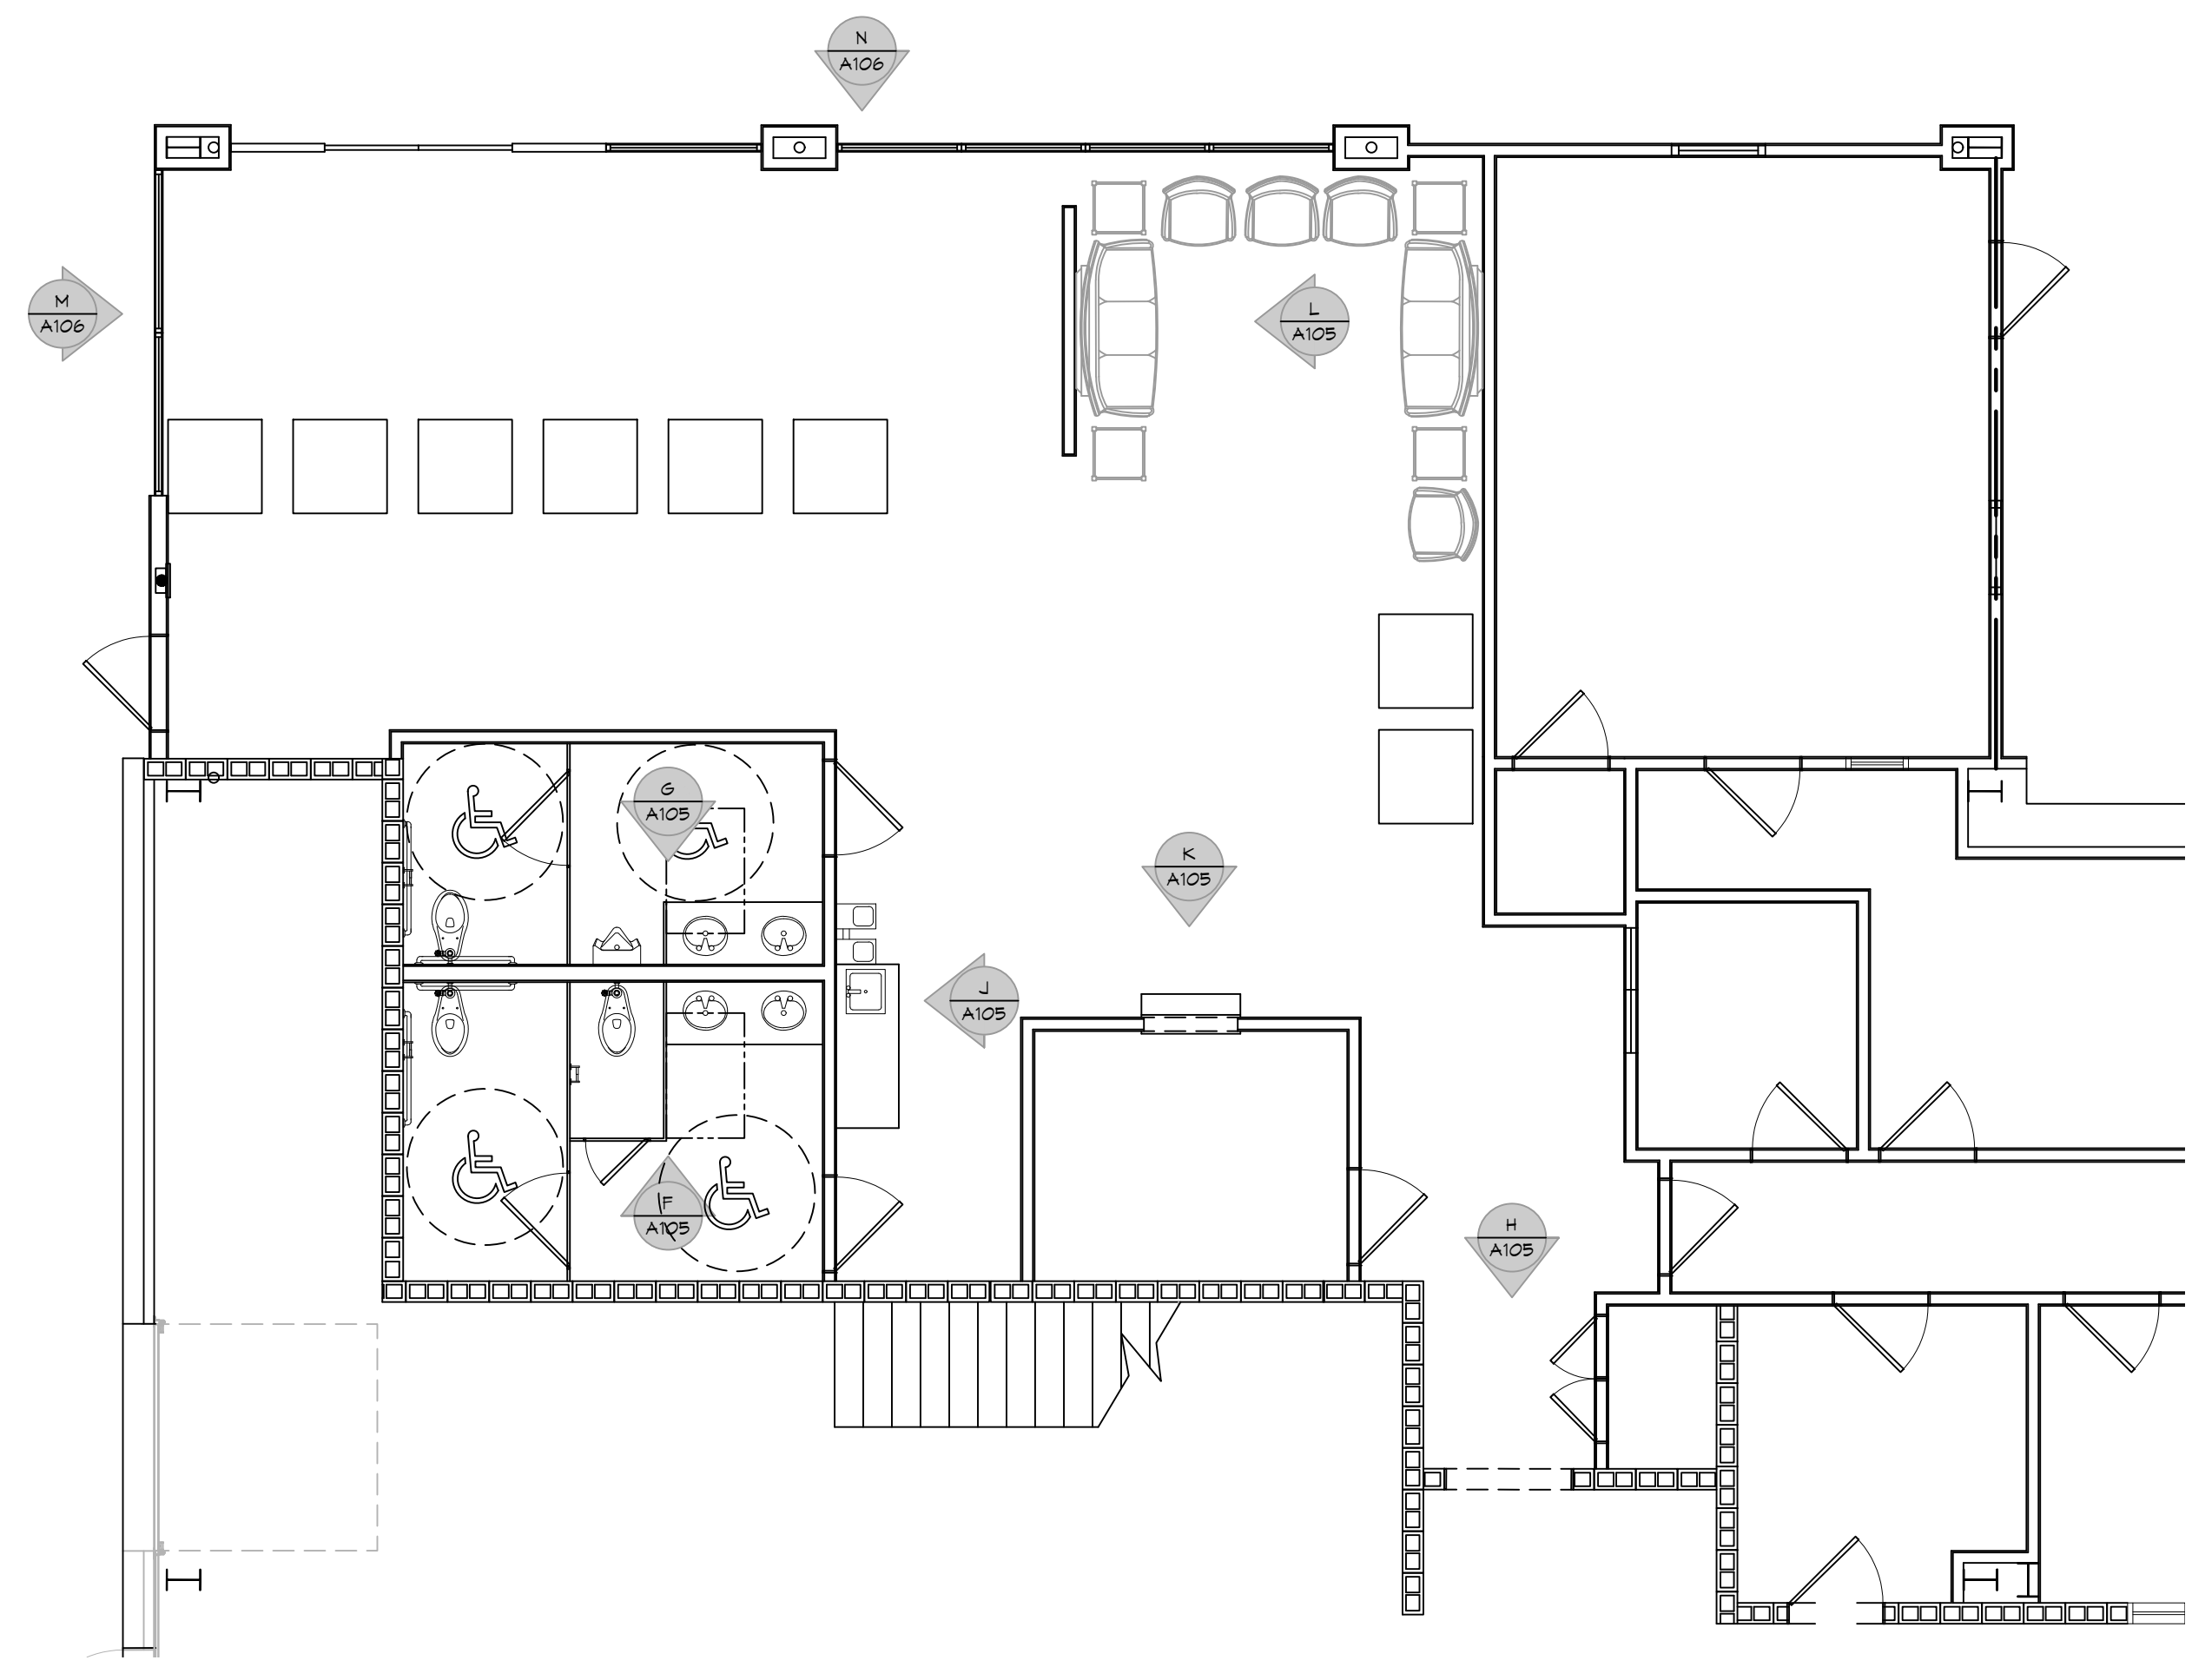

DAMMON ENGINEERING, INC.

LOUISIANA & MISSISSIPPI

www.dammonengineering.com
info@dammonengineering.com
594 Old Spanish Trail
Slidell, LA 70468
Chief Engineer: Brian Watch, PE

#	DATE	DESCRIPTION
1	8/1/2022	Revised Millwork and Counter Tops

REVISIONS

NEW SERVICE AREA
LEGACY BUCK GMC SLIDELL
249 E HONOR BEACH RD.
SLIDELL, LA 70459

JOB No: 11-05-2025
DATE: 2/27/25
DRAWN BY: BAW
CHECKED BY: BAW

SHEET TITLE:
INTERIOR ELEVATIONS PLAN

DRAWING NUMBER:
A105


SHEET No: 10 of 18

GENERAL NOTES


1. ACM PANELS TO BE DRY JOINT SYSTEM. BATTEN, MOLDING OR FIELD CUT "SHEET AND STICK" SYSTEMS ARE NOT ACCEPTABLE. CAP FLASHINGS ARE NOT ACCEPTABLE. FLASHINGS MUST BE INTEGRAL TO THE SYSTEM.
2. ACM FINISH AREAS TO BE FREE OF LIGHTS, CAMERAS, GUTTERS, AND OTHER BUILDING ACCESSORIES.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI


Chief Engineer: Brian March, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.8832

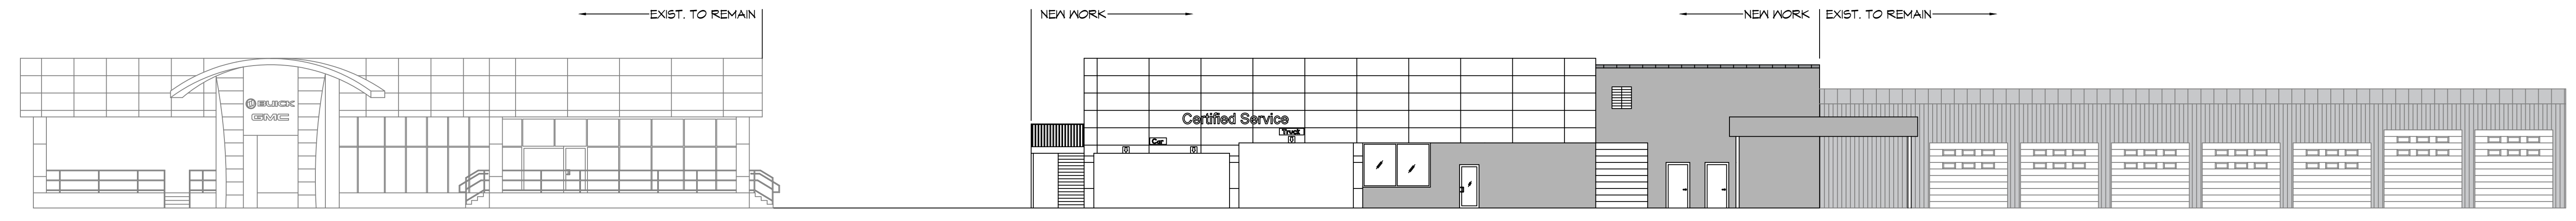


23 STREET SCAPE VIEW
SCALE: N.T.S.

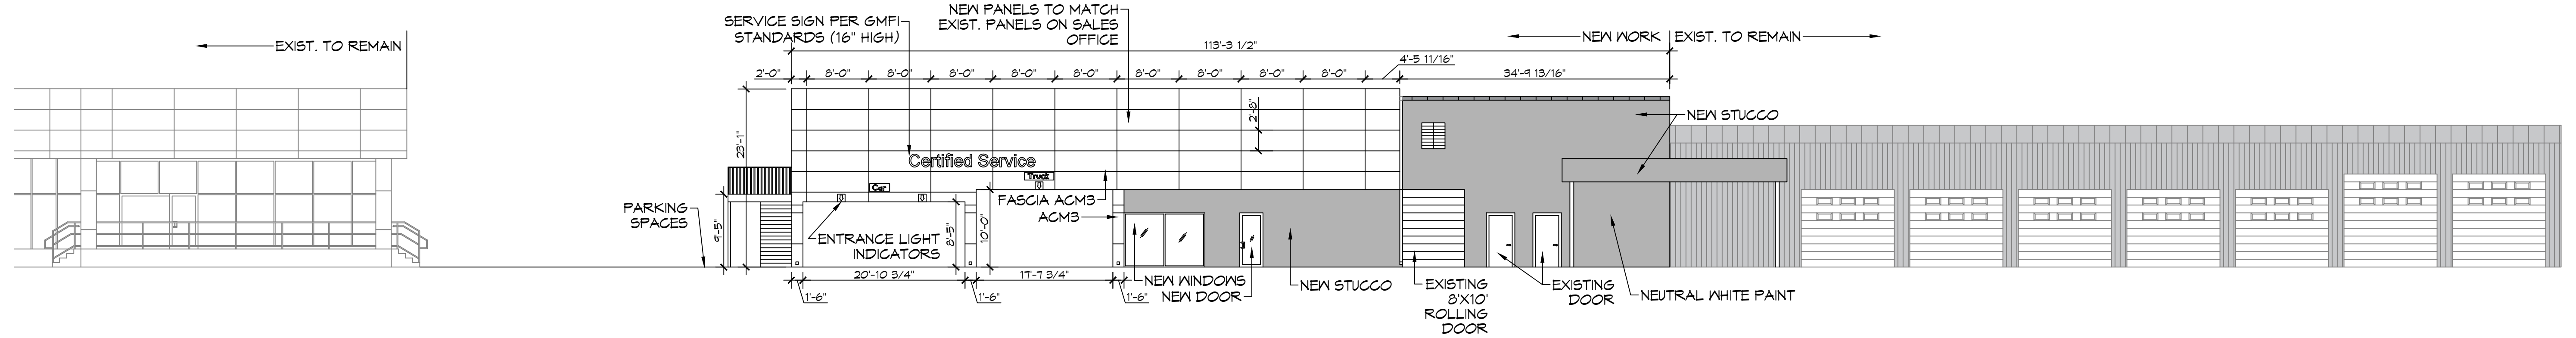

24 NEW FRONT ELEVATION
SCALE: 3/32" = 1'-0"

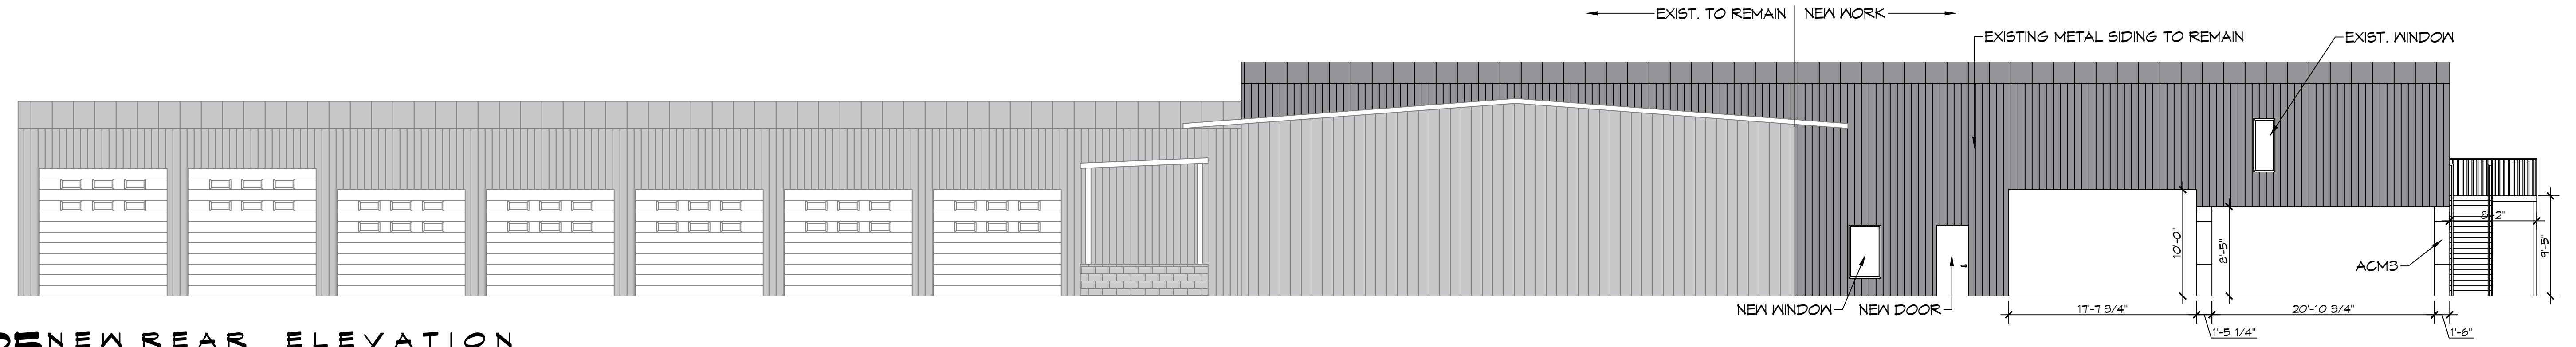

25 NEW REAR ELEVATION
SCALE: 1/8" = 1'-0"

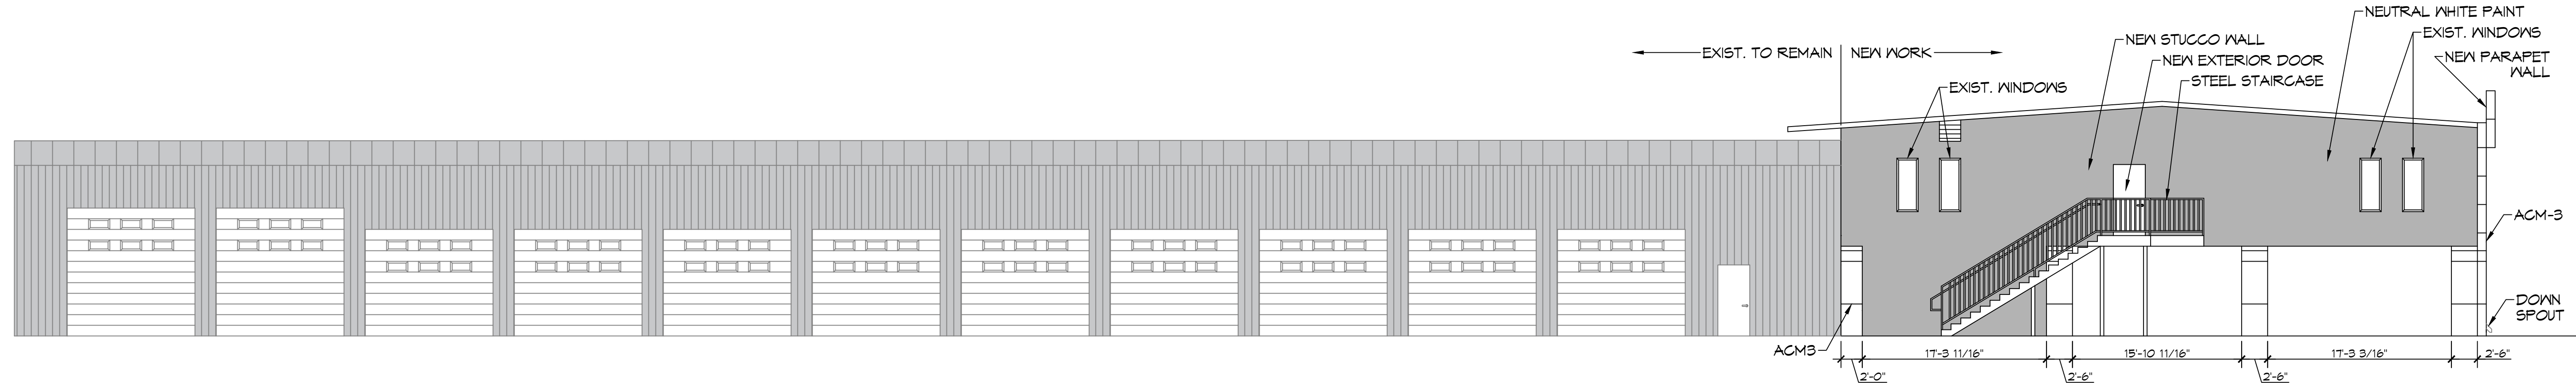

26 NEW SIDE ELEVATION
SCALE: 1/8" = 1'-0"

#	DESCRIPTION	DATE

SEAL:

NEW SERVICE AREA
LEGACY BUICK GMC SLIDELL
249 E HORIZON BEACH RD.
SLIDELL, LA 70458
JOB No: 2471 | DATE: 11-05-2023
DRAWN BY: CKD | CHECKED BY: JMS

SHEET TITLE:
NEW BUILDING ELEVATIONS







DRAWING NUMBER:

A107


SPLIT SYSTEM SCHEDULE																				
AIR HANDLER							CONDENSER													
Tag	Area Served	Tons (Nominal)	Total CFM	O/A (CFM)	Position	Make	Model	Cooling TMB	Gas Heat SMBH	MBH	Motor HP	Power VAC	PH	Tag	Make	Model	VAC	PH	MCA	Remarks
AH1-1	Office	4	1480	280	Uplow	Goodman	GAR509004C	48.6	35.2	80	1/2	115	1	CU-2	Goodman	GSE140481	208	1	26.4	1, 2, 3, 4, 5
AH1-2	Lobby	4	1480	280	Uplow	Goodman	GAR509004C	48.6	35.2	80	1/2	115	1	CU-2	Goodman	GSE140481	208	1	26.4	1, 2, 3, 4, 5
AH1-3	Office	1-1/2	570	50	Uplow	Goodman	AR1P1830	13.7	11.1	1	1/3	208	1	CU-3	Goodman	GSE140181	208	1	12.2	1, 2, 3, 4
AH1-4	Office	1-1/2	570	50	Uplow	Goodman	AR1P1830	13.7	11.1	1	1/3	208	1	CU-4	Goodman	GSE140181	208	1	12.2	1, 2, 3, 4

DIFFUSER SCHEDULE			
Mark No.	Service	Neck Size	Description
A	Supply Air	Ref. Plan	Price 620D Register, Double Deflection w/ Damper
B	Supply Air	Ref. Plan	12"x 12" Adjustable Square Cone Diffuser, Price ASCDA w/ Insulated Back Panel
C	Supply Air	Ref. Plan	24"x 24" Adjustable Square Cone Diffuser, Price ASCDA w/ Insulated Back Panel
D	Transfer Grille	Ref. Plan	Sight proof steel transfer grille, Price STG


EXHAUST FAN SCHEDULE						
TAG	FAN		POWER		MAKE / MODEL	REMARKS
	AIRFLOW (CFM)	TSP ("wc)	AMPS	VAC		
EF-1	120	0.1	0.4	120	1	60 Broan A110 1, 2
EF-2	90	0.2	0.4	120	1	60 Broan A110 1, 2
EF-3	60	0.2	0.37	120	1	60 Broan A80 1, 2

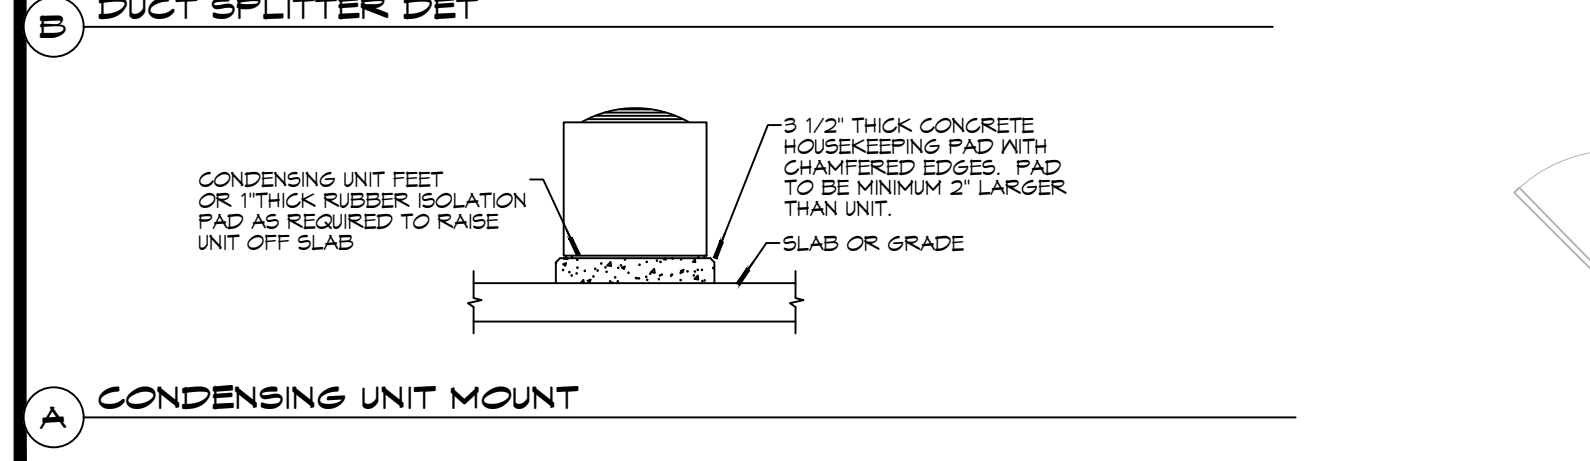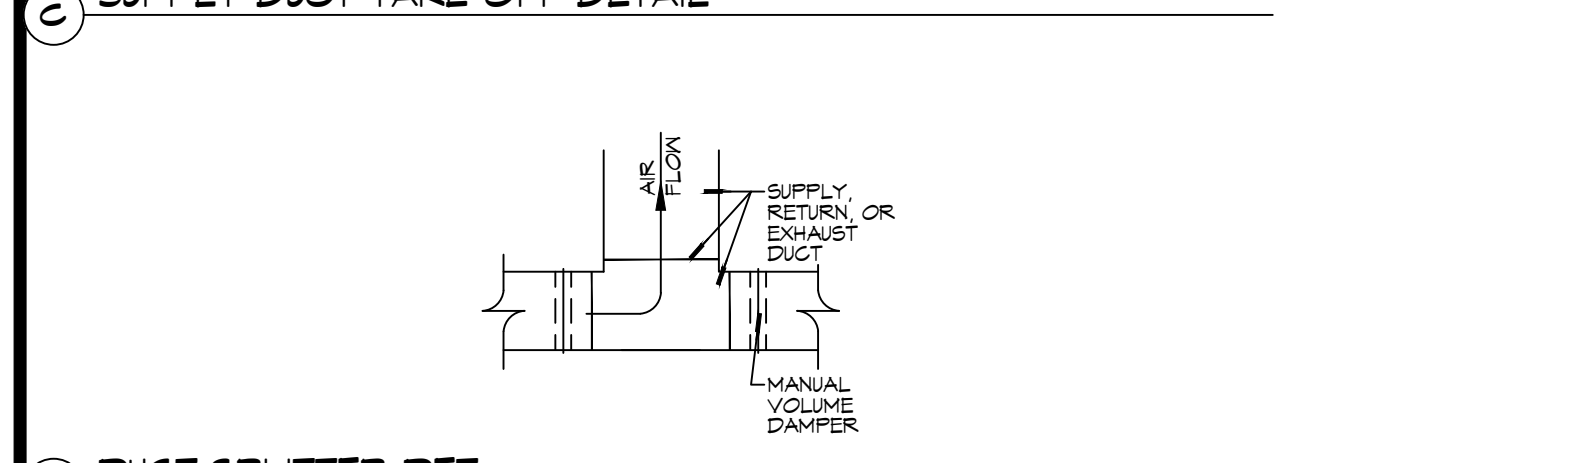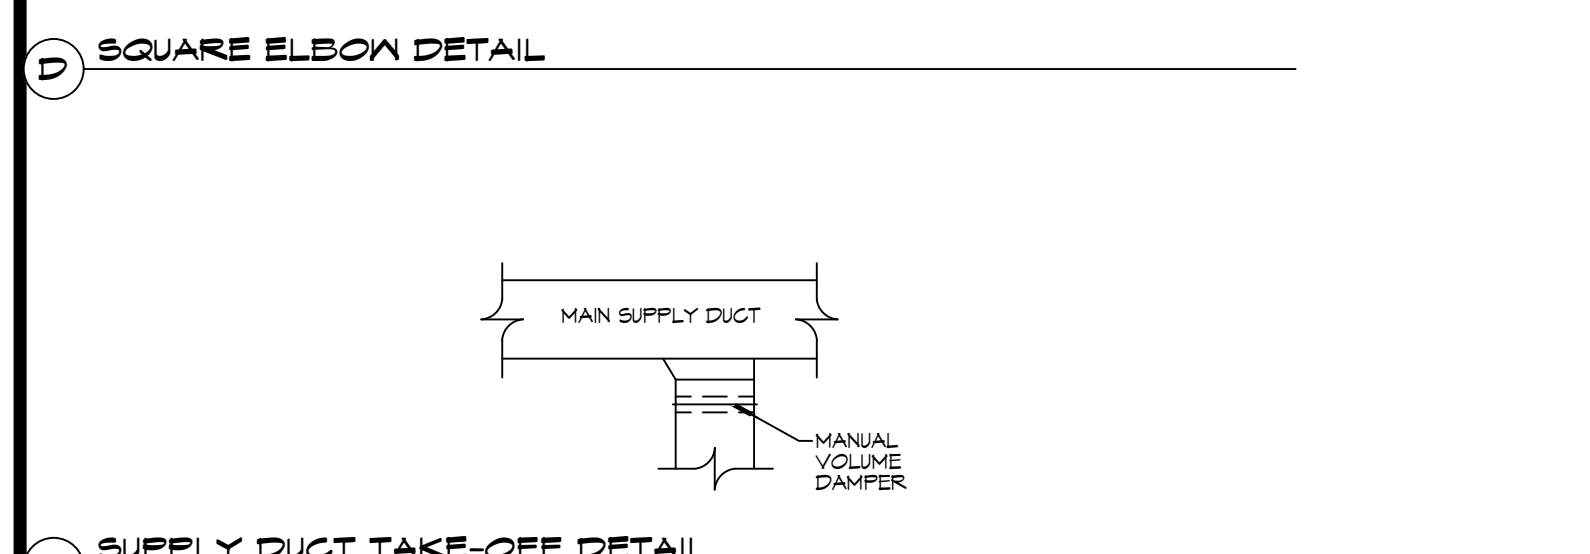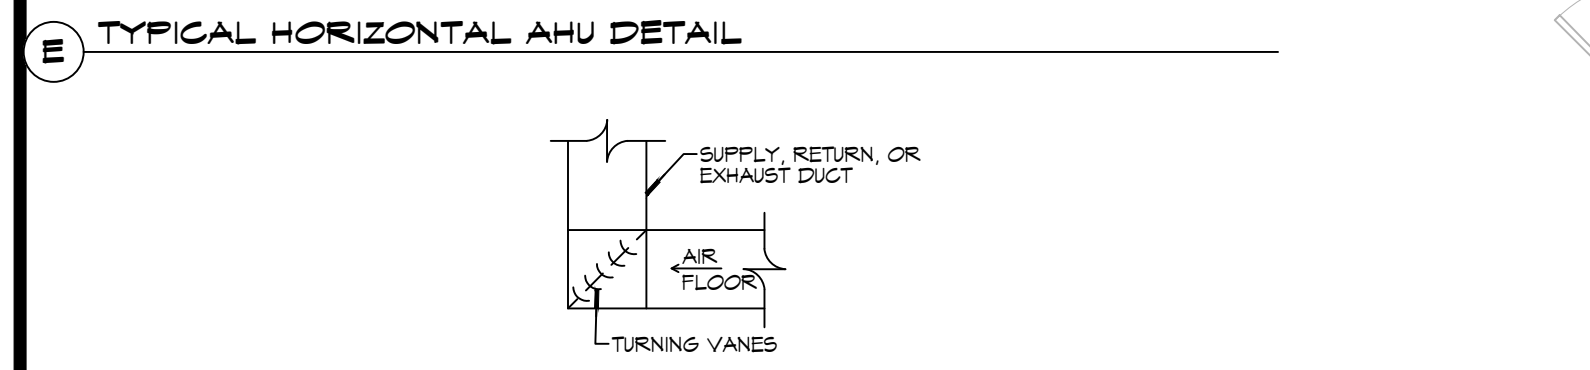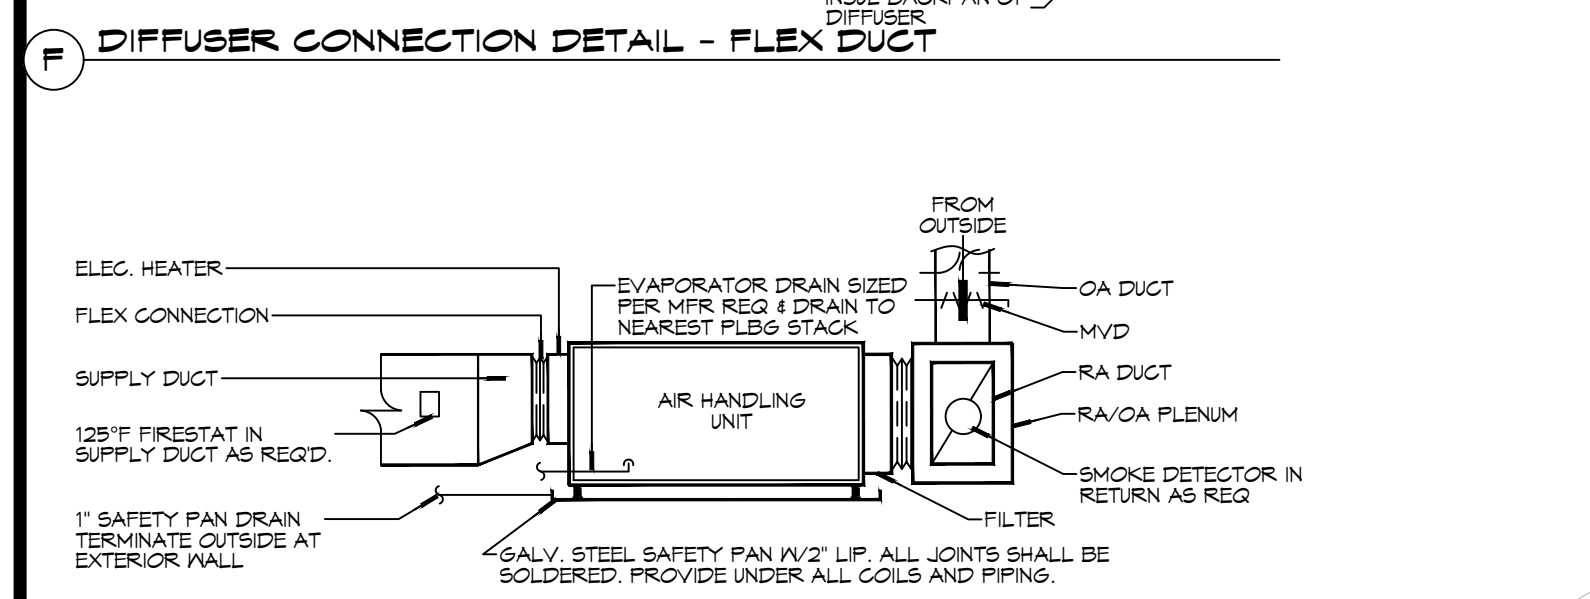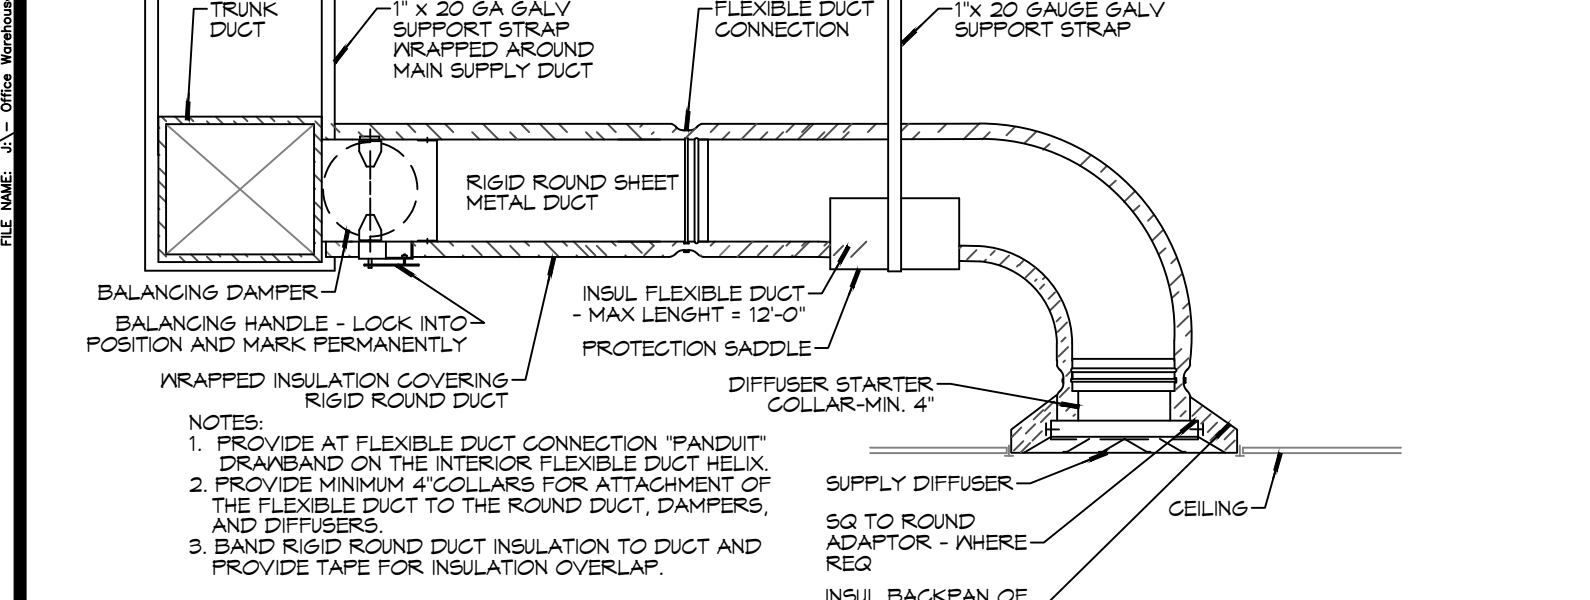

32 DETAILS
SCALE: N.T.S.

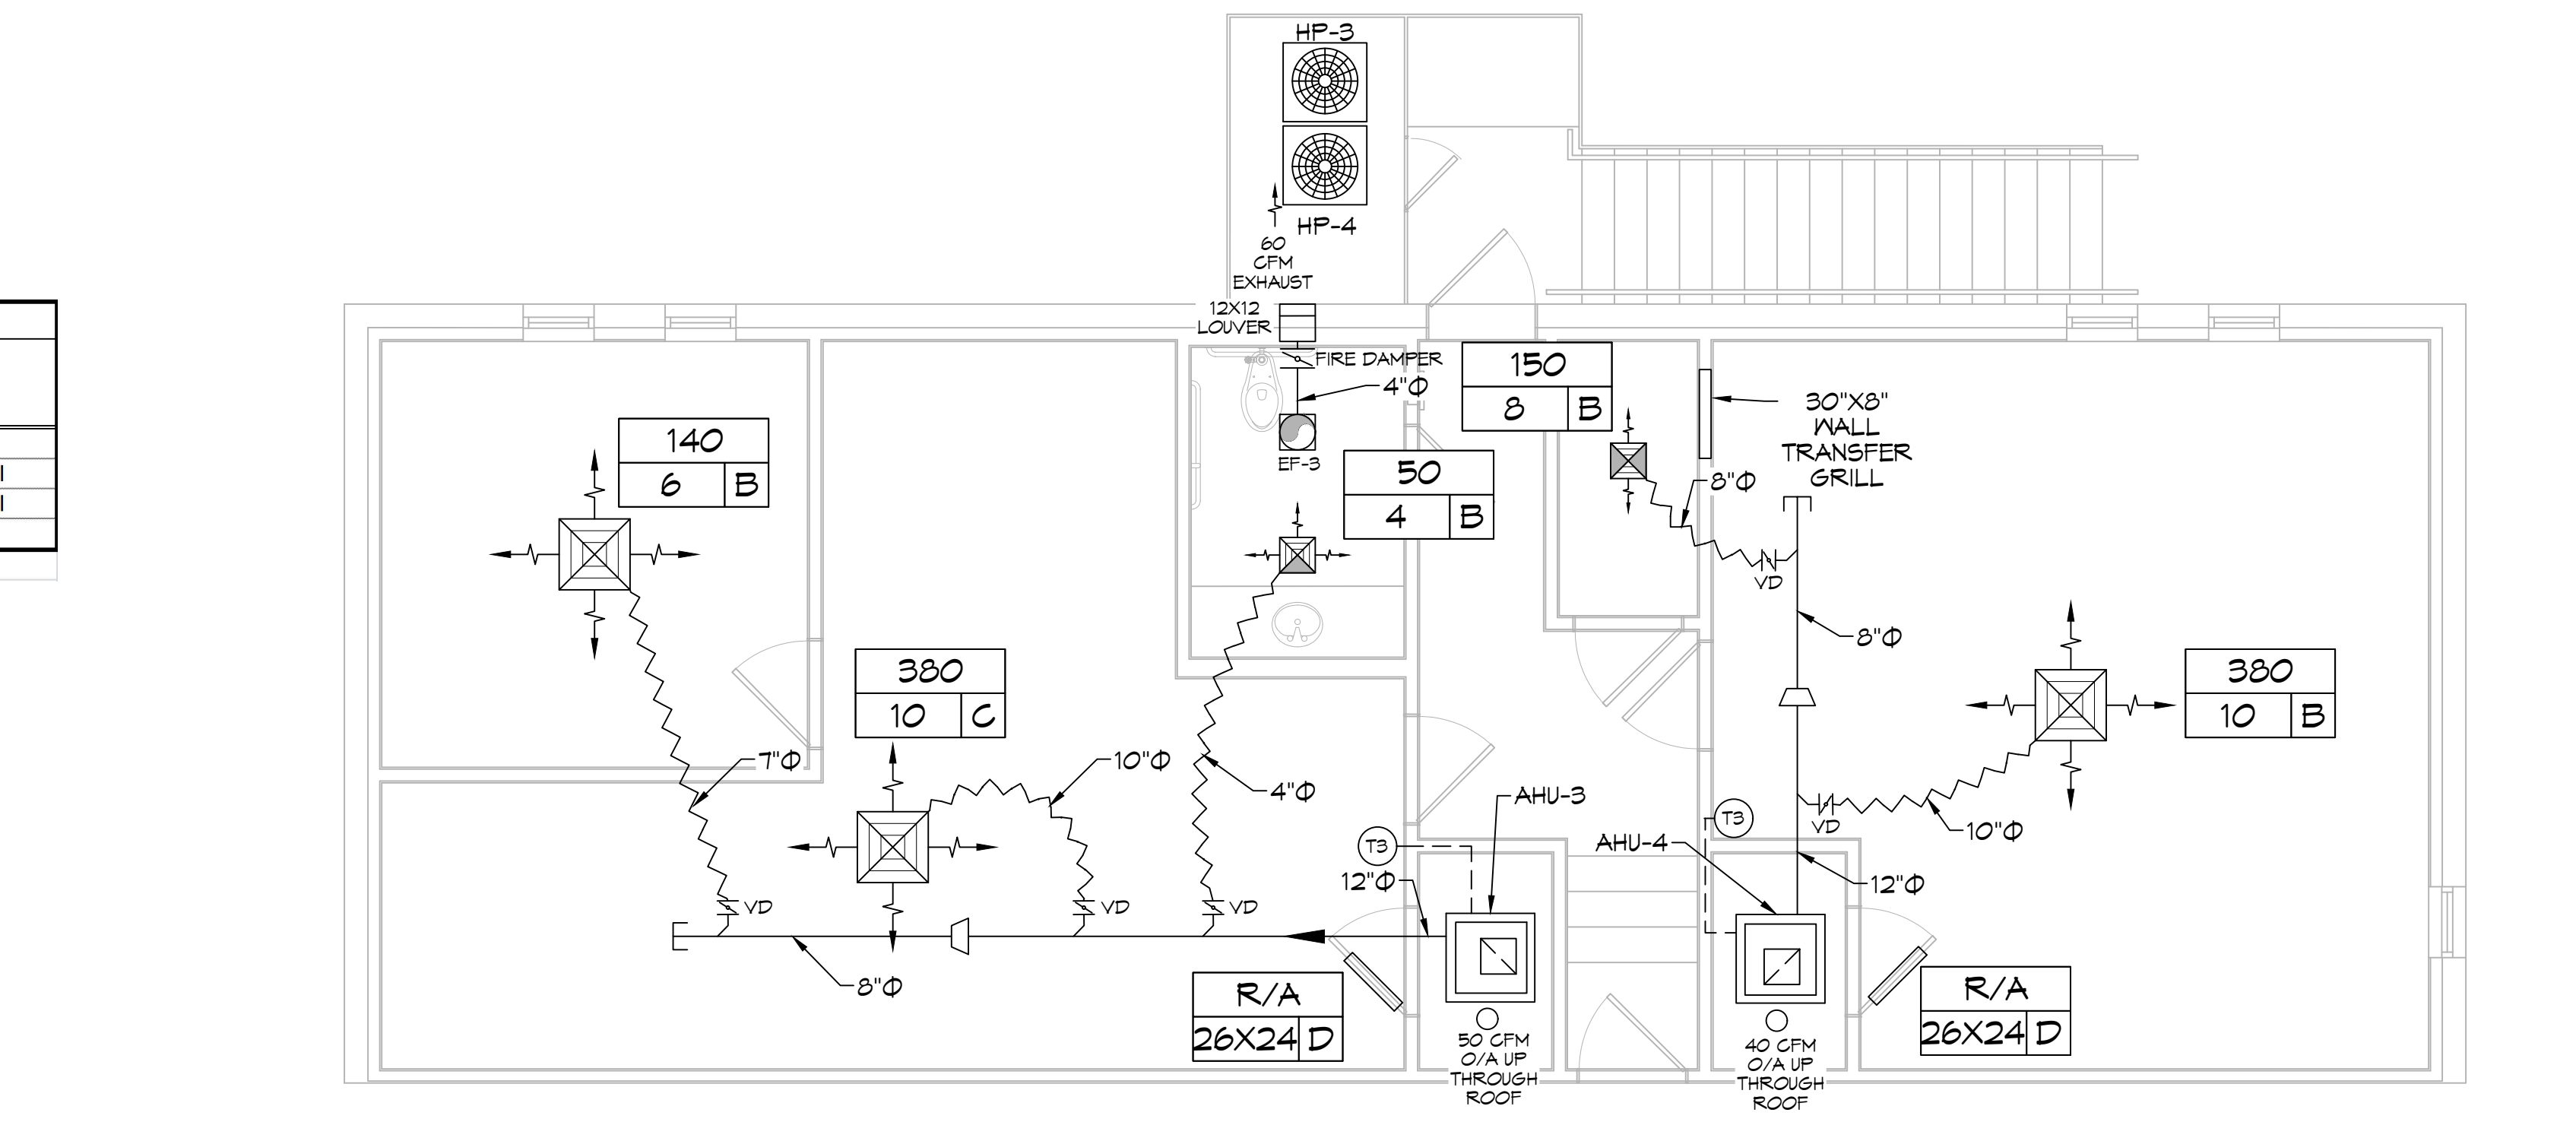

33 MECHANICAL PLAN SECOND FLOOR
SCALE: 1/4" = 1'-0"

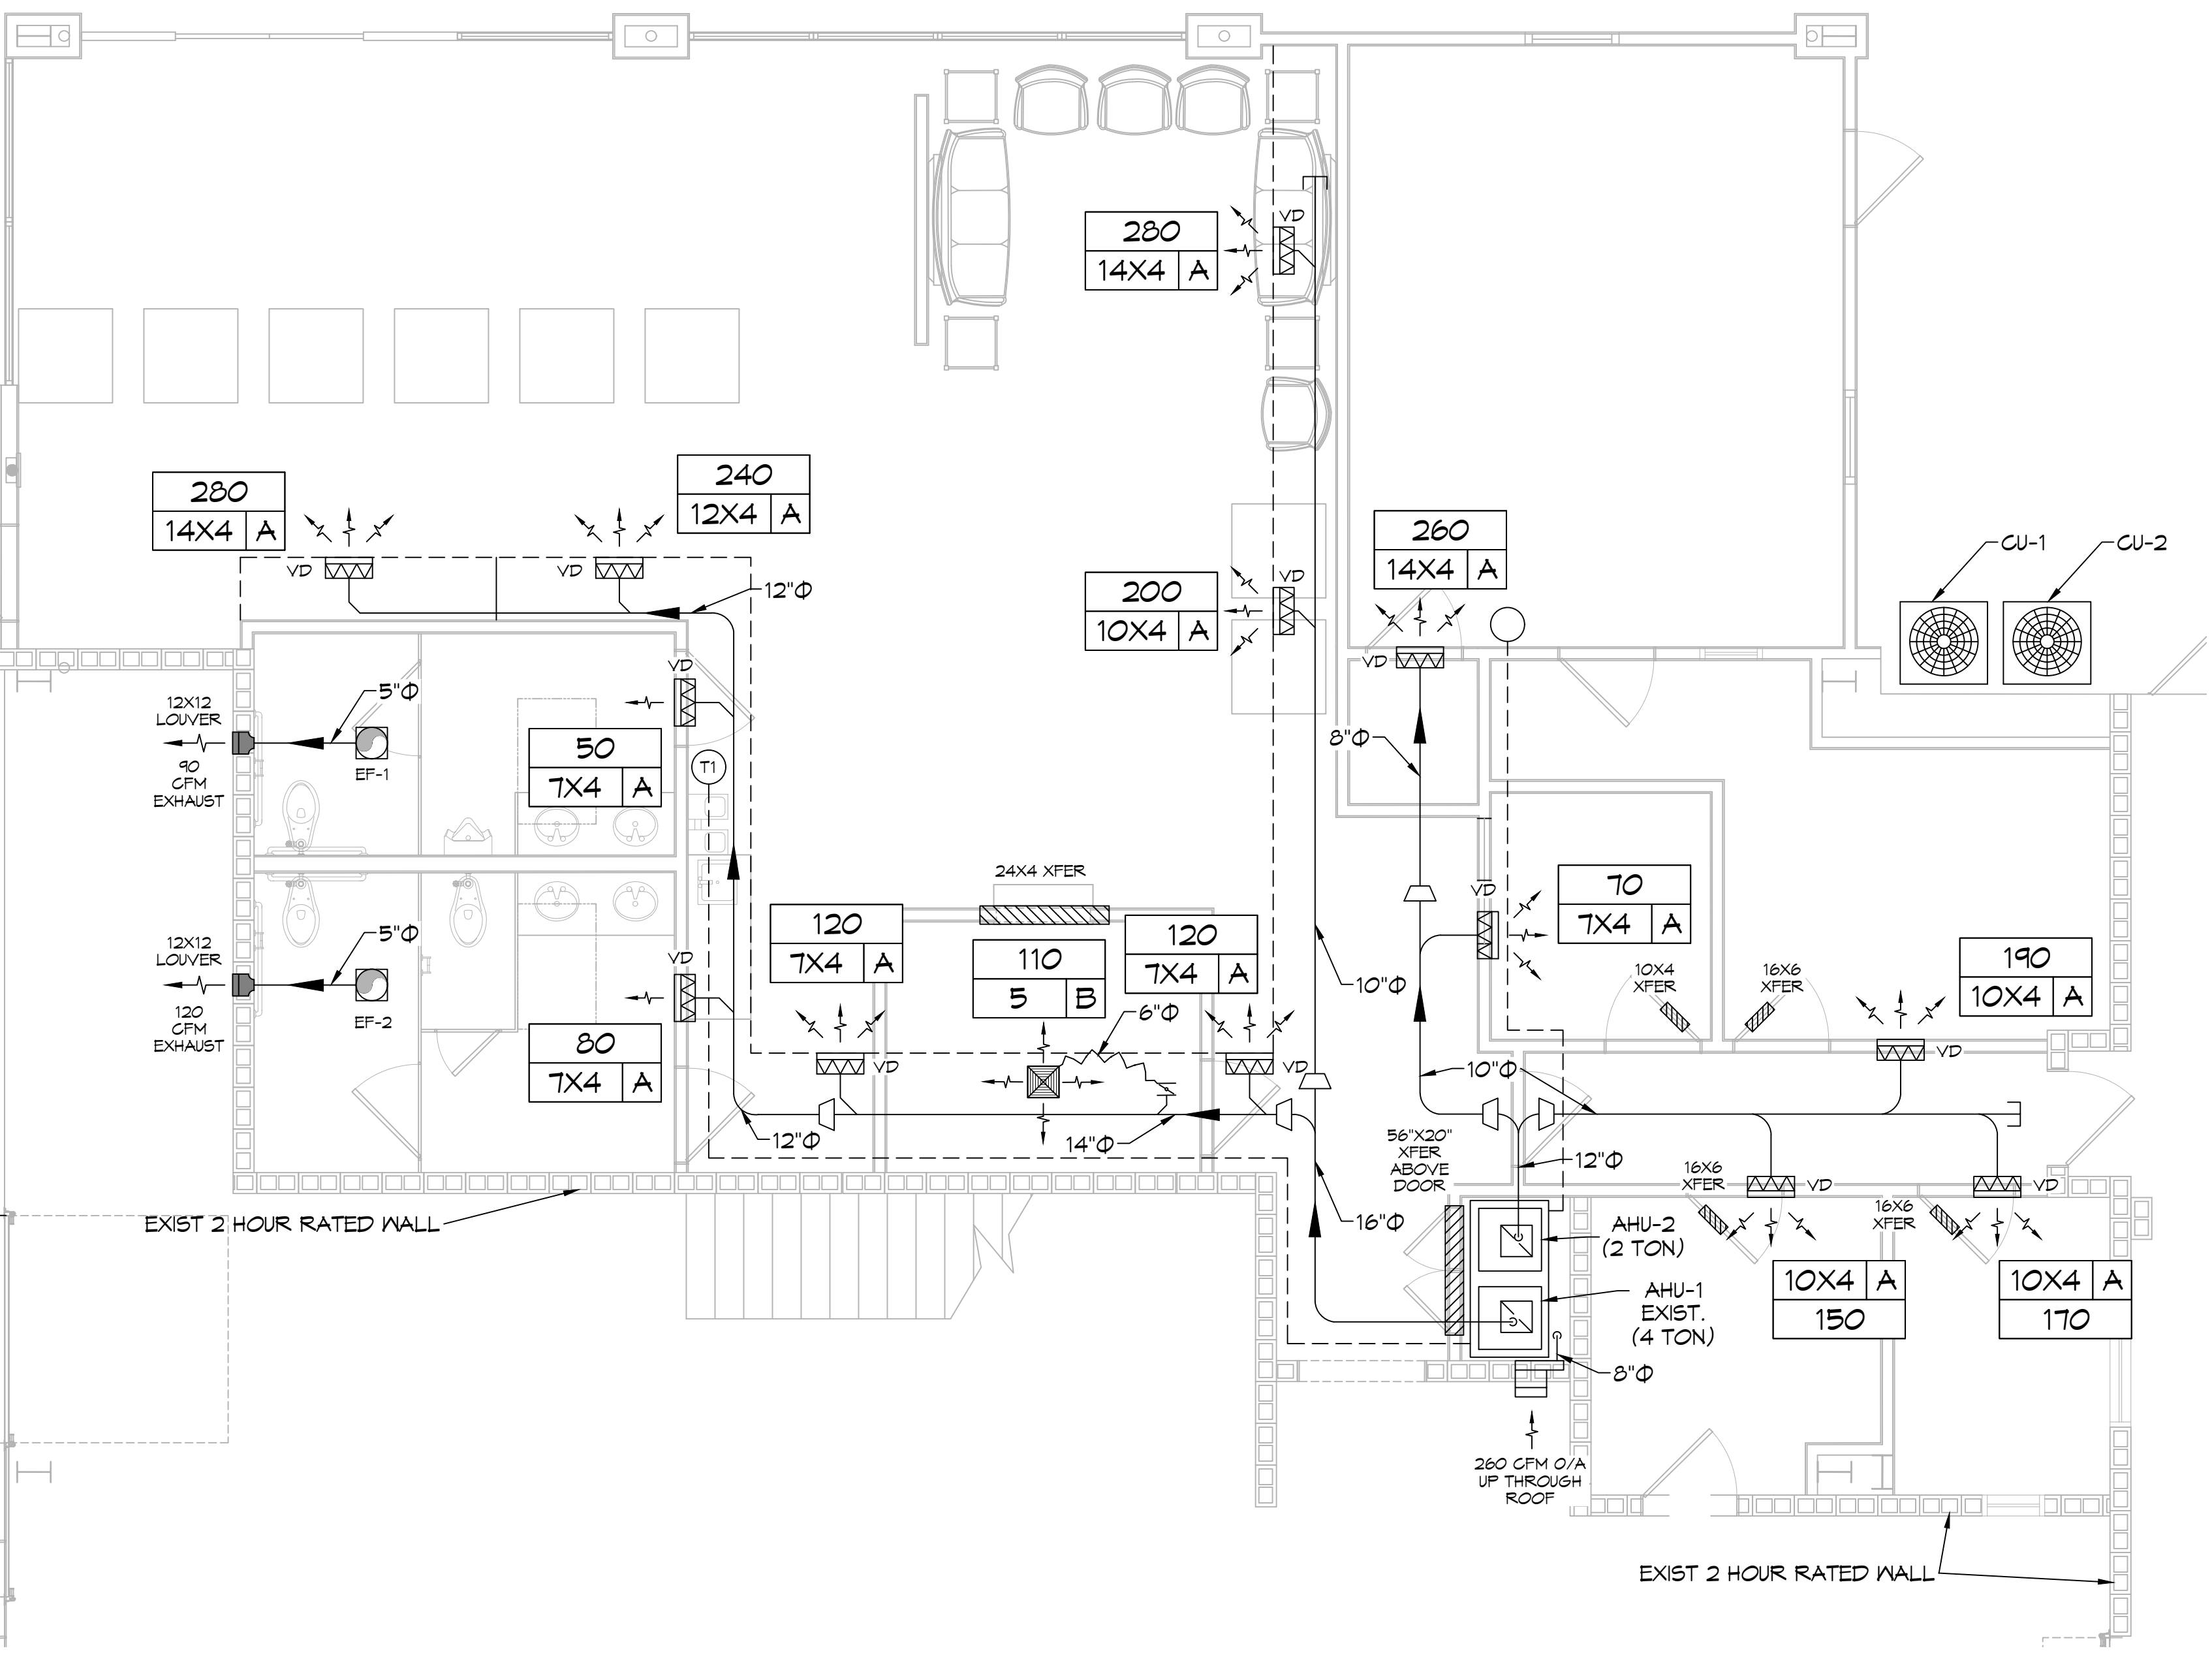


34 MECHANICAL PLAN FIRST FLOOR
SCALE: 1/4" = 1'-0"

GENERAL HVAC NOTES

- CONCEALED DUCTWORK TO BE GALVANIZED SHEET METAL WRAPPED WITH FIBROUS GLASS DUCT WRAP WITH FSK VAPOR BARRIER, MIN R-6. INSTALLED PER SMACNA STANDARDS. DUCT WORK IMMEDIATELY DOWNSTREAM FROM AHU SHALL BE LINED FOR SOUND ATTENUATION.
- EXPOSED DUCTWORK TO BE GALVANIZED SHEET METAL LINED WITH FIBROUS GLASS DUCT LINER, MIN R-6. INSTALLED PER SMACNA STANDARDS.
- ROUND FLEXIBLE DUCT TO BE UL-181, CLASS 1, AIR DUCT MATERIALS.
- DUCT SIZES SHOWN ARE CLEAR INSIDE DIMENSIONS.
- IN ALL SYSTEMS OVER 2000 CFM AND LESS THAN 15,000 CFM, SMOKE DETECTORS SHALL BE INSTALLED IN ACCORDANCE WITH NFPA 72E IN THE RETURN DUCT DOWNSTREAM OF THE AIR HANDLING UNIT AND ALL FILTERS TO AUTOMATICALLY STOP THE FAN.
- PROVIDE UL LISTED 125°F FIRESTAT IN RETURN AIR OF EACH SYSTEM UNDER 2000 CFM TO SHUT DOWN THE FAN IN THE EVENT OF FIRE.
- PROVIDE UL RATED FIRE DAMPERS WHERE REQUIRED AT ALL DUCT PENETRATIONS OF FIRE-RATED ASSEMBLIES AND WHERE REQUIRED BY CODE, INCLUDING OUTSIDE AIR INTAKES AND EXHAUST FANS.
- CONDENSATE DRAINS TO BE PVC PIPE RUN TO PLUMBERS P-TRAP WITHIN FIVE FEET OF AIR HANDLING UNITS.
- ALL AIR HANDLING SYSTEMS TO BE BALANCED TO ASSURE PROPER AIR FLOWS PER PLANS.
- ALL THERMOSTATS TO BE AUTOMATIC CHANGEOVER WITH HEAT SWITCH.
- EXHAUST FAN SHALL BE CONTROLLED BY A SWITCH ON THE WALL IN THE SAME LOCATION AS LIGHT SWITCHES. PROVIDE BACK DRAFT DAMPER.
- PROVIDE AND INSTALL WATER PROOF GRILLE VENT IN PROPER ROOF LOCATION FOR PLUMBING FIXTURE EXHAUST.
- ALL SUPPLY AIR VENTS SHALL BE EQUIPPED WITH AIR CONTROL DAMPERS AT THE REGISTER.
- LOCATE OUTDOOR UNITS AS SHOWN ON ARCHITECTURAL DRAWINGS.
- REFRIGERANT LINES SHALL BE SIZED BY UNIT MANUFACTURER AND INSTALLED ACCORDING TO MANUFACTURER'S INSTRUCTIONS.
- FRESH AIR SHALL BE SUPPLIED TO EACH AIR HANDLER THROUGH EXTERIOR WALL DUCT SUPPLIED WITH A CONTROL DAMPER.
- ALL ELECTRICAL, MECHANICAL, AND PLUMBING PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E8-14).
- ALL MECHANICAL SYMBOLS ARE DRAWN DIAGRAMMATICALLY. CONTRACTOR TO VERIFY WITH OWNER LOCATIONS OF VENTS, DAMPERS, REGISTERS, ETC.
- FLEXIBLE DUCTWORK LENGTH NOT TO EXCEED 12'-0".
- REFER TO REFLECTED CEILING PLAN FOR FINAL GRILLE AND DIFFUSER LOCATIONS AND COORDINATE AS REQUIRED.
- FINAL LOCATION OF TEMPERATURE CONTROLS TO BE COORDINATED WITH OWNER AT JOB SITE.
- PROVIDE AND INSTALL SMOKE DETECTORS AS APPROVED BY LOCAL AHJ. PLACE NEAR R/A AND S/A OPENINGS OF AHU AND PROVIDE, WITH ACCESS PANEL, WIRING BY ELECTRICAL CONTRACTOR.
- FRESH AIR INTAKES ARE REQUIRED TO HAVE MOTORIZED OR GRAVITY DAMPERS TO SHUT OFF WHEN SYSTEM IS NOT RUNNING.
- PROVIDE BIRD SCREENS AT ALL EXTERIOR MECHANICAL PENETRATIONS.
- COORDINATE WALL MOUNTED THERMOSTAT LOCATIONS WITH ALL OWNER FURNISHED ITEMS EITHER WALL MOUNTED OR FLOOR MOUNTED AGAINST PARTITIONS. REFER TO ARCHITECTURAL DRAWINGS.
- PROVIDE MIN 18 GA GALVANIZED SHEET METAL TO BLANK-OFF GABLE VENTS WHERE INTAKE/EXHAUST DUCTS OCCUR.

LEGEND

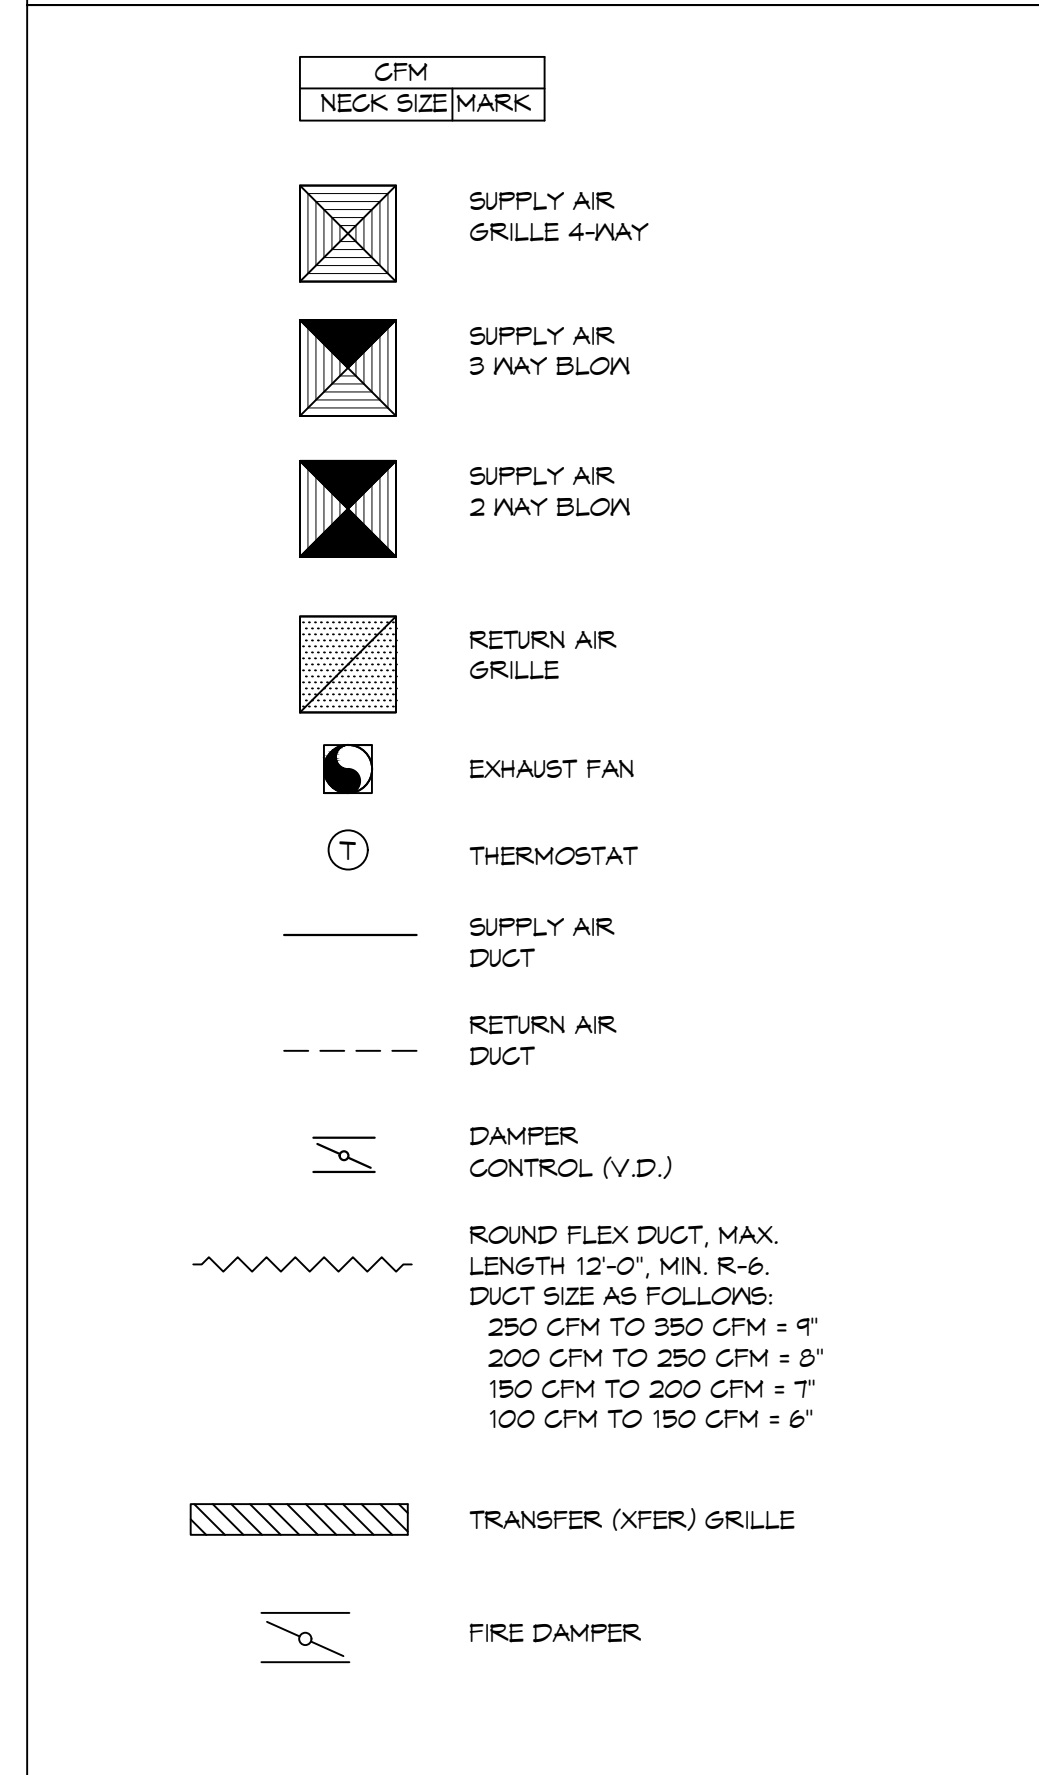

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Civil Engineer: Brian M. Smith, P.E.
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985-649-5832

#	REVISIONS	DATE

#	DESCRIPTION

NEW SERVICE AREA
LEGACY BUICK GMC SLIDELL
248 E HONNE BEACH RD.
SLIDELL, LA 70458
JOB No: 11-05-2023
DATE: 11-05-2023
DRAWN BY: BAK
CHECKED BY: GKD

SHEET TITLE:
MECHANICAL FLOOR PLAN, SCHEDULES AND DETAILS
DRAWING NUMBER:
M101
SHEET No: 15 of 18

