


BULK SYSTEM'S NEW OFFICE / WAREHOUSE

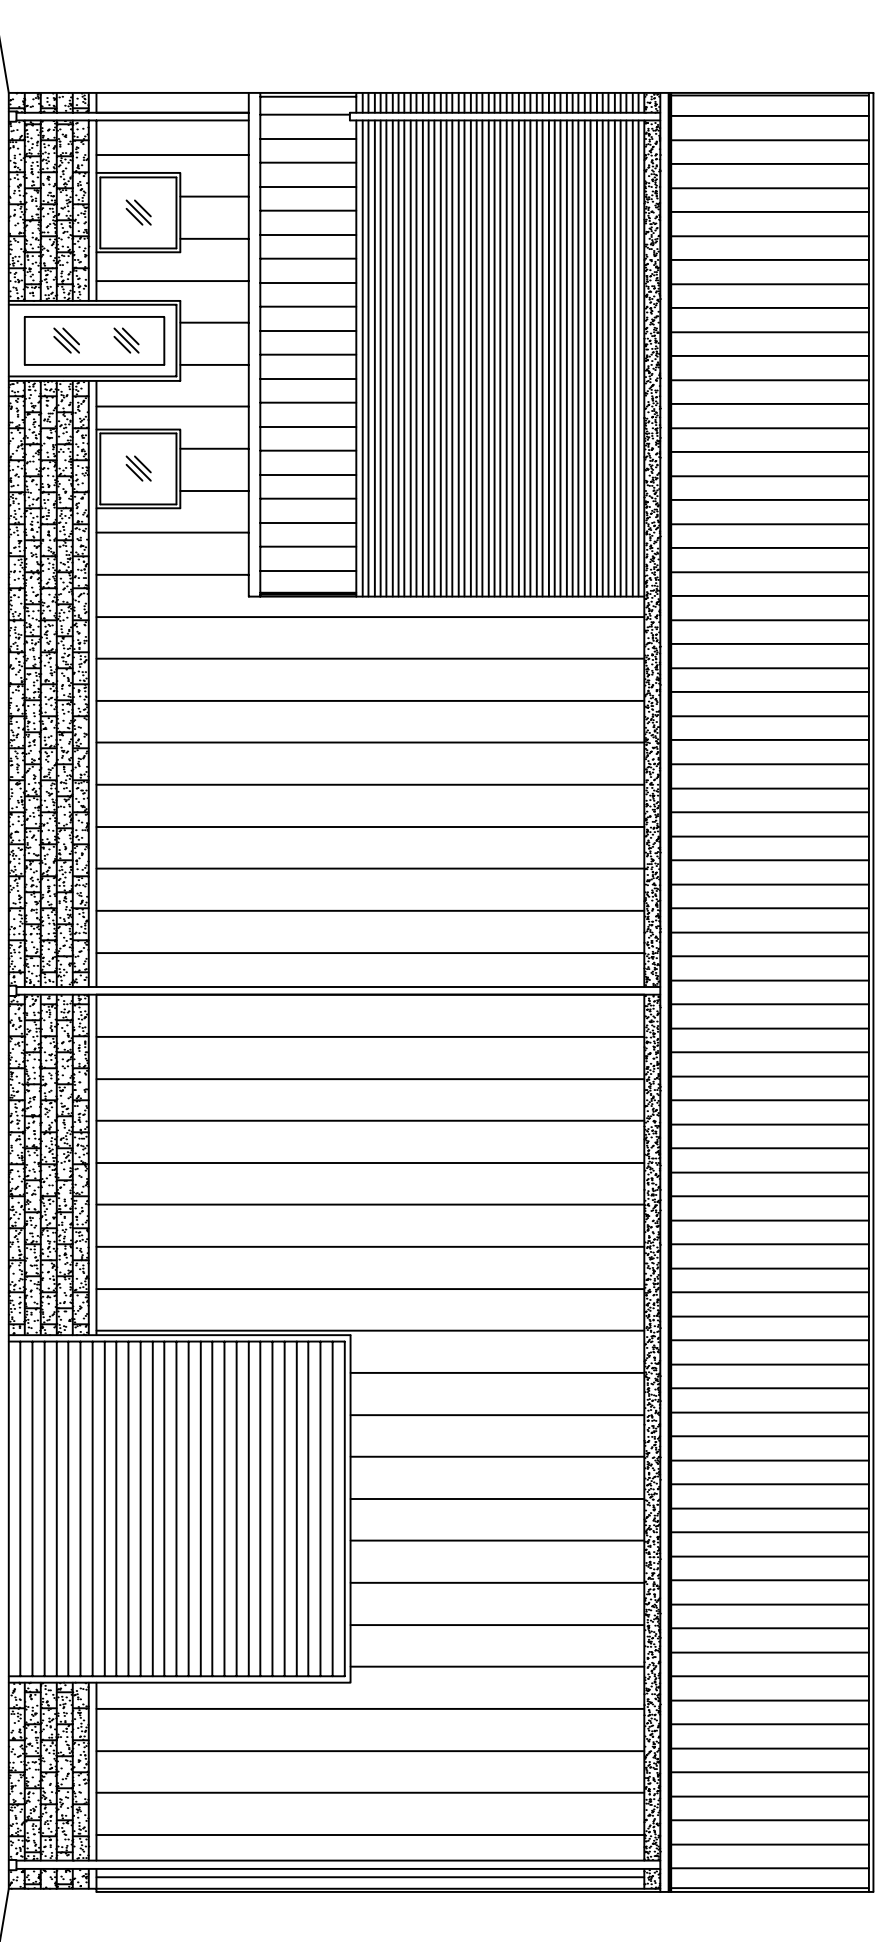

FRONT ELEVATION

1226 FREMAUX AVENUE
SLIDELL, LA.
SQUARE FEET TOTAL
BUILDING TOTAL: 3,742 SQ. FT.

OCCUPANCY CLASSIFICATION:
BUSINESS, GROUP B (SEC 304.1)
WAREHOUSE STORAGE, GROUP S-1 (SEC 311.2)

OCCUPANT LOAD: (TBL 1004.1.1)
BUSINESS AREAS = 100 GROSS SQ.FT. / OCCUPANT
WAREHOUSE AREAS = 500 GROSS SQ. FT. / OCCUPANT
506 5' F. OFFICE = 5,06 OCCUPANTS
3236 5' F. WAREHOUSE = 6,4 OCCUPANTS
3,742 5' F. GROSS BUILDING
TOTAL 11,46 OCCUPANTS

EXIT ACCESS REQUIREMENTS: (SEC 1015)
EXIT REQUIRED FOR < 49 OCCUPANTS IN BUSINESS OCCUPANCY (1 EXITS PROVIDED)
EXIT REQUIRED FOR < 29 OCCUPANTS IN STORAGE OCCUPANCY (2 EXITS PROVIDED)

EXIT TRAVEL DISTANCE REQUIREMENTS: (SEC 1016)
BUSINESS EXIT ACCESS TRAVEL DISTANCE = 200' UNSPRINKLED
WAREHOUSE EXIT ACCESS TRAVEL DISTANCE = 300' UNSPRINKLED

ALLOWABLE HEIGHT AND BLDG. AREA: (TBL 503)
B=23,000 SQ.FT./ 3 STORY ALLOWED, THIS PROJECT 1 STORY / 3,742 SQ.FT.

CONSTRUCTION CLASSIFICATION: (SEC 602.2)
TYPE II-B

FIRE RESISTANCE RATING REQUIREMENTS FOR BLDG. ELEMENTS: (TBL 601)
STRUCTURAL FRAME = 0 HRS.
BEARING WALLS (INTERIOR AND EXTERIOR) = 0 HRS.
NON-BEARING WALLS = 0 HRS.
FLOOR CONSTRUCTION = 0 HRS.
ROOF CONSTRUCTION = 0 HRS.

FIRE ALARM SYSTEM REQUIREMENTS: (SEC 907)
THIS BLDG. DOES NOT REQUIRE A FIRE ALARM SYSTEM

FIRE PROTECTION SYSTEM REQUIREMENTS: (SEC 903)
THIS BLDG. DOES NOT REQUIRE A FIRE PROTECTION SYSTEM IN ACCORDANCE WITH SEC 903.2.9

CONSTRUCTION DOCUMENTS: (SEC 1603)
THIS BLDG. SHALL BE DESIGNED IN ACCORDANCE WITH IBC SECTION 1609 AS A FULLY ENCLOSED BLDG. USING THE FOLLOWING INFORMATION:
WIND DESIGN DATA:

DETERMINATION OF WIND LOADS SHALL BE IN ACCORDANCE WITH IBC SEC 1609.4
BASIC WIND SPEED (3 SECOND GUSTS) = 130 MPH (TIG 1609)
IMPORTANCE FACTOR: CATEGORY II BLDG., IE = 1.00, IS = 1.0, IW = 1.00 (TBL 1604.5)
EXPOSURE B
DESIGN WIND PRESSURE (ASCE 7.05 FIG. 6-2): 33.6 PSF
INTERNAL PRESSURE COEFFICIENT (ASCE 7.05 FIG. 6-5): ± 0.18
LIVE LOADS: (SEC 1607)
LOBBIES AND 1st FLR. CORRIDOR (TBL 1607.1): 100 PSF
OFFICE (TBL 1607.1): 50 PSF
ROOF LIVE LOAD (TBL 1607.1) = 20 PSF UNIFORM, 300 LB. CONCENTRATED
GROUND SNOW LOAD (FIG. 1608.2) = 5 PSF

BASED ON THE SURVEY OF THIS PROPERTY BY J.V. BURKES & ASSOC., INC. REG. # 4443.
THIS PROPERTY IS NOT IN A SPECIAL FLOOD HAZARD AREA.
F.I.N.M. COMMUNITY MAP NO. 220204 0010C : DATE 4-21-99
FLOOD ZONE: X: BASE FLOOD ELEVATION N/A.



WORK SITE

VICINITY MAP
N.T.S.

DWG#	DRAWING NAME	REVISED
-	COVER SHEET	
C-1	COPY OF SURVEY	
C-2	SITE PLAN	
C-3	SITE UTILITY PLAN	
C-4	SITE DRAINAGE PLAN	
C-5	SITE PAVING PLAN	
C-6	SILT FENCE DETAIL 5	
S-1	FOUNDATION PLAN	
A-1	FLOOR PLAN	
A-2	SCHEDULES & NOTES	
A-3	EXTERIOR BUILDING ELEVATIONS	
A-4	EXTERIOR BUILDING ELEVATIONS	
A-5	BUILDING SECTION & DETAILS	
A-6	REFLECTED CEILING PLAN	
H-1	HANDICAP NOTES	
H-2	HANDICAP NOTES	
M-1	MECHANICAL PLAN	
E-1	ELECTRICAL POWER PLAN & NOTES	
E-2	ELECTRICAL LIGHTING PLAN & SCHEDULES	
P-1	PLUMBING PLAN	

INDEX OF DRAWINGS

DETAILED BUILDING REQUIREMENTS (MAIN WIND FORCE RESISTING COMPONENTS)

- THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS AND STRUCTURES SHALL BE IN ACCORDANCE WITH EITHER THE AISC LOAD AND RESISTANCE FACTOR DESIGN SPECIFICATION FOR STRUCTURAL STEEL BUILDINGS AND LIGHT STRESS DESIGN (AISC 360) OR AISC SPECIFICATION FOR THE DESIGN OF STEEL HOLLOW STRUCTURAL SECTIONS (AISC 359). WIND LOAD DESIGN OF 130 MPH.
- ROOF COVERING HAS BEEN DESIGNED IN ACCORDANCE WITH THE REQUIREMENTS SET FORTH IN IBC SECTION 1507
- 7/16" THICK STRUCTURAL WOOD PANELS AND ATTACHMENT HARDWARE SHALL BE PROVIDED FOR BUILDING OCCUPANCY THE PANELS SHALL BE NUMBERED FOR EACH GLAZED OPENING AND SHALL BE STORED ON SITE PERMANENTLY (IBC 1609.1.4 EXCEPTION)


CONTRACTOR NOTE

EACH CONTRACTOR RESPONSIBLE FOR THE CONSTRUCTION OF A MAIN WIND-FORCE-RESISTING COMPONENT OF THIS BUILDING SHALL SUBMIT A WRITTEN CONTRACTOR'S STATEMENT OF RESPONSIBILITY TO THE BUILDING OFFICIAL AND OWNER PRIOR TO COMMENCEMENT OF THE WORK ON THAT COMPONENT. (IBC 1706.3)

CHIEF ENGINEER: EMMETT DAMMON, P.E.
CHIEF ARCHITECT: KEVIN KINCHEN
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

www.dammonengineering.com
dammoneng@bellsouth.net
PHONE: 985-649-5832
FAX: 985-641-5950

DAMMON
ENGINEERING, INC.
Architects & Engineers

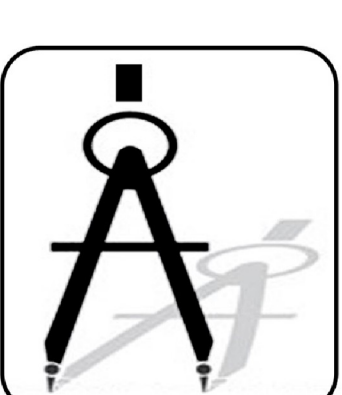

BULK SYSTEM'S NEW
OFFICE/WAREHOUSE BUILDING

1226 FREMAUX AVENUE
SLIDELL, LA 70458

JOB No: 2173 DATE: 04-23-2013
DRAWN BY: JTL CHECKED BY:

The above drawings and specifications, designs and arrangements represent total liability and we will remain the property of Dammon Engineering, and no part thereof shall be copied, altered or used in connection with any work or project other than the specific project for which they have been prepared and approved without written consent of Dammon Engineering. Mutual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these conditions.