SYSTEM

BE

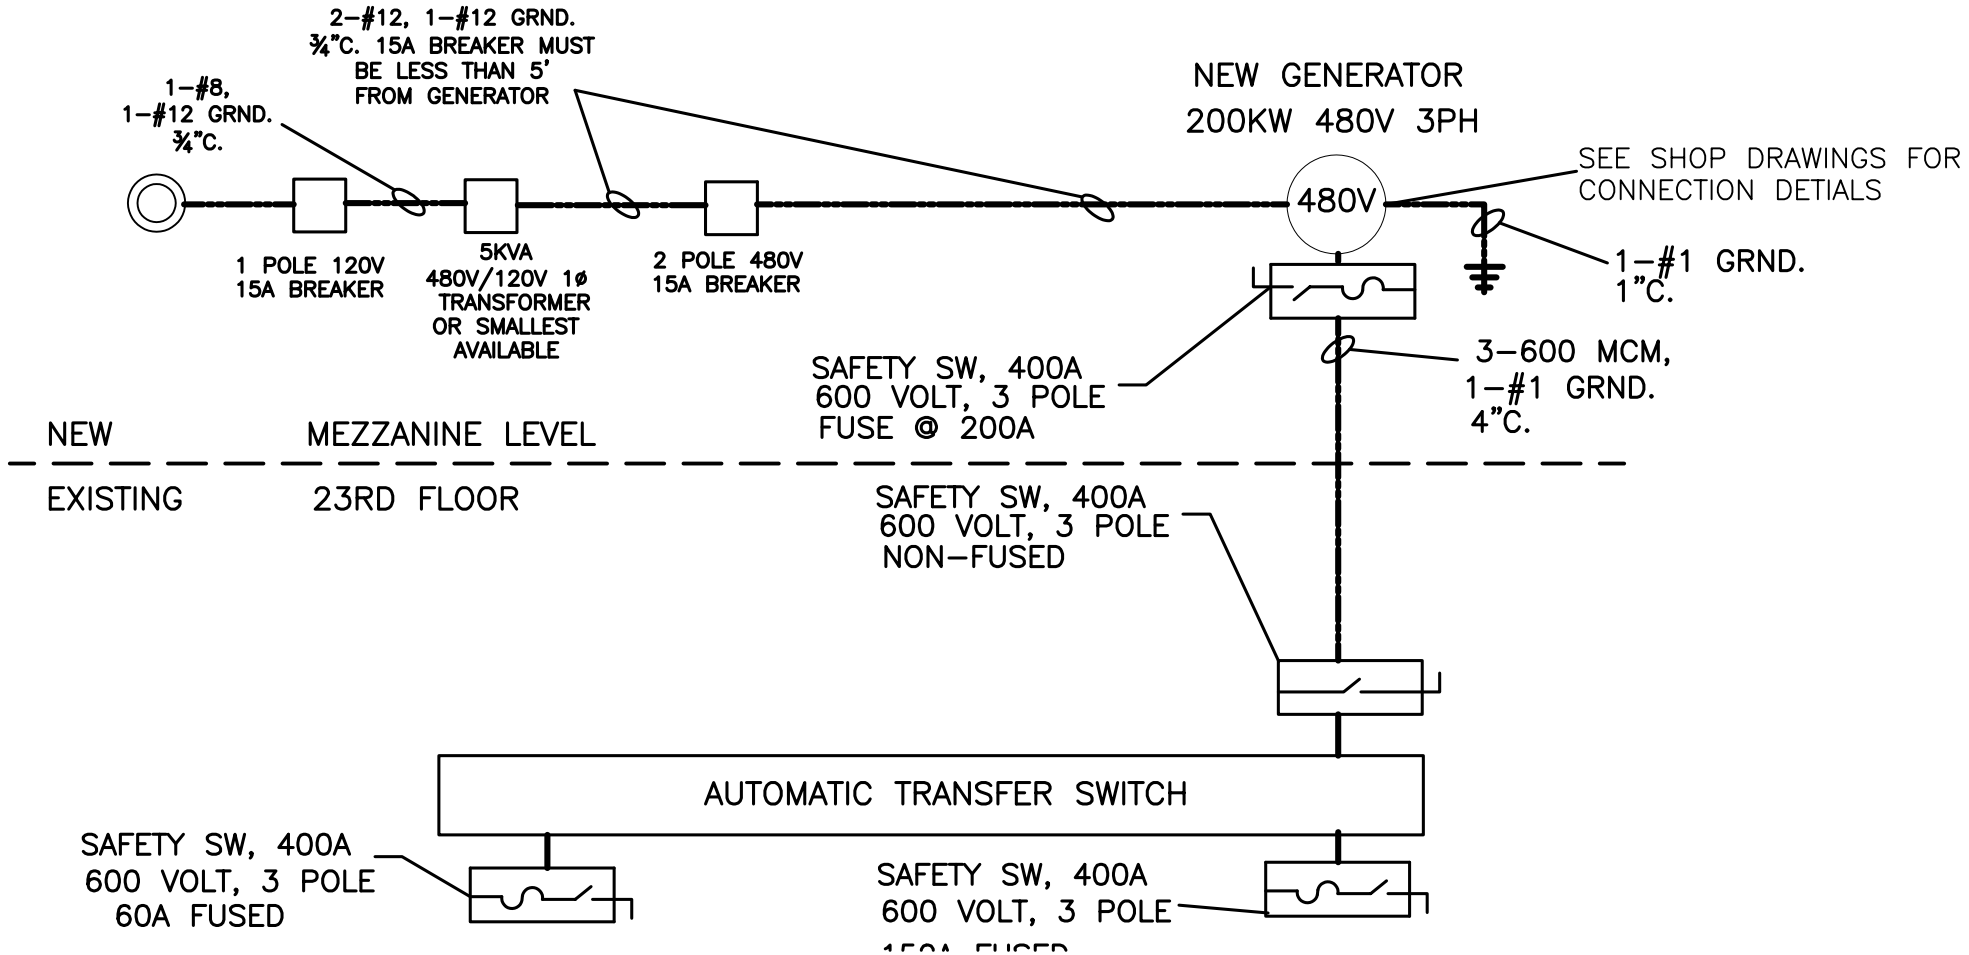
2–#12, 1–#12 GRND.
¾"C. 15A BREAKER MUST
BE LESS THAN 5'
FROM GENERATOR
1–#8,
1–#12 GRND.
¾"C.
NEW GENERATOR
200KW 480V 3PH
480V
SEE SHOP DRAWINGS FOR
CONNECTION DETIALS
1 POLE 120V
15A BREAKER
5KVA
480V/120V 1ø
TRANSFORMER
OR SMALLEST
AVAILABLE
2 POLE 480V
15A BREAKER
1–#1 GRND.
1"C.
SAFETY SW, 400A
600 VOLT, 3 POLE
FUSE @ 200A
3–600 MCM,
1–#1 GRND.
4"C.
NEW
MEZZANINE LEVEL
EXISTING
23RD FLOOR
SAFETY SW, 400A
600 VOLT, 3 POLE
NON–FUSED
AUTOMATIC TRANSFER SWITCH
SAFETY SW, 400A
600 VOLT, 3 POLE
60A FUSED
SAFETY SW, 400A
600 VOLT, 3 POLE