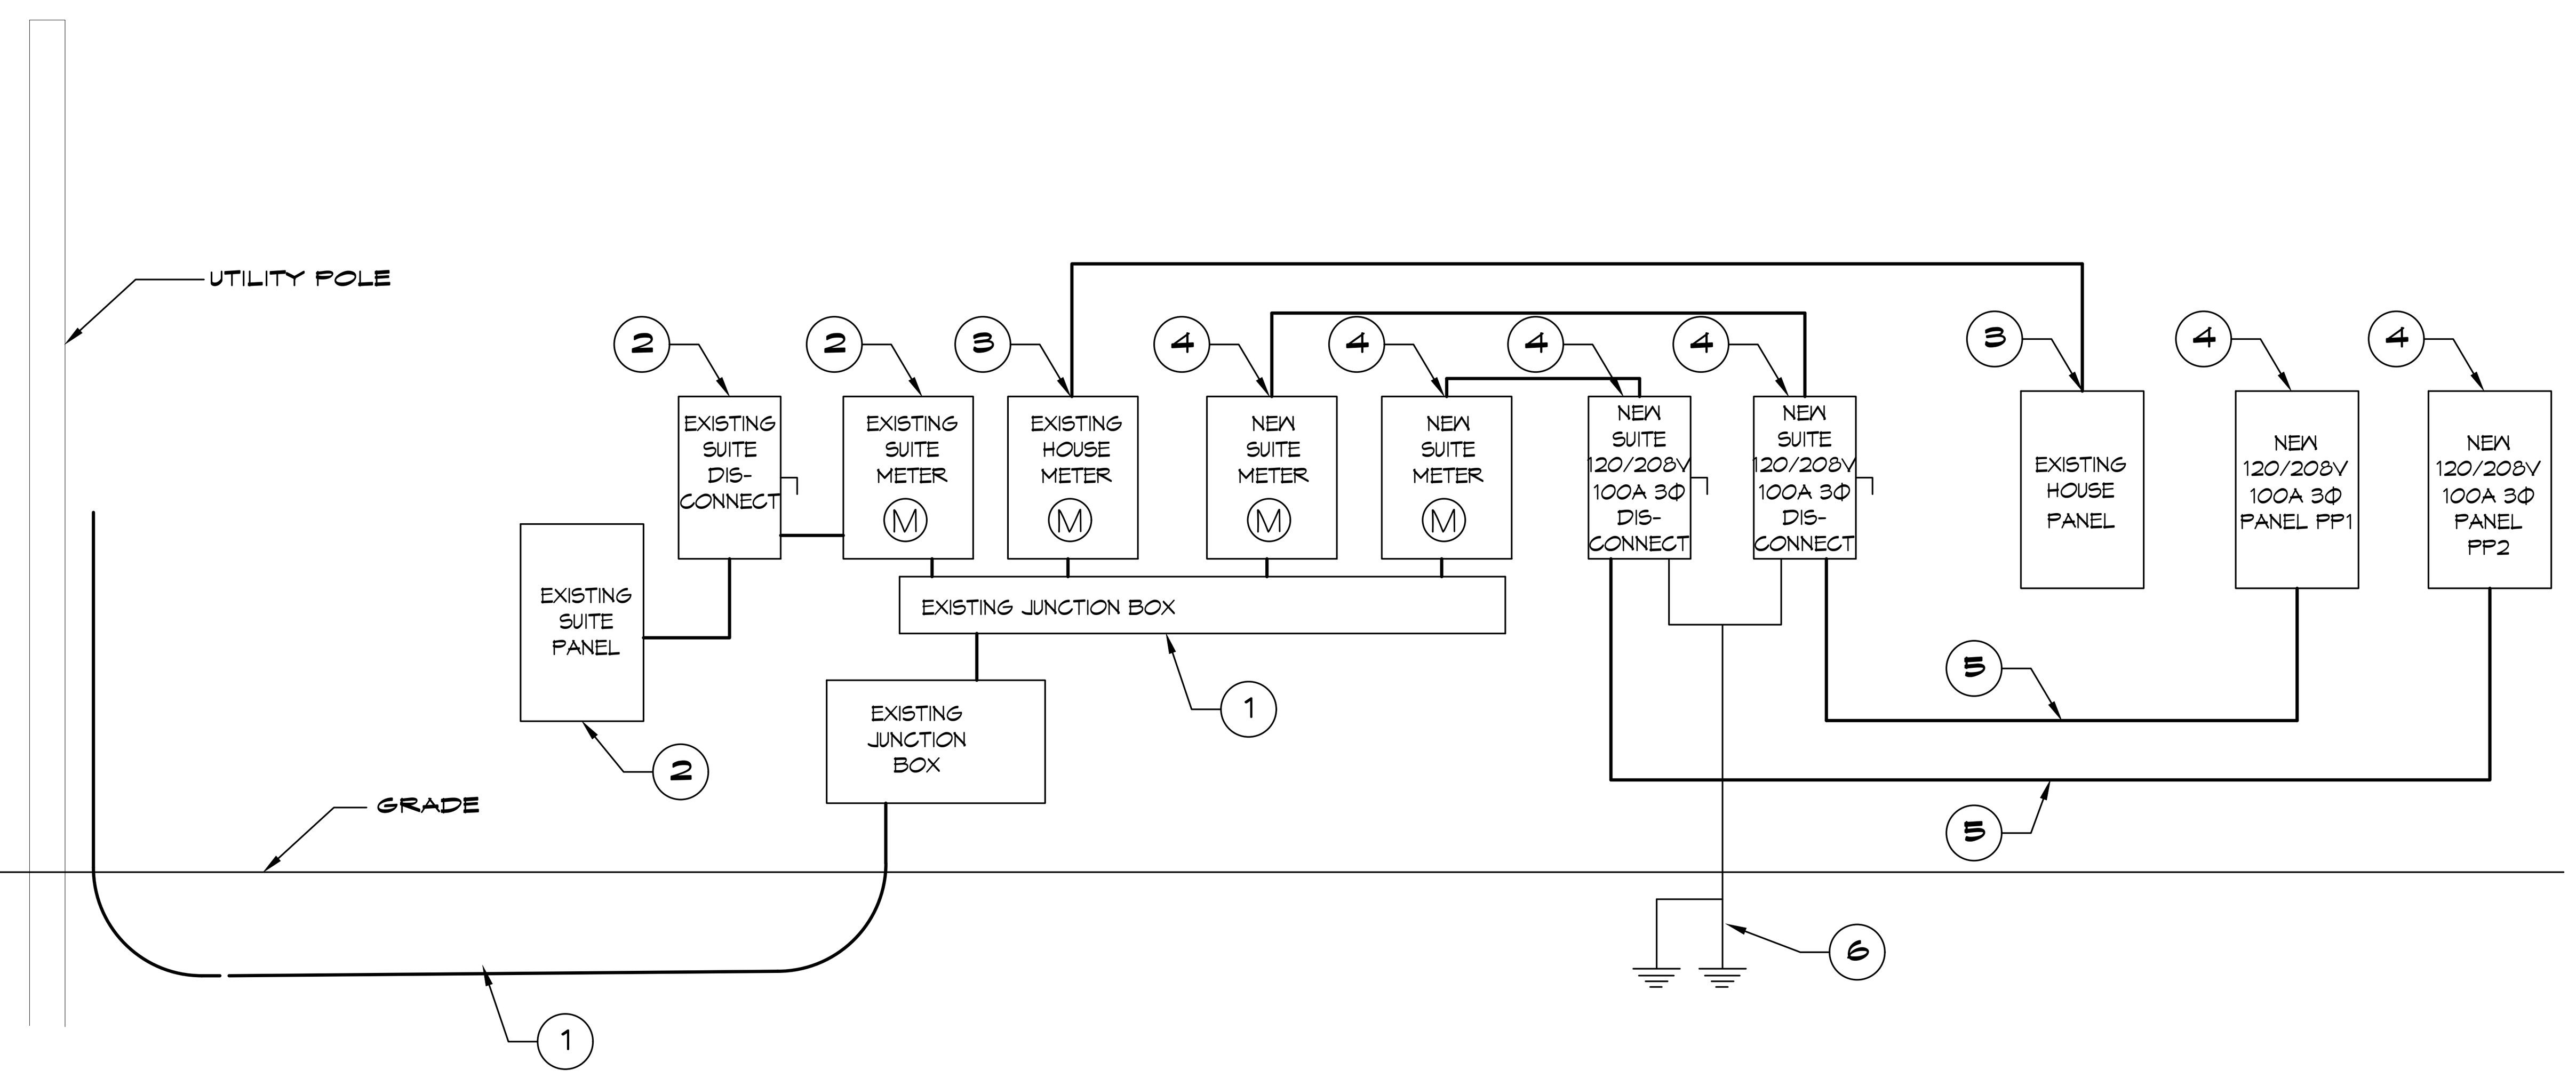

ONE LINE NOTES:

1. EXISTING 120/208V 3Φ 200A SERVICE AND JUNCTION BOXES.
2. EXISTING SUITE 120/208V 3Φ METER, DISCONNECT AND PANELBOARD TO REMAIN.
3. EXISTING HOUSE 120/208V 3Φ METER AND PANELBOARD TO REMAIN.
4. NEW 120/208V 3Φ 100A METER, DISCONNECT AND PANELBOARD.
5. 4-#2 THHN, 1-#8 GND, 1 1/4" C
6. 2 - 3/4" x 10' CU CLAD GND ROD, #2 CU GND WIRE. PROTECT IN PVC PIPE. CONNECT TO METAL BLDG, COLD WATER SUPPLY & GAS LINE. CAD WELD ALL CONNECTIONS.

14 RISER DIAGRAM

SCALE: NONE

PANEL SCHEDULE

PANEL: PP-A1
LOCATION: BACK WALL, LEFT SIDE
FEEDER SOURCE:
VOLTAGE: 120/208V 3Φ, 4 WIRE
ENCLOSURE: SURFACE MOUNTED, 100 Amp; W/ EQUIP GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AΦ BΦ CΦ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1					3.8		2.6					2
3	#8	LEFT SIDE HVAC UNIT. AHU #1 W/HEAT	35	3	3.8		2.6	3	30	LEFT SIDE HEAT PUMP. CU-1	#10	4
5					3.8		2.6					6
7	#12	LEFT SIDE LIGHTS. TREATMENT ROOM, RESTROOM, AND OFFICES	20	1	1.7		0.4	1	20	LEFT SIDE DEDICATED RECEPTACLE. BACK OFFICE	#12	8
9	#12	LEFT SIDE DEDICATED RECEPTACLE. FRONT OFFICE	20	1	0.4		3.4	1	30	TANKLESS WATER HEATER. RESTROOM	#10	10
11	#12	LEFT SIDE RECEPTACLES. TREATMENT ROOM	20	1	0.9		-	-	-	SPARE	-	12
13	-	SPARE	-	-	-		-	-	-	SPARE	-	14
15	-	SPARE	-	-	-		-	-	-	SPARE	-	16
17	-	SPARE	-	-	-		-	-	-	SPARE	-	18
19	-	SPARE	-	-	-		-	-	-	SPARE	-	20
21	-	SPARE	-	-	-		-	-	-	SPARE	-	22
23	-	SPARE	-	-	-		-	-	-	SPARE	-	24

SOLID NEUTRAL
NEUTRAL WIRE (W)

TOTAL CONNECTED LOAD (kva) = 26.0

AΦ = 8.5	BΦ = 10.2	BΦ = 7.3

GROUND BUS
GROUND WIRE (G)

PANEL SCHEDULE

PANEL: PP-A2
LOCATION: BACK WALL, RIGHT SIDE
FEEDER SOURCE:
VOLTAGE: 120/208V 3Φ, 3 WIRE
ENCLOSURE: SURFACE MOUNTED, 100 Amp; W/ EQUIP GND BAR SQ D TYPE QO LOAD CENTER

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION / LOCATION	BREAKER AMP	BREAKER POLE	LOAD (kva)	AΦ BΦ CΦ	LOAD (kva)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION / LOCATION	THHN WIRE SIZE	CKT NO
1					3.8		2.6					2
3	#8	RIGHT SIDE HVAC UNIT. AHU #1 W/HEAT	35	3	3.8		2.6	3	30	RIGHT SIDE HEAT PUMP. CU-1	#10	4
5					3.8		2.6					6
7	#12	RIGHT SIDE LIGHTS. TREATMENT ROOM, AND OFFICES	20	1	1.7		0.4	1	20	RIGHT SIDE DEDICATED RECEPTACLE. BACK OFFICE	#12	8
9	#12	RIGHT SIDE RECEPTACLES. TREATMENT ROOM	20	1	1.3		-	-	-	SPARE	-	10
11	-	SPARE	-	-	-		-	-	-	SPARE	-	12
13	-	SPARE	-	-	-		-	-	-	SPARE	-	14
15	-	SPARE	-	-	-		-	-	-	SPARE	-	16
17	-	SPARE	-	-	-		-	-	-	SPARE	-	18
19	-	SPARE	-	-	-		-	-	-	SPARE	-	20
21	-	SPARE	-	-	-		-	-	-	SPARE	-	22
23	-	SPARE	-	-	-		-	-	-	SPARE	-	24

SOLID NEUTRAL
NEUTRAL WIRE (W)

TOTAL CONNECTED LOAD (kva) = 22.6

AΦ = 8.5	BΦ = 7.7	BΦ = 6.4

GROUND BUS
GROUND WIRE (G)

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS

#	DESCRIPTION	DATE

SEAL:

RENOVATION
ACTION PHYSICAL THERAPY & SPORTS MEDICINE
107 SOUTH MILITARY RD.
SLIDELL, LA 70461

JOB No:	2451	DATE:	11-04-2021
DRAWN BY:	AEP	CHECKED BY:	CKD

SHEET TITLE:
PANEL SCHEDULE, ONE LINE DIAGRAM AND ELEC. LOAD SUMMARY

DRAWING NUMBER:

E102