

## RENOVATIONS TO OFFICE SUITES AT 2346 & 2348 CIRUTI STREET SLIDELL, LA

NOTE:  
COORDINATE WITH, AND PROVIDE ALL ITEMS AS SHOWN  
ON ATTACHED DRAWINGS FROM PATTERSON DENTAL.

### INTERNATIONAL BUILDING CODE 2006

OCCUPANCY CLASSIFICATION:  
BUSINESS, GROUP B. (SEC 304.1)

OCCUPANT LOAD: (TBL 1004.1.1)  
BUSINESS AREAS = 100 GROSS SQ.FT. / OCCUPANT  
2,397 SQ.FT. GROSS BUILDING = TOTAL OF 24 OCCUPANTS

EXIT ACCESS REQUIREMENTS: (SEC 1019)  
1 EXIT REQUIRED FOR < 49 OCCUPANTS IN BUSINESS OCCUPANCY (4 EXITS PROVIDED)  
EXIT ACCESS TRAVEL DISTANCE = 200' UNSPRINKLED

ALLOWABLE HEIGHT AND BLDG. AREA: (TBL 503)  
B=23,000 SQ.FT. / 4 STORY ALLOWED, THIS PROJECT 1 STORY / 2,397 SQ.FT.

CONSTRUCTION CLASSIFICATION: (SEC 602.2)  
TYPE II B

FIRE RESISTANCE RATING REQUIREMENTS FOR BLDG. ELEMENTS: (TBL 601)

STRUCTURAL FRAME= 0 HRS.  
BEARING WALLS (INTERIOR AND EXTERIOR)= 0 HRS.  
NON-BEARING WALLS= 0 HRS.  
FLOOR CONSTRUCTION= 0 HRS.  
ROOF CONSTRUCTION= 0 HRS.  
NOTE: FIRE PROTECTION OF STRUCTURAL MEMBERS REQUIRED IN WHERE EVERY PART OF THE ROOF  
CONSTRUCTION IS 20' ABOVE SLAB. ALL ROOF CONSTRUCTION < 20' ABOVE SLAB.


FIRE RESISTANCE RATING REQUIREMENTS FOR EXTERIOR WALLS: (TBL 602)  
EXTERIOR WALLS WITH 10' <= 30' FIRE SEPARATION DISTANCE = 0 HR.

FIRE ALARM SYSTEM REQUIREMENTS: (SEC 907)  
THIS BLDG. DOES NOT REQUIRE A FIRE ALARM SYSTEM IN ACCORDANCE WITH SEC 907.2.2 & SEC  
907.2.7

CONSTRUCTION DOCUMENTS: (SEC 1603)  
THIS BLDG. SHALL BE DESIGNED IN ACCORDANCE WITH IBC SECTION 1609 AS A FULLY ENCLOSED  
BLDG., WITH AN INTERNAL PRESSURE COEFFICIENT OF + OR - 0.18 (ASCE 7-05 FIGURE 6-5), AND  
USING THE FOLLOWING INFORMATION:

BASIC WIND SPEED (3 SECOND GUSTS)= 130 MPH (FIG 1609)  
IMPORTANCE FACTOR: CATEGORY III BLDG., IE =1.00, IS =1.0, IW =1.00 (TBL 1604.5)  
EXPOSURE B, DETERMINATION OF WIND LOADS SHALL BE IN ACCORDANCE WITH IBC SEC  
1609.4  
LIVE LOADS TBL 1607.1 OFFICE BUILDINGS  
CORRIDORS ABOVE FIRST FLOOR = 80PSF  
FILE AND COMPUTER ROOMS SHALL BE DESIGNED FOR HEAVIER LOADS BASED ON  
ANTICIPATED OCCUPANCY = -  
LOBBIES AND FIRST-FLOOR CORRIDORS = 100PSF  
OFFICES = 50 PSF  
GROUND SNOW LOADS= 5 PSF (FIG. 1608.2)

SQUARE FEET TOTAL: 2,397 SQ. FT.

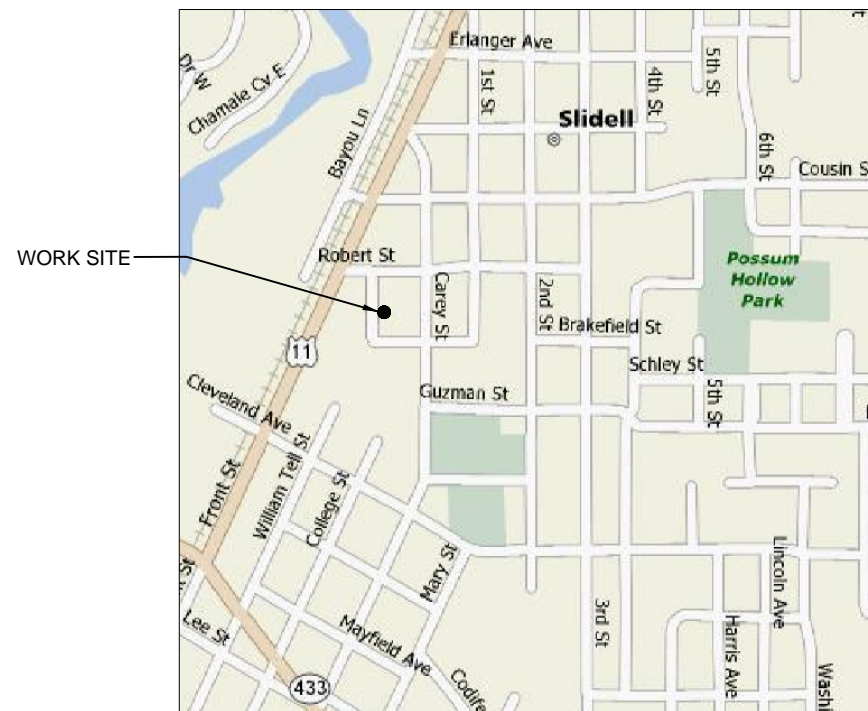


VICINITY MAP  
N.T.S.

INDEX OF DRAWINGS	
DWG#	DRAWING NAME
-	COVER SHEET
C-1	SITE PLAN & SURVEY
X-1	EXISTING FLOOR PLAN
D-1	DEMOLITION PLAN
A-1	NEW FLOOR PLAN
A-2	SCHEDULES & NOTES
A-3	EXTERIOR ELEVATIONS
A-4	REFLECTED CEILING PLAN
E-1	ELECTRICAL PLANS

**OFFICE RENOVATION FOR  
SAINT TAMMANY PARISH  
SCHOOL BOARD  
SLIDELL, LA**

DATE: 07-07-09  
JOB NO. 2035

**DAMMON ENGINEERING, INC.**  
1095 FLORIDA AVE.  
SLIDELL, LA 70458  
OFFICE: (985) 649-5832  
FAX: (985) 641-5950  
WEBSITE: WWW.DAMMONENGINEERING.COM  
EMAIL: DAMMONENG@BELLSOUTH.NET



SHEET 1  
OF 9