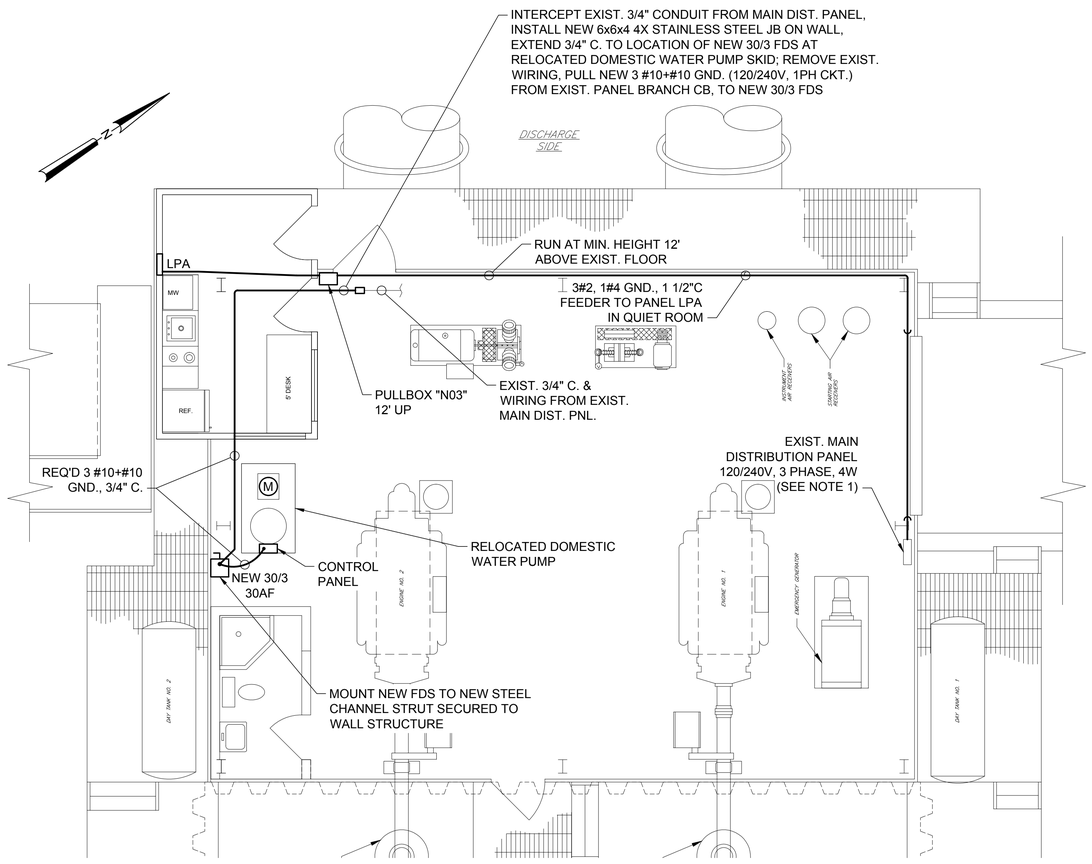

ELECTRICAL CONDUIT PLAN

SCALE: 1/4" = 1'-0"

NOTE:

1. FURNISH AND INSTALL IN EXISTING MAIN DISTRIBUTION PANEL; ONE 90A, 3-P CIRCUIT BREAKER IN POLE SPACES 17 & 19. BREAKER SHALL MATCH EXISTING.
2. SEE SHT DV-E1 FOR QUIET ROOM & BATHROOM LIGHTING & POWER PLANS.

These plans and specifications have been prepared by me or under my close personal supervision, and to the best of my knowledge and belief, they meet all applicable codes and ordinances. I will inspect the work.

Bruce D. Barton
BRUCE D. BARTON, # 18286
Date

STATE OF LOUISIANA
BRUCE D. BARTON
REG. No. 18286
REGISTERED PROFESSIONAL ENGINEER
Bruce D. Barton
10/4/2012

ALL SOUTH CONSULTING ENGINEERS, L.L.C.
652 PAPWORTH AVENUE
METAIRIE, LA 70005
(504) 322-2783

CADD FILE NAME:

REVISIONS

DATE:	REMARKS:	APP'D

DESIGNED BY: RAC
DRAWN BY: EAO
CHECKED BY: RAC
DATE: 10/04/2012
SCALE: AS SHOWN
JOB NO. 025-006-01

PLAQUEMINES PARISH QUIET ROOMS
PACKAGE NO. 2
DIAMOND PUMP STATION, HAYES PUMP STATION, GRAND DELIARD PUMP STATION, AND DUVIC PUMP STATION
DUVIC PUMP STATION
ELECTRICAL CONDUIT PLAN

SHEET NO.
DV-E2