


PUMP DATA  
 DUPELX GRINDER PUMPS  
 40 GPM @ 40 TDH  
 WITH 2 H.P. 3750 R.P.M. MOTORS  
 ZOELLER 840

DUPELX LIFT STATION DETAIL  
 NOT TO SCALE

- \* CONCRETE STRENGTH IS 4,800 PSI @ 28 DAYS
- \* STRUCTURE JOINTS TO BE SEALED WITH FLAT BUTYL SEALANT (CONSEAL)
- \* REINFORCEMENT STEEL MEETS HS-20 LOADING REQUIREMENTS

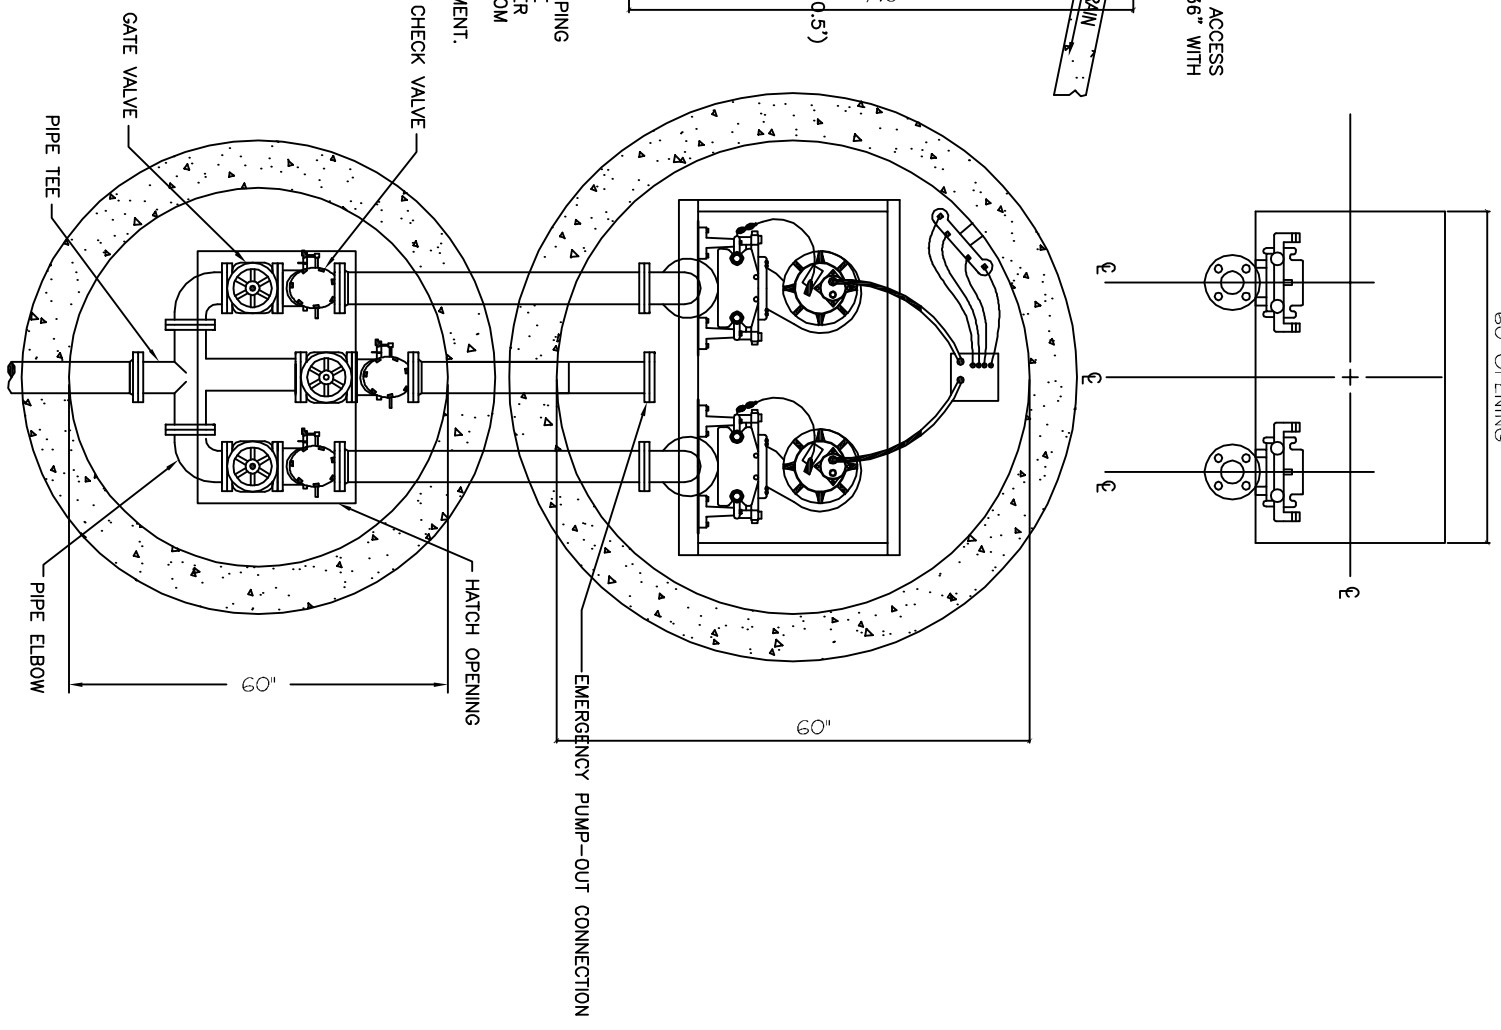

SEWER  
 LIFT  
 STATION

SHEET NO: 03 OF 04

C2A

REVISIONS	
#	DESCRIPTION

**DREAMLAND MOBILE HOME PARK**  
 ALLIE ESSENCE LANE  
 NICHOLSON, MISSISSIPPI

JOB NO: 2182 DATE: 05-19-2014  
 DRAWN BY: CKD CHECKED BY: BM

The above drawings and specifications, designs and arrangements, represent the work and shall not be used for any other project or purpose without the written consent of the engineer. The engineer shall not be responsible for any errors or omissions in the drawings or specifications or for any consequences arising therefrom. The engineer shall not be responsible for any damage or injury to persons or property caused by the use of the drawings or specifications or for any consequences arising therefrom.

**DAMMON ENGINEERING, INC.**  
 Architects & Engineers

CHIEF ENGINEER: BRIAN MISTICH, P.E.  
 CHIEF ARCHITECT: KEVIN KINCHEN  
 554 OLD SPANISH TRAIL  
 SLIDELL, LA 70458  
 dammonengineering.com  
 PHONE: 985-644-5832  
 FAX: 985-641-5450