A/C UNIT SCHEDULE

TOTAL BTU	ELECTRICAL VOLTAGE	ELECTRICAL MCA	ELECTRICAL CKT BRKRS	COMMENTS
60,000 BTU (5 TON) AC #1	240V,3Φ	-	P1 60 AMP	NOTE: ALL A/C TO BE SPLIT-SYSTEM HVAC (TRANE OR EQUAL)

AHU UNIT SCHEDULE

TOTAL BTU	CFM	O.A.	HEAT (KW)	ELECTRICAL VOLTAGE	ELECTRICAL MCA	ELECTRICAL CKT BRKRS	COMMENTS
60,000 BTU (5 TON) AHU #1	2,000	80	20	240V,3Φ	-	P1-,-,-	NOTE: ALL A/C TO BE SPLIT-SYSTEM HVAC (TRANE OR EQUAL)

EXHAUST FAN SCHEDULE

EXHAUST	LOCATION	CFM	VOLTAGE	TYPE	MANUFACTURER
EF-2	TOILET	75	120	VENT	BROAN OR EQUAL
EF-3	TOILET	130	120	VENT	BROAN OR EQUAL

LEGEND

- SUPPLY AIR GRILLE
- RETURN AIR GRILLE
- EXHAUST FAN
- THERMOSTAT
- SUPPLY AIR DUCT
- FRESH AIR DUCT
- DAMPER CONTROL
- ROUND FLEX DUCT, MAX. LENGTH 12'-0", MIN. R-6. PROVIDE MAN. DAMPER AT DIFFUSER CONNECTIONS. DUCT SIZE AS FOLLOWS:
  250 CFM TO 350 CFM = 9"
  200 CFM TO 250 CFM = 8"
  150 CFM TO 200 CFM = 7"
  100 CFM TO 150 CFM = 6"

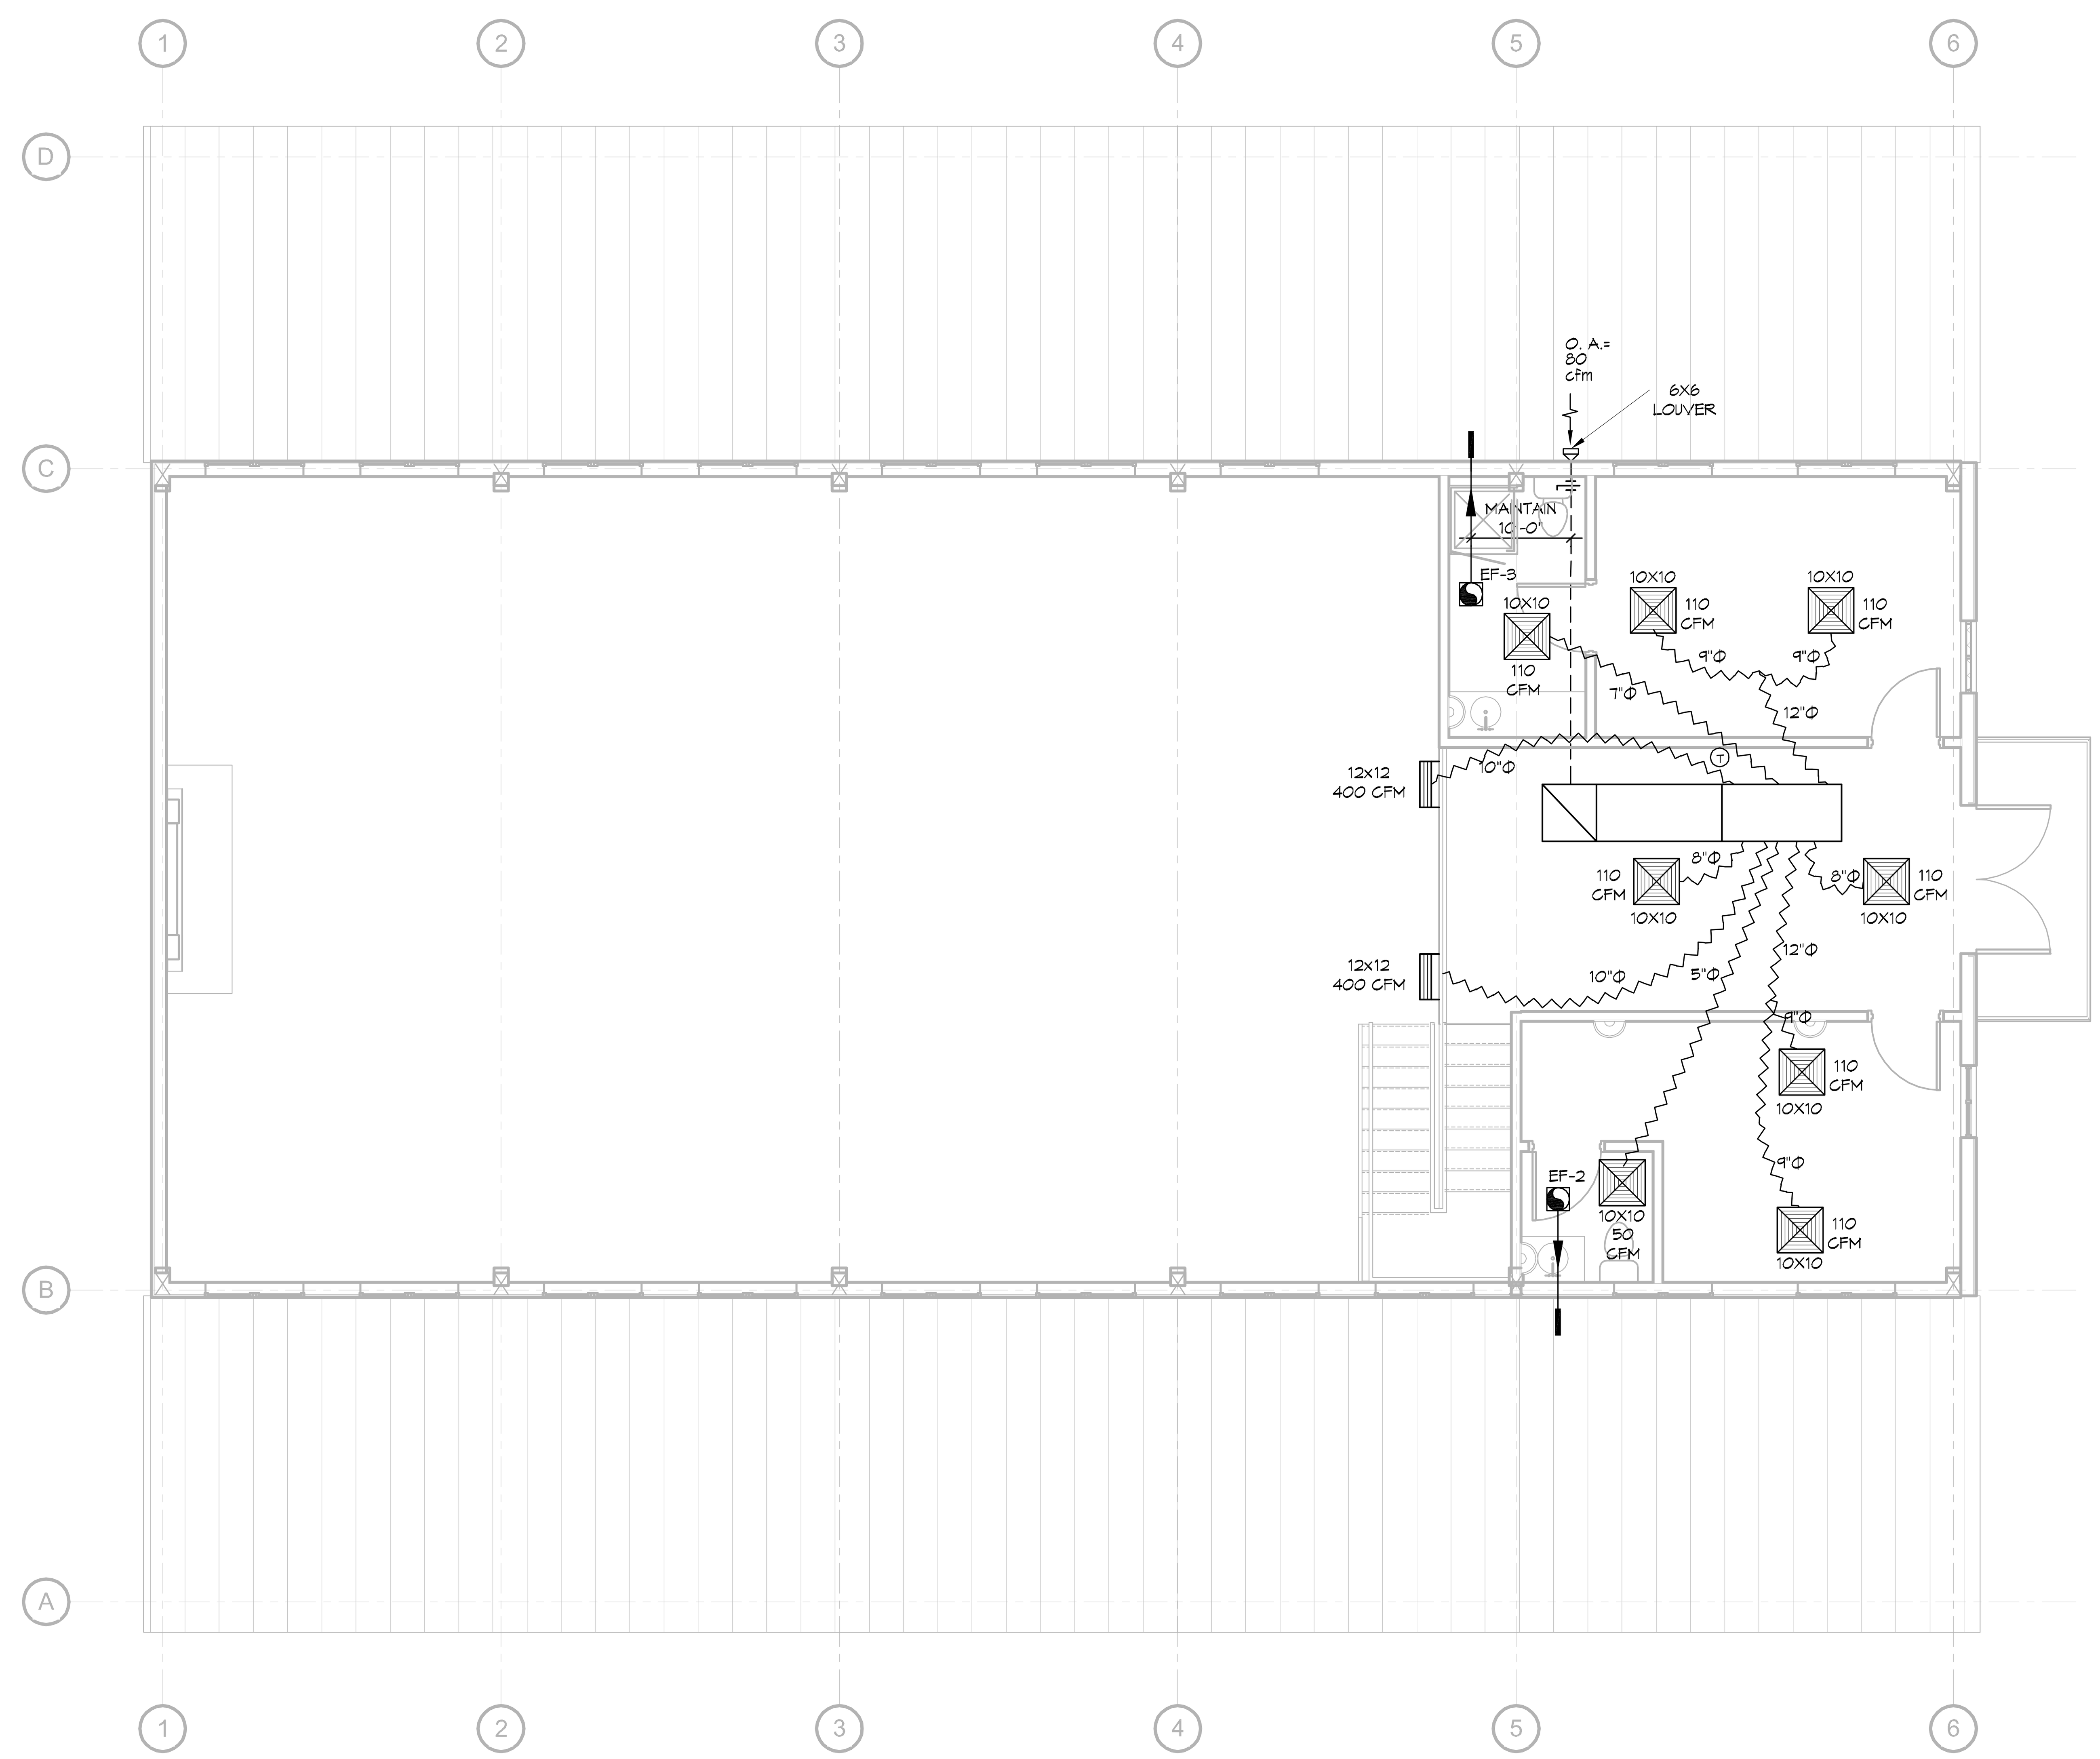

1 MECHANICAL MEZZ FLOOR PLAN

SCALE: 3/16"=1'-0"

DAMMON ENGINEERING, INC.

LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS

#	DESCRIPTION	DATE

SEAL: STATE OF LOUISIANA — BRIAN A. MISTICH License No. 30187 — PROFESSIONAL ENGINEER

NEW BUILDING

PINEWOOD WEDDING VENUE

405 COUNTRY CLUB BLVD.
SLIDELL LA. 70458

JOB No: 2329	DATE: 11-10-17
DRAWN BY: CKD	CHECKED BY: BAM

SHEET TITLE: MECHANICAL FLOOR PLAN, SCHEDULES AND DETAILS

DRAWING NUMBER: M102

SHEET No: 4 of # 4