


1 SITE UTILITY PLAN
SCALE: 1"=30'-0"

GENERAL SITE NOTES

1. PROVIDE ALL LABOR, MATERIAL, AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS, AND INVERTS PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
2. CONTRACTOR TO BE RESPONSIBLE TO VERIFY ANY INVERTS AND SET NEW INVERTS OF SEWAGE AND DRAINAGE PIPES.
3. ALL WORK AND MATERIAL TO COMPLY STRICTLY TO THE LATEST LOCAL CITY, PARISH, STATE, AND NATIONAL GOVERNING CODES.
4. SEWAGE LINES 3" AND SMALLER SHALL BE SLOPED 1/4" PER FOOT AND LINES THAT ARE 4" AND LARGER SHALL BE SLOPED 1/8" PER FOOT.
10. CONTRACTOR SHALL CONTACT LOUISIANA ONE CALL PRIOR TO COMMENCEMENT OF SITE EXCAVATION.

SITE UTILITIES LEG


- W — NEW WATER LINE
- S — NEW SEWER LINE
- P — NEW ELECTRICAL LINE

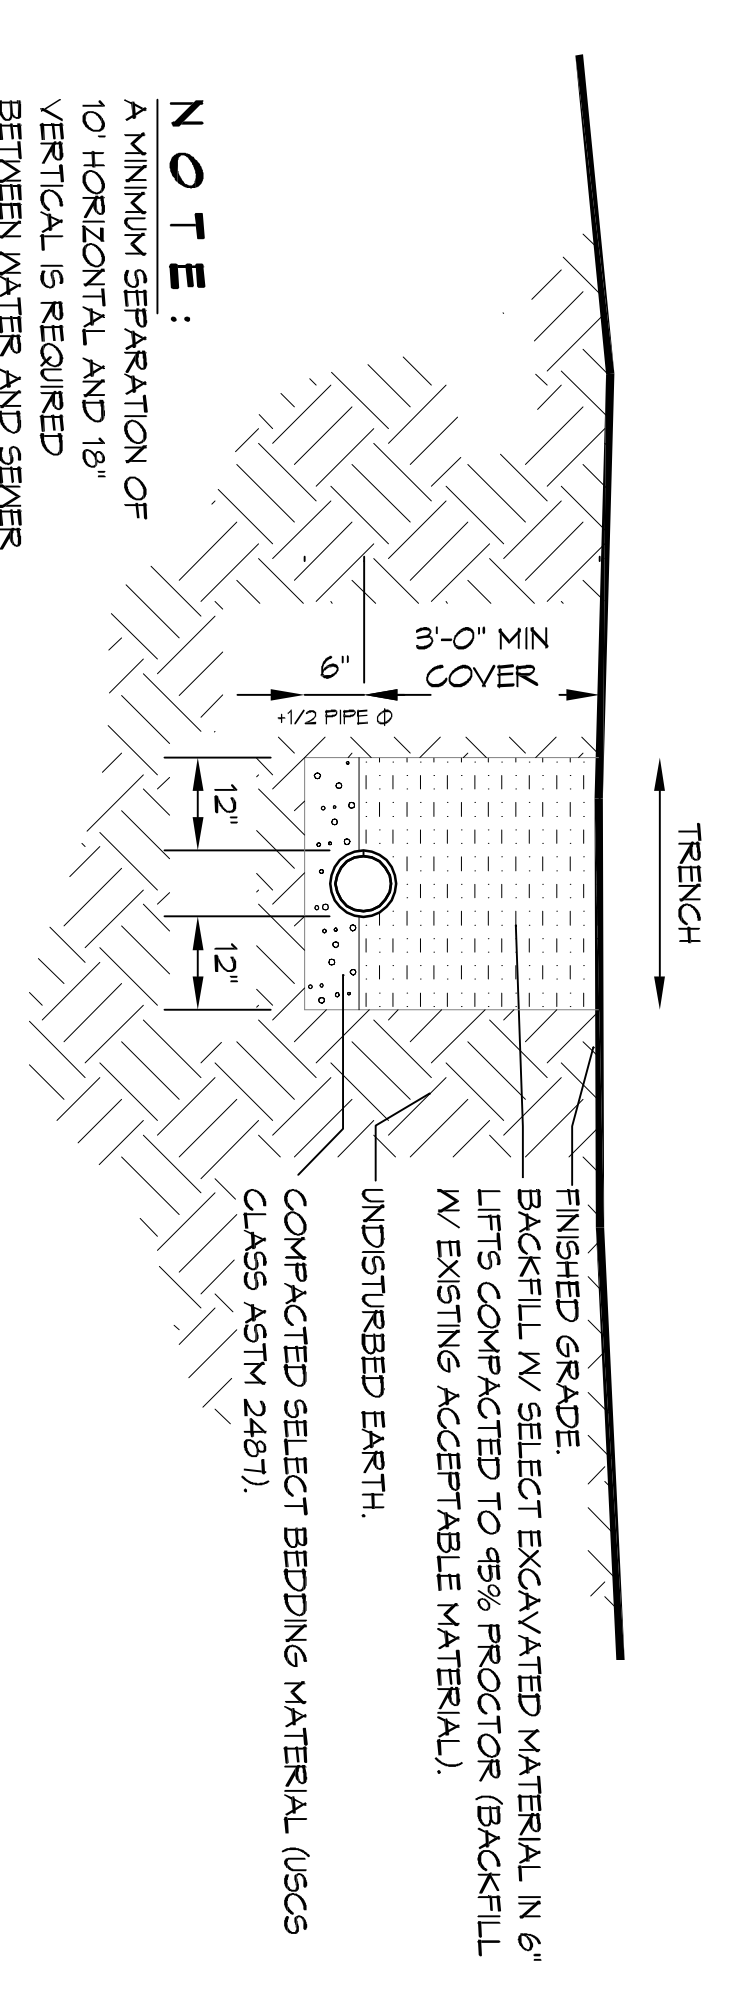

NOTE:
A MINIMUM SEPARATION OF 10" HORIZONTAL AND 18" VERTICAL IS REQUIRED BETWEEN WATER AND SEWER LINES


2 DETAIL
SCALE: N.T.S.

SEWER AND WATER SEPARATION

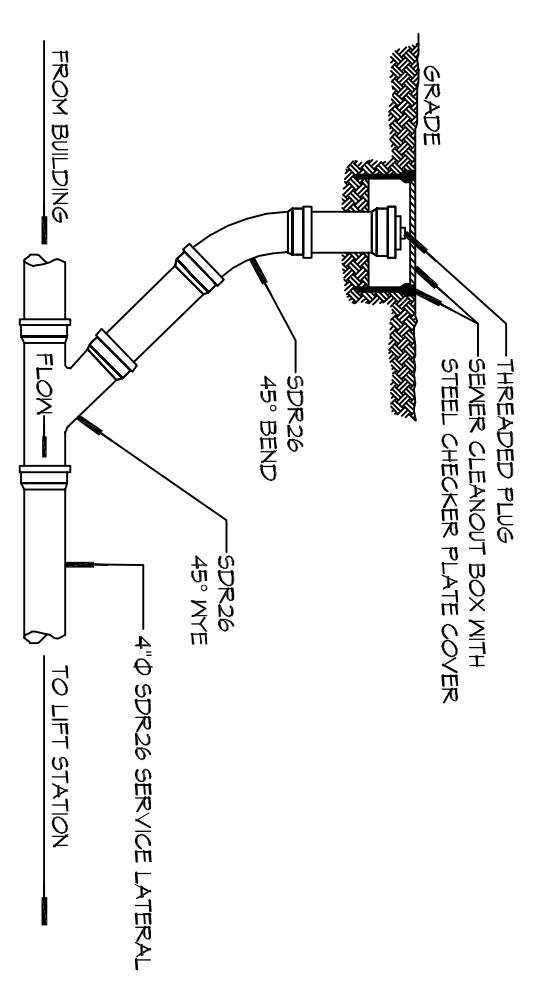

3 DETAIL
SCALE: N.T.S.

SEWER CLEAN OUT

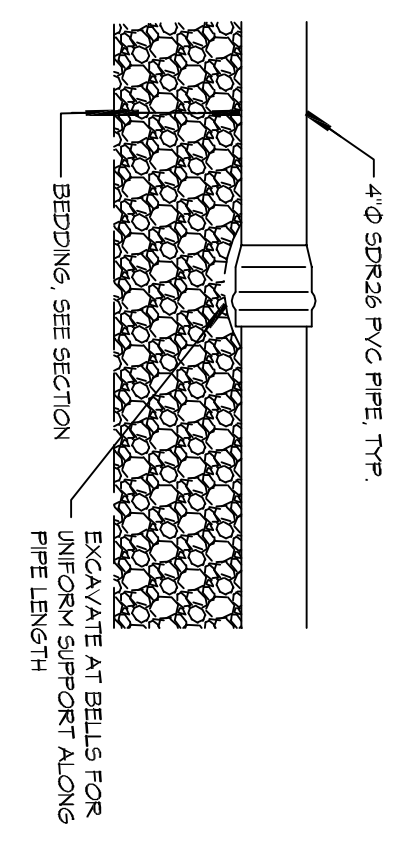

4 DETAIL
SCALE: N.T.S.

TYPICAL PIPE BEDDING

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI

Chief Engineer: Brian Mstich, PE
554 Old Spanish Trail
Siddell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS		DATE
#	DESCRIPTION	

NEW BUILDING
PINEWOOD WEDDING VENUE
405 COUNTRY CLUB BLVD.
SLIDELL, LA. 70458

JOB No: 2929 DATE: 11-10-17
DRAWN BY: CKD CHECKED BY: CKD

The above drawings are specifications. Design and engineering responsibility for the use shall remain the property of Dammon Engineering, and no part thereof shall be copied, printed, or used in connection with any work or project other than that for which they were prepared and approved without written consent of Dammon Engineering. Visual contact with their drawings or specifications shall constitute acceptance of the drawings or specifications. All drawings are subject to change.

SHEET TITLE:
SITE UTILITY PLAN

DRAWING NUMBER:
C102

SHEET NO.: 4 of 4