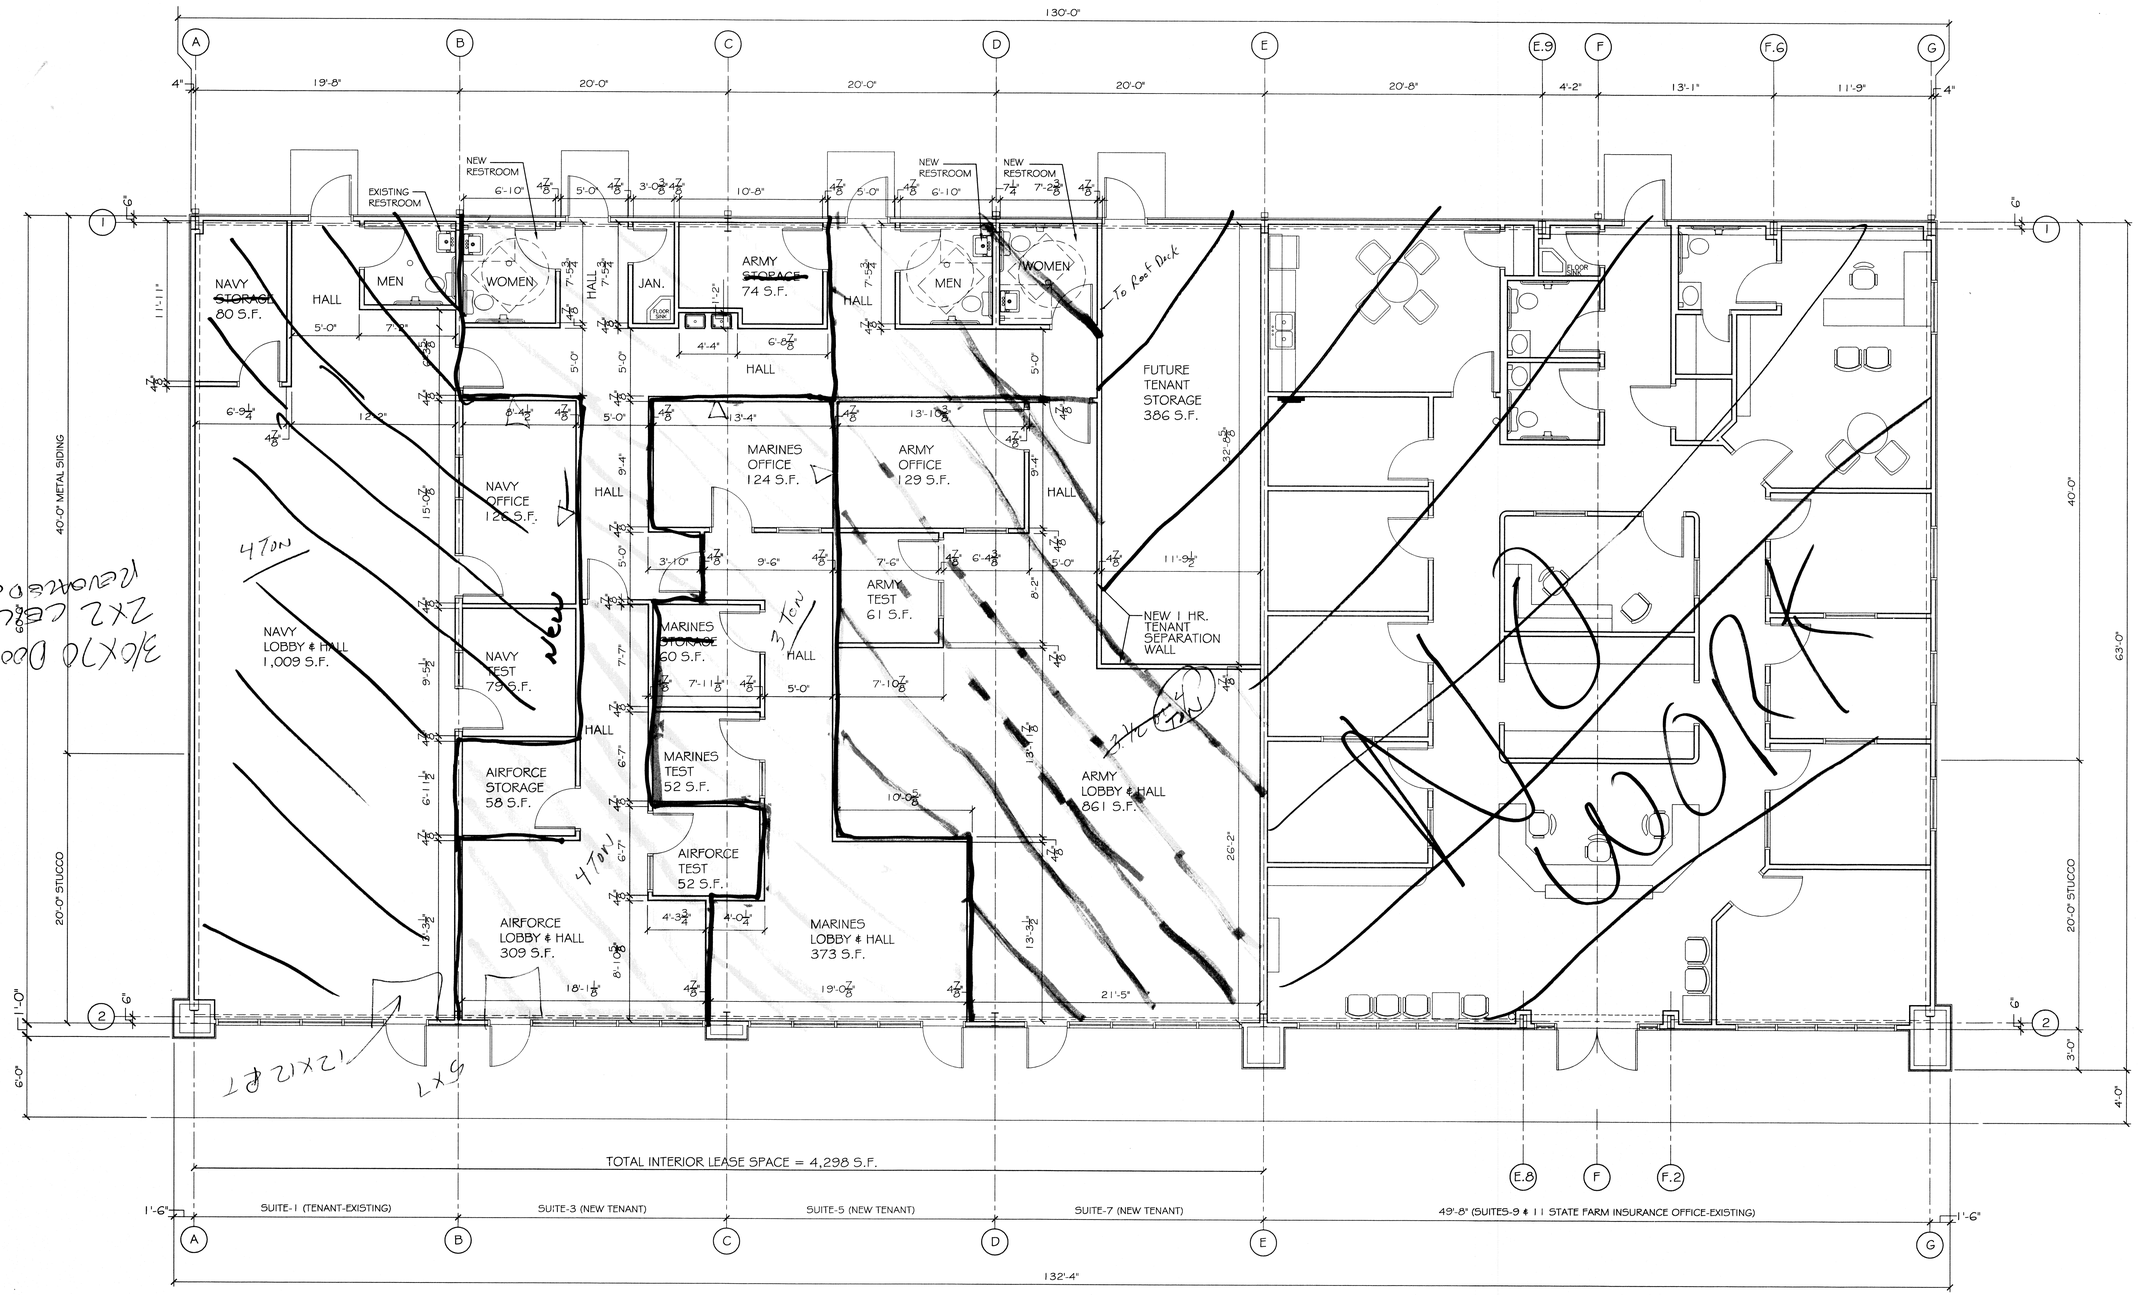

GA FILE NO. WP 1072 GENERIC

ONE LAYER 5/8" TYPE X GYPSUM WALLBOARD OR GYPSUM VENEER BASE APPLIED PARALLEL OR AT RIGHT ANGLES TO EACH SIDE OF 3-5/8" STEEL STUDS 24" O.C. WITH 1" TYPE S DRYWALL SCREWS 8" O.C. AT VERTICAL JOINTS AND 12" O.C. AT FLOOR AND CEILING RUNNERS AND INTERMEDIATE STUDS.

JOINTS STAGGERED 24" ON EACH SIDE AND ON OPPOSITE SIDES. SOUND TESTED WITH 3-12" GLASS FIBER FRICTION FIT IN STUD SPACE. (NON-LOAD BEARING)

1 HOUR FIRE 45 TO 49 STC SOUND

THICKNESS: 4-7/8"
APPROX. WEIGHT: 6 PSF
FIRE TEST: SEE WP 1200 (FM WP-45, 6-19-68); OSU T-1770, 8-61; ULC 79T484, 79T500, 79T497, 8-12-81, ULC DESIGN W415)
SOUND TEST: NRCC 816-NV, 2-3-81

1 HR SEPARATION DETAIL
NTS

FLOOR PLAN
SCALE: 3/16"=1'

NOTE: ALL DIMENSIONS ARE TO FACE OF GYP. BD., EXCEPT COLUMN GRID LINES, UNLESS OTHERWISE NOTED.

DAMMON ENGINEERING, INC.
Architects & Engineers
dammoneng@bellsouth.net
PHONE: 985-649-5852
FAX: 985-641-5950
CHIEF ENGINEER: EMMETT DAMMON, P.E.
CHIEF ARCHITECT: ROBERT WILTSE
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

PHS PROPERTIES, L.L.C.
TENANT BUILDOUT
351-391 GAUSE BOULEVARD, WEST
SLIDELL, LOUISIANA

JOB No: 2162 | DATE: 01-24-2013
DRAWN BY: JTL | CHECKED BY:

REVISIONS

#	DESCRIPTION	DATE

The above drawings and specifications, together with all the architectural and engineering ideas, designs and arrangements represented thereby, are and shall remain the property of the architect and engineer and are not to be used in whole or in part, or altered, in any way whatsoever, or loaned, copied or exhibited without the written permission of the architect and engineer. Visual contact with these drawings and specifications shall constitute conclusive evidence of acceptance of these restrictions.

REVISED LATEST FLOOR PLAN SCHEME - C

SHEET No:

A-1