





- FOUNTAIN NOTES**
1. Fountain shall be design/build by contractor.
  2. Fountain shall conform to layout as shown in details 1-2 on sheet F1.0.
  3. Fountain shall be constructed of single pour of 3500 psi concrete with #4 rebar 8" O.C E.W. as shown.
  4. Fountain coping shall be cast in place as shown.
  5. A single skimmer box shall be provided along with bottom drains as necessary.
  6. Fountain shall feature 6 bubbler type nozzles to provide for a minimum 36" high jet.
  7. Nozzles shall be located as shown.
  8. Each fountain nozzle shall have 3 submersible lights.
  9. Fountain mechanical and electrical system to be designed by contractor and/or fountain supplier and shall be approved by landscape architect.
  10. All fountain mechanical and electrical equipment shall be housed in a below grade vault.
  11. Plaster and waterline tile to be determined by contractor for approval.
  12. Fountain exterior to have stucco finish to match buildings on site.

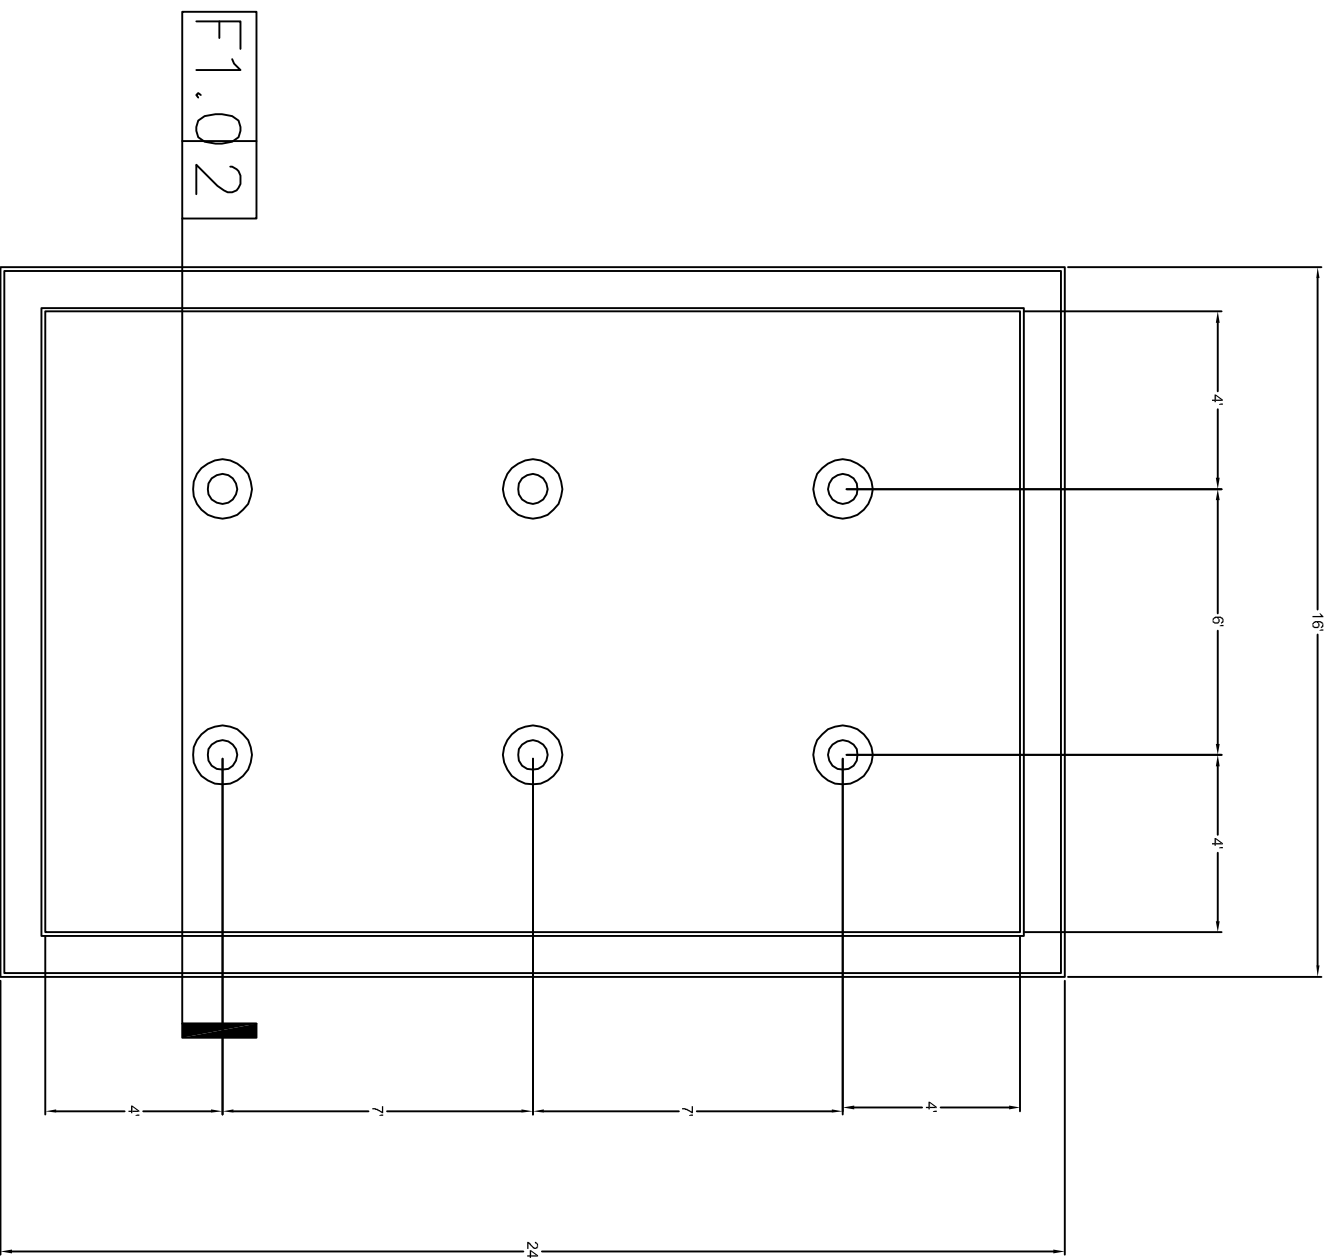

**1** FOUNTAIN LAYOUT PLAN  
SCALE: 1/2" = 1'-0"

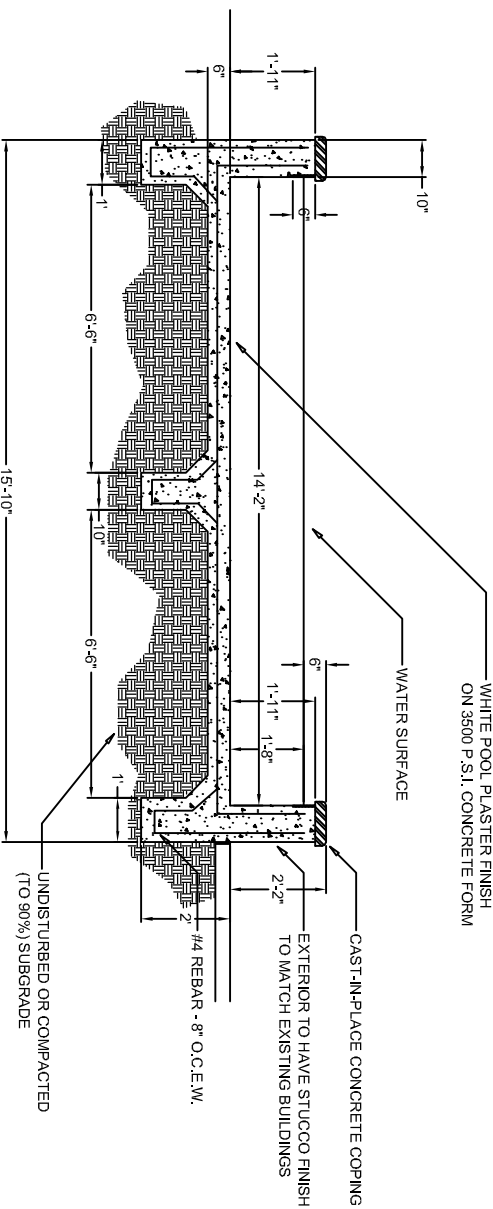

**2** FOUNTAIN SECTION  
SCALE: 1/2" = 1'-0"

**CITY HALL PARKING LOT & COURTYARD**

BOUECAREN STREET  
SUDELL, LA

JOB No:	2172	DATE:	05-30-13
DRAWN BY:	ERM	CHECKED BY:	

REVISIONS		
#	DESCRIPTION	DATE

FOUNTAIN LAYOUT PLAN

SHEET No: 11 OF 11

**F1.0**