



NOTES
 REMOVE ALL ELECTRICAL EQUIPMENT, PUMP MOTORS, CONDUITS, WIREWAYS AND WIRING UNLESS NOTED OTHERWISE.
 RETAIN ELECTRICAL CONDUIT FROM THE FIRST FLOOR TO EACH FLOOR ABOVE.
 REMOVE ALL ELECTRICAL WIRE FROM 480 VOLT RISERS. RETAIN CONDUIT.

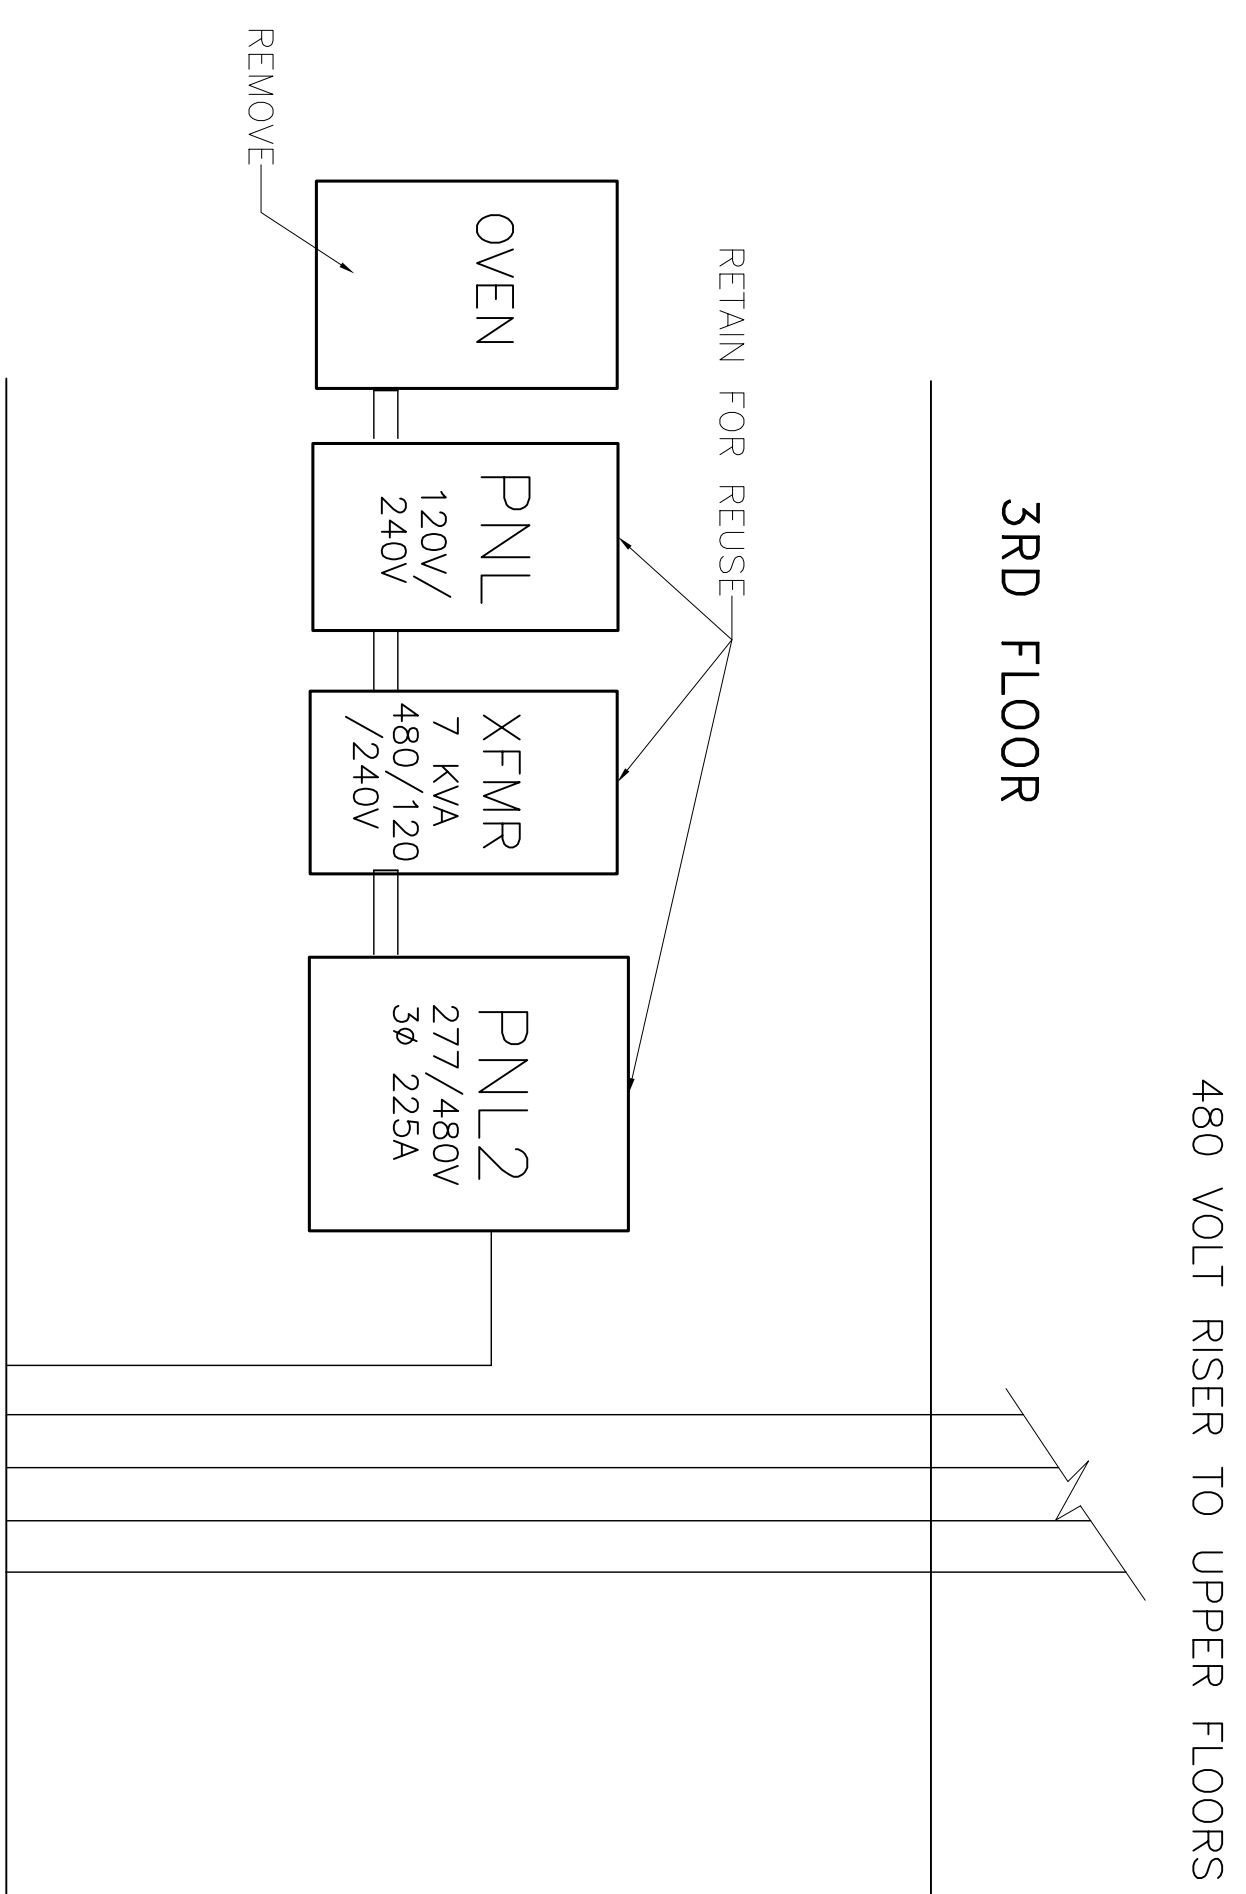

TYPICAL EXISTING ELECTRICAL DISTRIBUTION 2nd THRU 6th FLR. MECHANICAL ROOMS N.T.S.

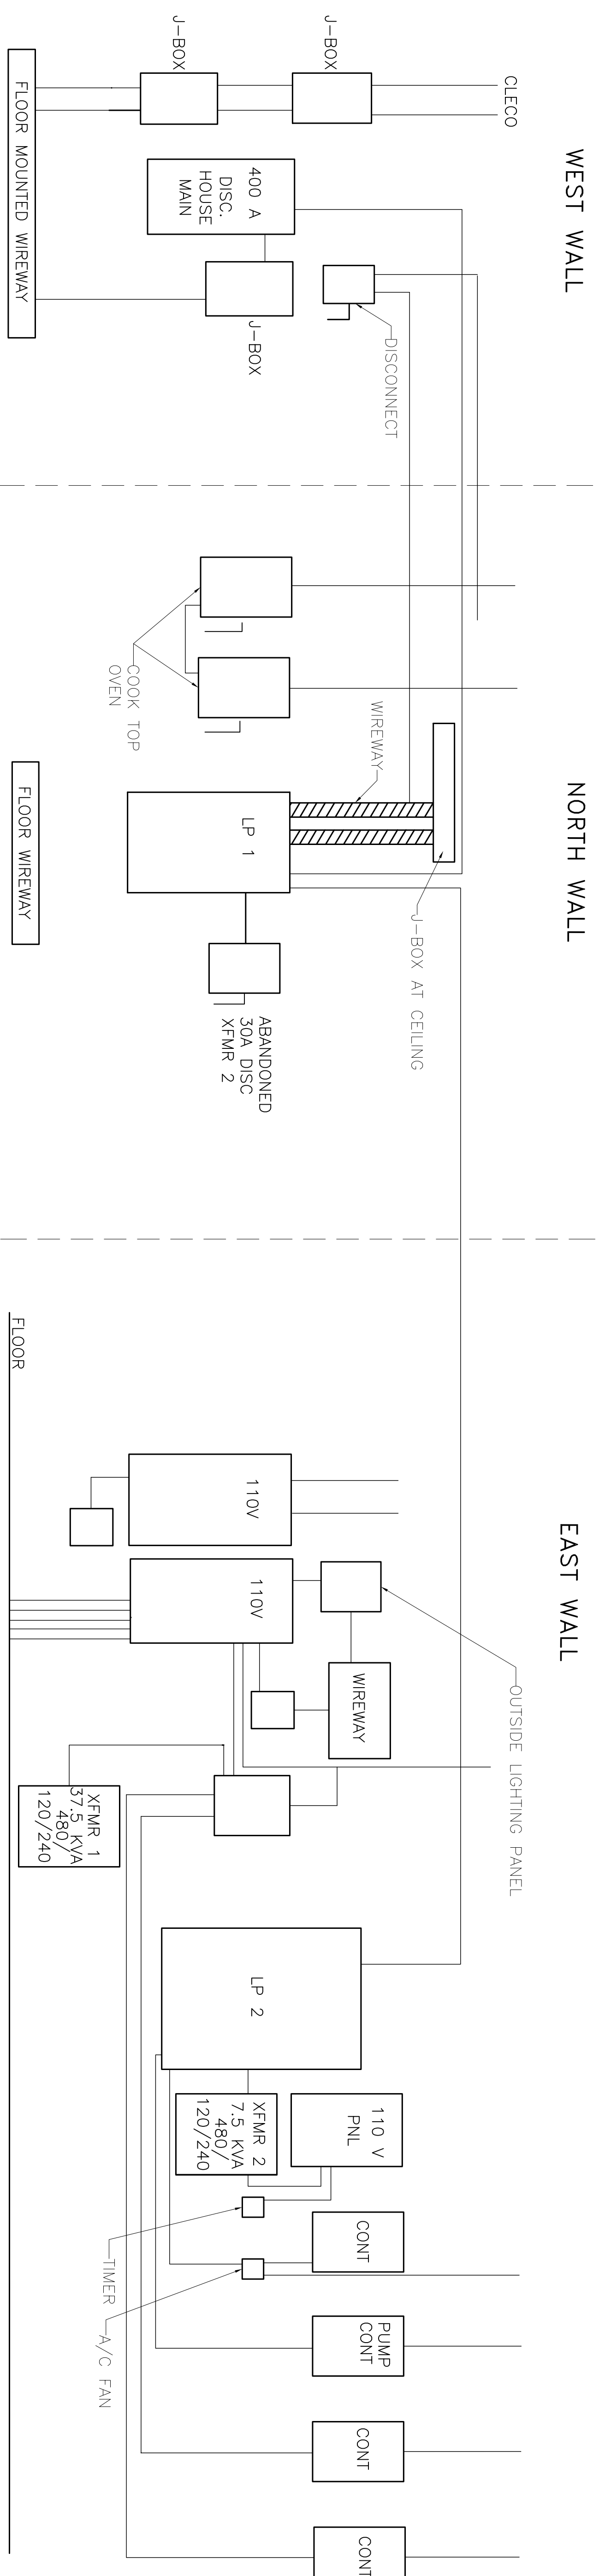

EXISTING ELECTRICAL DISTRIBUTION SYSTEM 1st FLOOR BOILER ROOM N.T.S.

EXISTING ELECTRICAL SYSTEM
 ST. TAMMANY PARISH ADMIN. COMPLEX
 OLD SPANISH TRAIL
 SLIDELL, LOUISIANA

RENOVATE OFFICE BUILDING
DAMMON ENGINEERING. INC.
 1095 FLORIDA AVENUE 985-649-5832 SLIDELL, LA. 70458
 DAMMONENGINEERING.COM

SCALE:AS NOTED
 FILE:
 JOB NO.: 1729
 DATE:1-8-07
 SHEET

OF E13

CONTRACT SET- 10/10/07