

CLUB HOUSE LIGHT FIXTURE SCHEDULE

TAG	DESCRIPTION	MANUFACTURER CATALOG NUMBER	LAMP	WATTS	VOLTS	MOUNTING LOCATION	REMARKS
A	1-LAMP RECESSED CAN LIGHT	PROGRESS P6132-EB (26watt)/P8015-21A	(1) 26W CFL	26	120	CEILING - RECESSED	1
AE	1-LAMP RECESSED CAN LIGHT WITH BATTERY BACKUP	PROGRESS P6132-EBEM (26watt)/P8015-21A	(1) 26W CFL	26	120	CEILING - RECESSED	1
A2	2-LAMP RECESSED CAN LIGHT	PROGRESS P68-EB (2-18watt)/P8030-21A	(2) 26W CFL	52	120	CEILING - RECESSED	1
A2E	2-LAMP RECESSED CAN LIGHT WITH BATTERY BACKUP	PROGRESS P68-EBEM (Emergency)/P8030-21A	(2) 26W CFL	52	120	CEILING - RECESSED	1
A3	1-LAMP RECESSED DIMMABLE CAN LIGHT	PROGRESS P6132-EBDM (dimmmable)/P8015-21A	(1) 26W CFL	26	120	CEILING - RECESSED KITCHENETTE/RECEPTION	1
A4	2-LAMP RECESSED CAN LIGHT, WET LOCATION LISTED	PROGRESS P66-EB/P8034-83	(2) 26W CFL	52	120	CEILING - RECESSED PATIO	1
CB	2-LAMP SURFACE MOUNT LINEAR FLUORESCENT	P7189-30STR (120/277)	(2) 32W T8	64	120	CEILING - SURFACE EXERCISE	1
CBE	2-LAMP SURFACE MOUNT LINEAR FLUORESCENT WITH BATTERY BACKUP	P7189-30STR (120/277)EM	(2) 32W T8	64	120	CEILING - SURFACE EXERCISE	1
CF1	CEILING FAN - NO LIGHT KIT	PROGRESS P2530-09	N/A	65	120	CEILING EXERCISE	1
CF2	CEILING FAN - NO LIGHT KIT	PROGRESS P2502-80	N/A	56	120	CEILING PATIO	1
EMO	LED REMOTE EMERGENCY LIGHT	LITHONIA ELA T QWP L0309	LED	-	120	SURFACE	2,4
CS	EXTERIOR WALL SCONCE	PROGRESS P5898-108	(2) 40W T10	80	120	WALL MOUNTED	1
CJ	4' FLUORESCENT STRIP	PROGRESS P7287-30EB	(1) 32W T8	32	120	CEILING MEP/JANITOR/FILES	1
CV	4-LAMP VANITY, BRUSHED NICKEL, WALL MOUNTED ABOVE MIRROR, FROSTED GLASS	PROGRESS P2003-09	(4) 43W A19	172	120	VANITY MENS/WOMENS	1
CL	TWELVE LIGHT CHANDELIER	PROGRESS P4497-09	(12) 43W A19	516	120	PENDANT VESTIBULE	1
CP	SINGLE MINI PENDANT, DIMMABLE	PROGRESS P5270-09	(1) 43W A19	43	120	PENDANT KITCHENETTE	1
CK	KEYLESS PORCELAIN SOCKET	LEVITON R50-09875-000	(1) 150W INC ROUGH SERVICE	150	120	SURFACE ATTIC	1
CX	WHITE THERMOPLASTIC EXIT SIGN, RED LETTERS WITH BATTERY BACKUP	PROGRESS PE008-30	LED	1	120	UNIVERSAL	3
EMH	WHITE THERMOPLASTIC COMBO EXIT SIGN AND EM LIGHT, RED LETTERS WITH BATTERY BACKUP	DUAL-LITE LM60N-SRHSW0812	LED	6	120	UNIVERSAL	3


REMARKS:
 1. SUBSTITUTIONS SHALL BE EQUIVALENT TO MODEL NUMBER SHOWN AND APPROVED BY OWNER PRIOR TO PURCHASE.
 2. GRAY SHOWN, VERIFY COLOR WITH OWNER PRIOR TO PURCHASE.
 3. PROVIDE WALL OR SUSPENDED MOUNTING AS NECESSARY.
 4. CONNECT TO NEAREST TYPE 'XR' FIXTURE.

PANELBOARD CH		NEMA ENCLOSURE 1		AIC RATING 65,000	
PANEL TYPE QO		MOUNTING SURFACE		NOTES TOP FEED	
MAIN BREAKER		VOLTAGE 240/120V MAINS 400A MCB		PHASE 1 PNL MAXAMPS 400A WIRE 3 OPTIONS	

CCT NO.	LOAD DESCRIPTION	BKR SIZE	BKR OPT	ACTUAL KW	PHASE	ACTUAL KW	BKR OPT	BKR SIZE	LOAD DESCRIPTION	CCT NO.
1	LANDSCAPE/VESTIBULE/SIGN LTG	20/1		1.280	A	1.000		20/1	RECEPTION LTG	2
3	OFFICE/FILES/MEP LTG	20/1		0.400	B	0.360		20/1	BATHROOM/HALL LTG	4
5	CEILING FANS	20/1		0.600	A	0.240		20/1	EXERCISE LTG	6
7	EXTERIOR LTG	20/1		0.400	B	1.500		20/1	VESTIBULE CHANDELIER	8
9	EMERGENCY/EXIT LTG	20/1		0.100	A	0.800		20/1	CLOSING/KITCHENETTE LTG	10
11	KITCHENETTE RCPT	20/1		0.720	B	0.720		20/1	KITCHENETTE RCPT	12
13	TELEPHONE BOARD RCPT	20/1		0.360	A	0.360		20/1	TELEPHONE BOARD RCPT	14
15	FIRE ALARM PANEL	20/1		0.360	B	1.200		20/1	COPIER	16
17	MEP RCPT / WATER HEATER	20/1		0.000	A	4.800		50/2	OVEN	18
19	PATIO RCPT	20/1		0.600	B	4.800		50/2	OVEN	20
21	FILES / IT RCPT	20/1		0.900	A	0.720		20/1	RECEPTION RCPT	22
23	FILES / IT RCPT	20/1		0.960	B	0.900		20/1	MULTIPURPOSE RCPT	24
25	FILES / IT RCPT	20/1		0.360	A	0.360		20/1	YOGA RCPT	26
27	MANAGER RCPT	20/1		0.900	B	0.360		20/1	POOL EQUIPMENT RCPT / FAN	28
29	ASSISTANT RCPT	20/1		0.720	A	1.200		20/1	EXERCISE FLOOR RCPT	30
31	VESTIBULE / HALL / JANITOR RCPT	20/1		0.720	B	1.200		20/1	EXERCISE FLOOR RCPT	32
33	EXERCISE WALL RCPT	20/1		0.540	A	1.200		20/1	EXERCISE FLOOR RCPT	34
35	EXERCISE WALL RCPT	20/1		0.540	B	1.200		20/1	EXERCISE FLOOR RCPT	36
37	GARBAGE DISPOSAL	20/1		0.500	A	1.200		20/1	EXERCISE FLOOR RCPT	38
39	DISHWASHER	20/1		0.500	B	1.200		20/1	EXERCISE FLOOR RCPT	40
41	REFRIGERATOR	20/1		0.800	A	3.200		40/2	CU-1	42
43	MICROWAVE	20/1		1.200	B	3.200		40/2	CU-2	44
45	AC-1AD-1	15/1		1.660	A	3.200		40/2	CU-2	48
47	AC-2AD-2	15/1		1.660	B	3.200		40/2	CU-2	48
49	AC-3AD-3	15/1		1.660	A	3.200		40/2	CU-3	50
51	MENS/WOMENS RCPT / FAN	20/1		1.000	B	3.200		20/2	SITE LIGHTING	52
53	HANDICAP ACCESS	20/1		0.200	A	0.900		20/2	SITE LIGHTING	54
55	ATTIC LTG/RCPT	20/1		0.280	B	0.900		20/1	MAIL KIOSK RCPT	56
57	EBB-3	20/1		1.000	A	0.400		20/1	MAIL KIOSK LTG	60
59	WATER HEATER / RECIRC PUMP	20/1		0.200	B	0.300		20/1	SPACE	62
61	SPACE			0.000	A	0.000			SPACE	64
63	SPACE			0.000	B	0.000			SPACE	64
65	SPACE			0.000	A	0.000			SPACE	66

ACTUAL CONNECTED		32.060 KW	PHASE A
		33.580 KW	PHASE B
		65.640 KW	TOTAL

274 AMPS

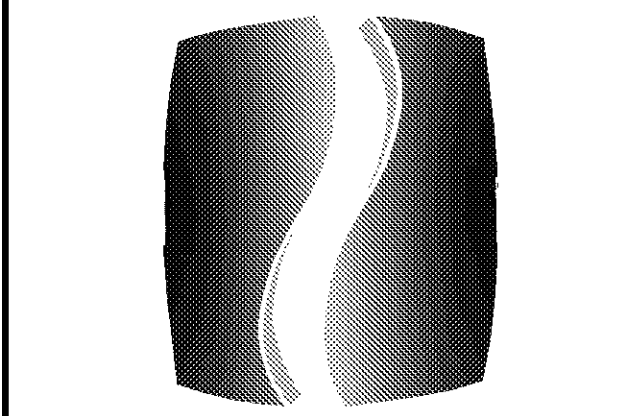

PHILLIPS

Phone 770.394.1616 Fax 770.394.1314

CONSULTANT



SEAL

ISSUE & REVISION RECORD

#	DATE	DESCRIPTION
	07/07/14	BID SET

This document is the property of Phillips Partnership, PC and is intended as an instrument of service and is not to be used for any other project or purpose without the prior written consent of Phillips Partnership, PC.

PROJECT

SPRINGS AT FREMAUX TOWN CENTER
SLIDELL, LA

CLIENT

CONTINENTAL PROPERTIES
CONTINENTAL 294 FUND LLC
W134 N8675 EXECUTIVE PARKWAY
MENOMONEE FALLS, WI 53051
262.502.5500 • FAX 262.502.5522

PHILLIPS JOB NUMBER 1333104

ISSUE DATE 07/07/14

DRAWN BY/CHECKED BY JDP


DRAWING TITLE

CLUBHOUSE SCHEDULES AND RISER

SHEET NUMBER

E2.C.01


NORTH TERRACES
400 PERIMETER CENTER TERRACE
SUITE 650
ATLANTA, GEORGIA 30346

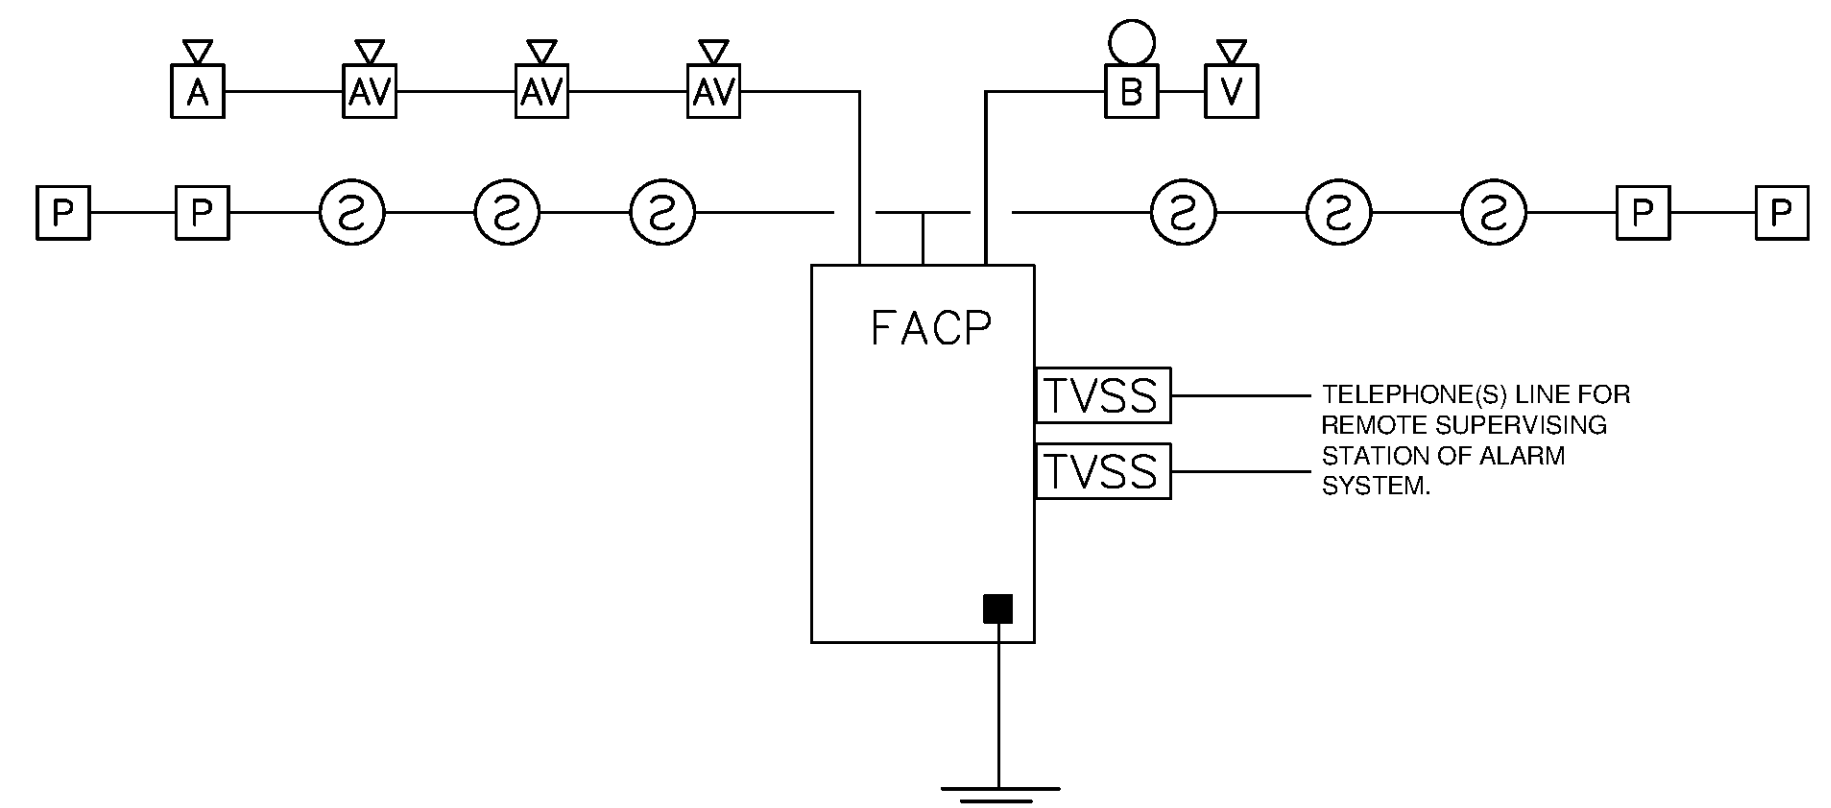

1 FIRE ALARM SCOPE RISER FOR CLUBHOUSE (DESIGN BUILD SYSTEM)
SCALE: NOT TO SCALE

DESIGN BUILD FIRE ALARM SYSTEM NOTES:


- CONDUITS (WHERE REQUIRED) TO BE 3/4" MINIMUM AND SIZED BY THE ELECTRICAL CONTRACTOR AS PER THE N.E.C. AND FILLED TO A 40% MAXIMUM.
- ALL FIRE ALARM INITIATING, SIGNAL AND CONTROL CIRCUITS SHALL BE POWER LIMITED. ACTUATION OF ANY PULL STATION, FLOW SWITCH OR SMOKE DETECTOR SHALL ACTIVATE ALARM.
- ALL FIRE ALARM COMPONENTS SHALL BE U.L. LISTED AND COMPATIBLE AS A COMPLETE SYSTEM.
- FIRE ALARM SYSTEM SHALL BE ADDRESSABLE, 24VDC, POWER LIMITED, FULLY SUPERVISED, WITH 60 HOUR STANDBY BATTERY. ADEMCO 5110 XM, WITH CENTRAL STATION COMMUNICATOR
- DESIGN AND INSTALL A COMPLETE ADDRESSABLE FIRE ALARM SYSTEM IN ACCORDANCE WITH NFPA 72, 2010 EDITION AND ALL APPLICABLE STATE AND LOCAL CODES AND ORDINANCES. PLANS INDICATE MINIMUM DEVICES.
- ALL POWER SUPPLY OUTPUTS, INTELLIGENT LOOPS AND SIGNAL CIRCUITS SHALL BE LOADED TO A MAXIMUM OF 75% OF CAPACITY TO ALLOW FOR FUTURE CHANGES AND EXPANSION.
- PROVIDE ALARM MONITORING SERVICE FOR ALARMS, SYSTEM TROUBLE, SUPERVISORY CONDITIONS AND WATER FLOW.
- FIRE ALARM SYSTEM SHALL HAVE 60 HOUR STANDBY BATTERY.

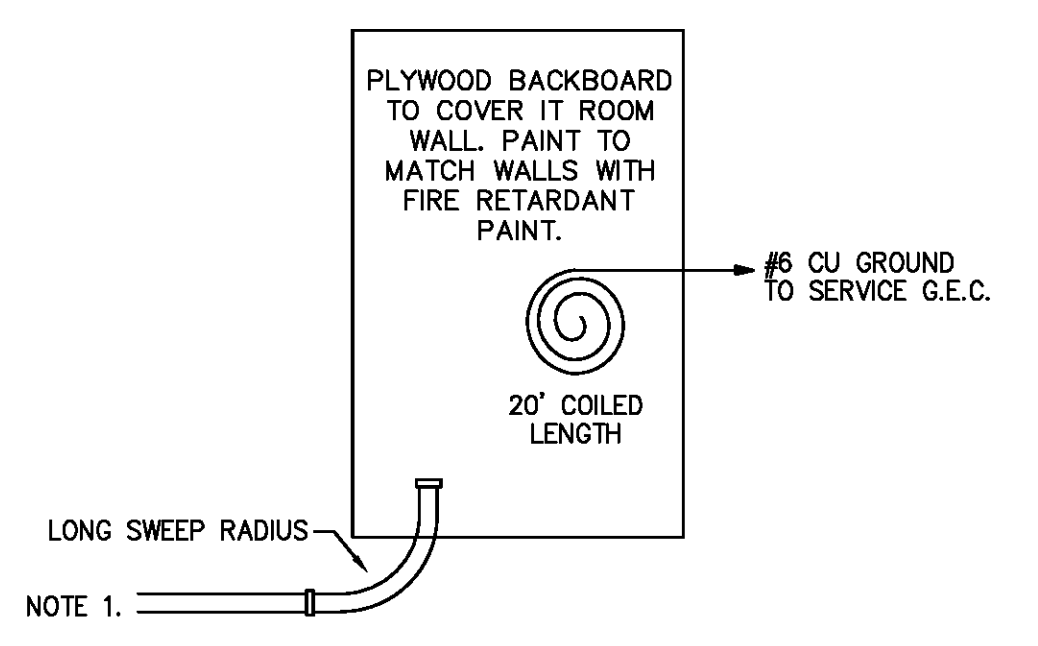

TELEPHONE RISER NOTES:

- (2) 4" TO BUILDING TELEPHONE SERVICE ENTRANCE. COORDINATE WITH TELEPHONE UTILITY.
- PROVIDE INSULATING BUSHING ON ENDS OF ALL CONDUITS.
- PROVIDE SEPARATE 3/4" C STUBBED ABOVE CEILING WITH INSULATING BUSHING FOR EACH COMBINATION TELEPHONE/DATA OUTLET.

2 TELEPHONE RISER DIAGRAM - CLUBHOUSE
SCALE: NOT TO SCALE

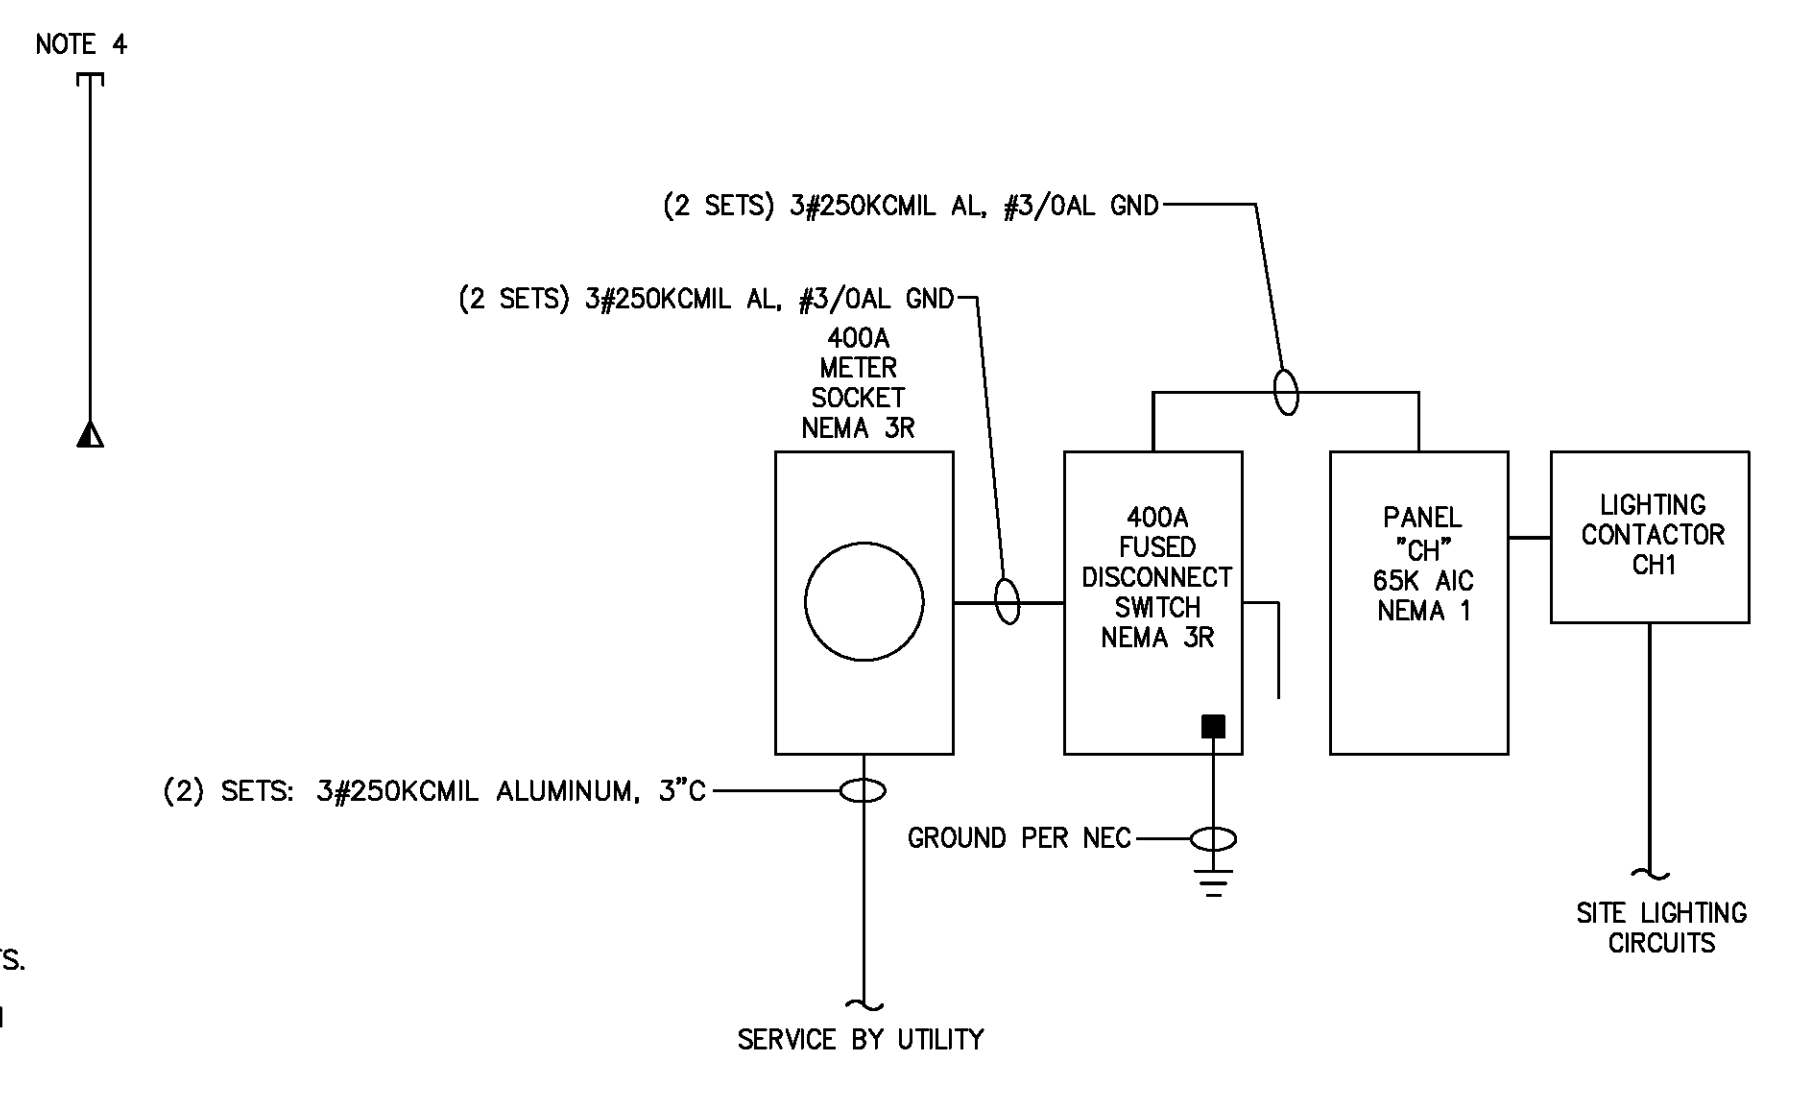

1 ELECTRICAL RISER DIAGRAM - CLUBHOUSE
SCALE: NOT TO SCALE