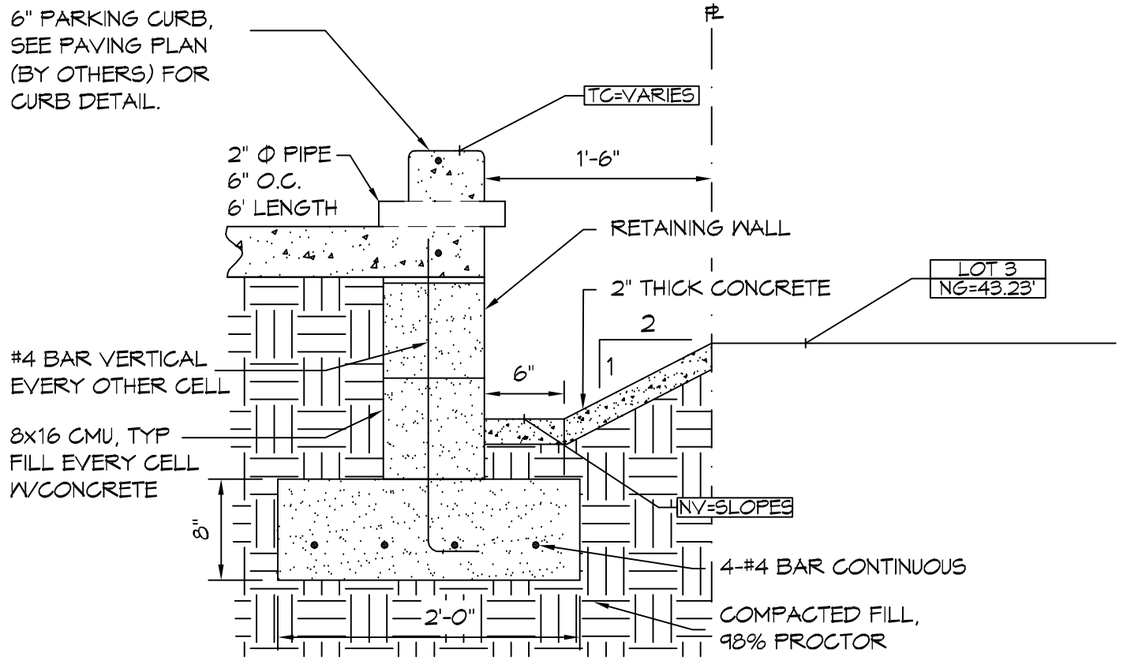

NOTES:
1. SLOPE INVERT .4% TO .5% TOWARD DRAINAGE DITCH.
2. CONCRETE MIX SHALL OBTAIN A MINIMUM STRENGTH OF 3,000 PSI IN 30 DAYS.
3. CONTRACTOR OR OWNER SHALL OBTAIN WRITTEN PERMISSION FROM THE OWNER OF LOT 3 PRIOR TO PLACING PERSONNEL OR MATERIALS ON LOT 3.

STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
4/2/2020
PROFESSIONAL ENGINEER

A SECTION THROUGH DRAINAGE SWELL

SCALE: 1"=1'-0"

DAMMON ENGINEERING, INC.
554 Old Spanish Trail Slidell, LA 70458 (985) 649-5832
dammonengineering.com
info@dammonengineering.com
PHONE: 985-649-5832
CHIEF ENGINEER: BRIAN A. MISTICH, P.E.
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

DRAINAGE ANALYSIS FOR THE
EL PASO MEXICAN RESTAURANT
200 WEST GLORIA SWITCH ROAD
CARENCRO, LA 70520

JOB No:	DATE:	CHECKED BY:
2269	4/2/2020	BAM
DRAWN BY:		
DD		

C1.4.1