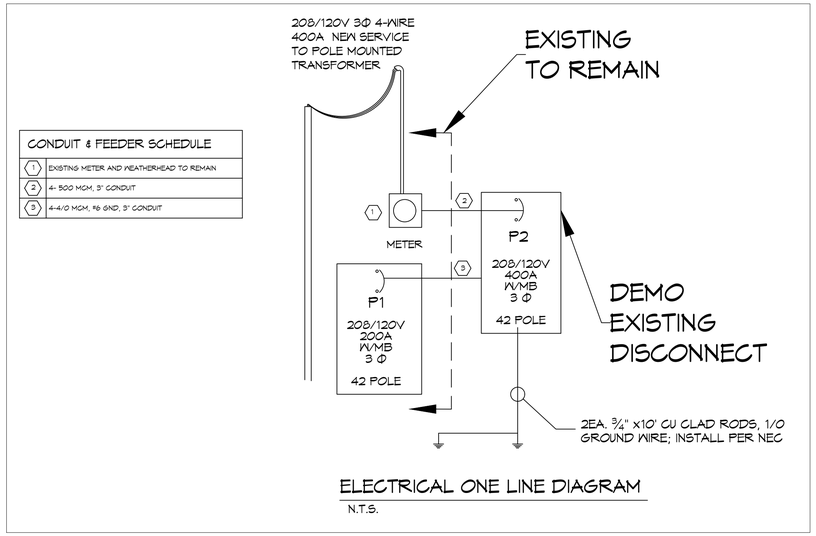

RISER DIAGRAM

SCALE: NTS

PANEL SCHEDULE

PANEL: P1 (EXISTING)
LOCATION: OUTSIDE NEAR SERVICE
FEEDER SOURCE: CLECO

VOLTAGE: 120/240V, 200A, 3Φ, 4W W/200A MB
ENCLOSURE: EXISTING 3Φ PANEL USED AS 1Φ SURFACE MOUNTED

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION LOCATION	BREAKER AMP	BREAKER POLE	LOAD (VA)	AΦ BΦ CΦ	LOAD (VA)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION LOCATION	THHN WIRE SIZE	CKT NO
1	-	LIGHTS & OUTLETS (DBL BREAKER EACH 20AMP)		1	1.6		1.6	1		UPSTAIRS LIGHTS & OUTLETS (DBL BREAKER EACH 20AMP)	-	2
3	-	CU #1	50	2	3.9		10.0	2	100	AHU #1	-	4
5					3.9		10.0					6
7												8
9										BLANK		10
11												12
13	-	CU #3	50	2	3.9		10.0	2	100	AHU #3	-	14
15					3.9		10.0					16
17	-	AHU #2	60	2	6.4							18
19					6.4							20
21										BLANK		22
23	-	CU #2	30	2	2.2		1.2	1	20	UPSTAIRS HEATER	-	24
25					2.2		1.2	1	20	UPSTAIRS BATH	-	26
27		BLANK								BLANK		28
29	-	KITCHEN AND DINING RM LIGHTS (DBL BREAKER 20 AMPS)	20	1	1.6		1.6	1	20	PATIO AND MAIN DINING LIGHTS (DBL BREAKER EACH 20AMP)	-	30
31	-	SPARE	20	1	-		-	1	20	SPARE	-	32
33		BLANK								BLANK		34
35	-	SPARE	20	1	-		-	1	20	SPARE	-	36
37	-	SPARE	20	1	-		-	1	20	SPARE	-	38
39		BLANK								BLANK		40
41	-	SPARE	20	1	-		-	1	20	SPARE	-	42

SOLID NEUTRAL NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 81.6

AΦ = 26.9 BΦ = 27.8 CΦ = 26.9

GROUND BUS GROUND WIRE (G)

PANEL SCHEDULE

PANEL: P2
LOCATION: OUTSIDE NEAR SERVICE
FEEDER SOURCE: CLECO

VOLTAGE: 120/240V, 400A, 3Φ, 4W W/400A MB
ENCLOSURE: SURFACE MOUNTED W/ EQUIPMENT GND BAR SQ D TYPE QO LOAD CENTER, 22K AIC

CKT NO	THHN WIRE SIZE	LOAD DESCRIPTION LOCATION	BREAKER AMP	BREAKER POLE	LOAD (VA)	AΦ BΦ CΦ	LOAD (VA)	BREAKER POLE	BREAKER AMP	LOAD DESCRIPTION LOCATION	THHN WIRE SIZE	CKT NO
1	-	COOLER CONDENSER FAN & LIGHTS #17	20	1	1.5		1.7	2	30	COOLER REMOTE COMPRESSOR #17	-	2
3	-	FREEZER CONDENSER, DEFROST & LIGHTS #17	20	2	1.1		1.7					4
5					1.1		2.4	2	20	FREEZER REMOTE COMPRESSOR #17	-	6
7	-	DISHWASHER, #6	20	1	1.4		2.4					8
9	-	REACH IN COOLER, #7	15	1	0.4		0.7	1	15	REACH IN FREEZER, #8	-	10
11	-	BAR DISHWASHER, #10	35	2	3.0		0.4	1	15	REACH IN, #14	-	12
13					3.0		1.0	1	15	HOOD SYSTEM CONTROL PANEL, #15	-	14
15	-	HOOD SYSTEM EXHAUST FAN, #15	35	1	2.3		1.4	1	15	HOOD SYSTEM SUPPLY FAN, #15	-	16
17	-	REACH IN COOLER, #7	15	1	0.4		0.8	1	15	PREP TBL, #16	-	18
19	-	PIZZA OVEN, #20	40	2	3.1		1.1	1	15	ICE MACHINE	-	20
21					3.1		3.1	2	30	AHU #4, 4.5 KW HEAT	-	22
23	-	CU #4, 4 TON HEAT PUMP	30	2	2.9		3.1					24
25					2.9		-	1	20	SPARE	-	26
27	-	SPARE	20	1	-		6.2	2	30	HOT WATER HEATER	-	28
29	-	SPARE	20	1	-		6.2					30
31												32
33												34
35												36
37					26.9							38
39	4/0	SUB PANEL	200	3	27.8							40
41					26.9							42

SOLID NEUTRAL NEUTRAL WIRE (N)

TOTAL CONNECTED LOAD (kva) = 140.0

AΦ = 45.0 BΦ = 47.8 CΦ = 47.2

GROUND BUS GROUND WIRE (G)

NOTE: ON PANEL P-1, MOVE EXISTING CB TO LOCATION SHOWN TO BALANCE THE LOADS.

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
Ph: 985.649.5921
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

REVISIONS

#	DESCRIPTION	DATE

SEAL:

STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
5/16/2024
PROFESSIONAL ENGINEER

RESTAURANT
CAMELLIA POINT
2980 PONTCHARTRAIN DRIVE
SLIDELL, LA 70458

JOB No: 2464 DATE: 05/06/2024
DRAWN BY: GCD CHECKED BY: BAM

THE WORK SHOWN ON THESE DRAWINGS AND SPECIFICATIONS, INCLUDING ANY ARCHITECTURAL DESIGN, ARRANGEMENT, DETAILS AND/OR SPECIFICATIONS, IS THE PROPERTY OF DAMMON ENGINEERING, INC. AND IS NOT TO BE USED IN WHOLE OR IN PART FOR ANY OTHER PROJECT WITHOUT THE WRITTEN AUTHORIZATION OF DAMMON ENGINEERING, INC. THEY ARE NOT TO BE LOANED, COPIED OR DISCLOSED TO ANY UNAUTHORIZED PERSON UNDER ANY CIRCUMSTANCES WITHOUT THE PRIOR WRITTEN CONSENT OF DAMMON ENGINEERING, INC. VISUAL CONTACT WITH THESE DRAWINGS AND SPECIFICATIONS SHALL CONSTITUTE PRIMA FACIE EVIDENCE OF THE ACCEPTANCE OF THESE RESTRICTIONS.

SHEET TITLE:
POWER PANEL AND ONE LINE DIAGRAM

DRAWING NUMBER:
E104

SHEET No: 4 of 7

C:\E_WORK_J\1_+ BISTRO\MAIN\Cornelio Brisol\Drawings\Current Drawings\E104 - Panel Schedule and One Line.dwg, E104 DATE & INIT., Thursday, May 16, 2024 2:49:47 PM