

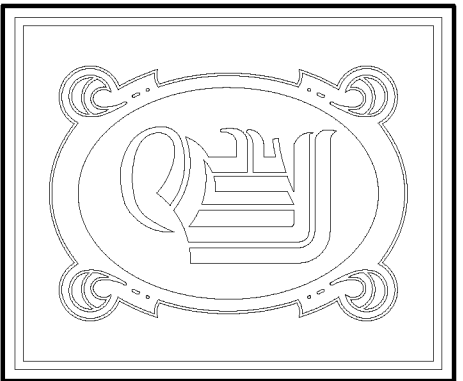
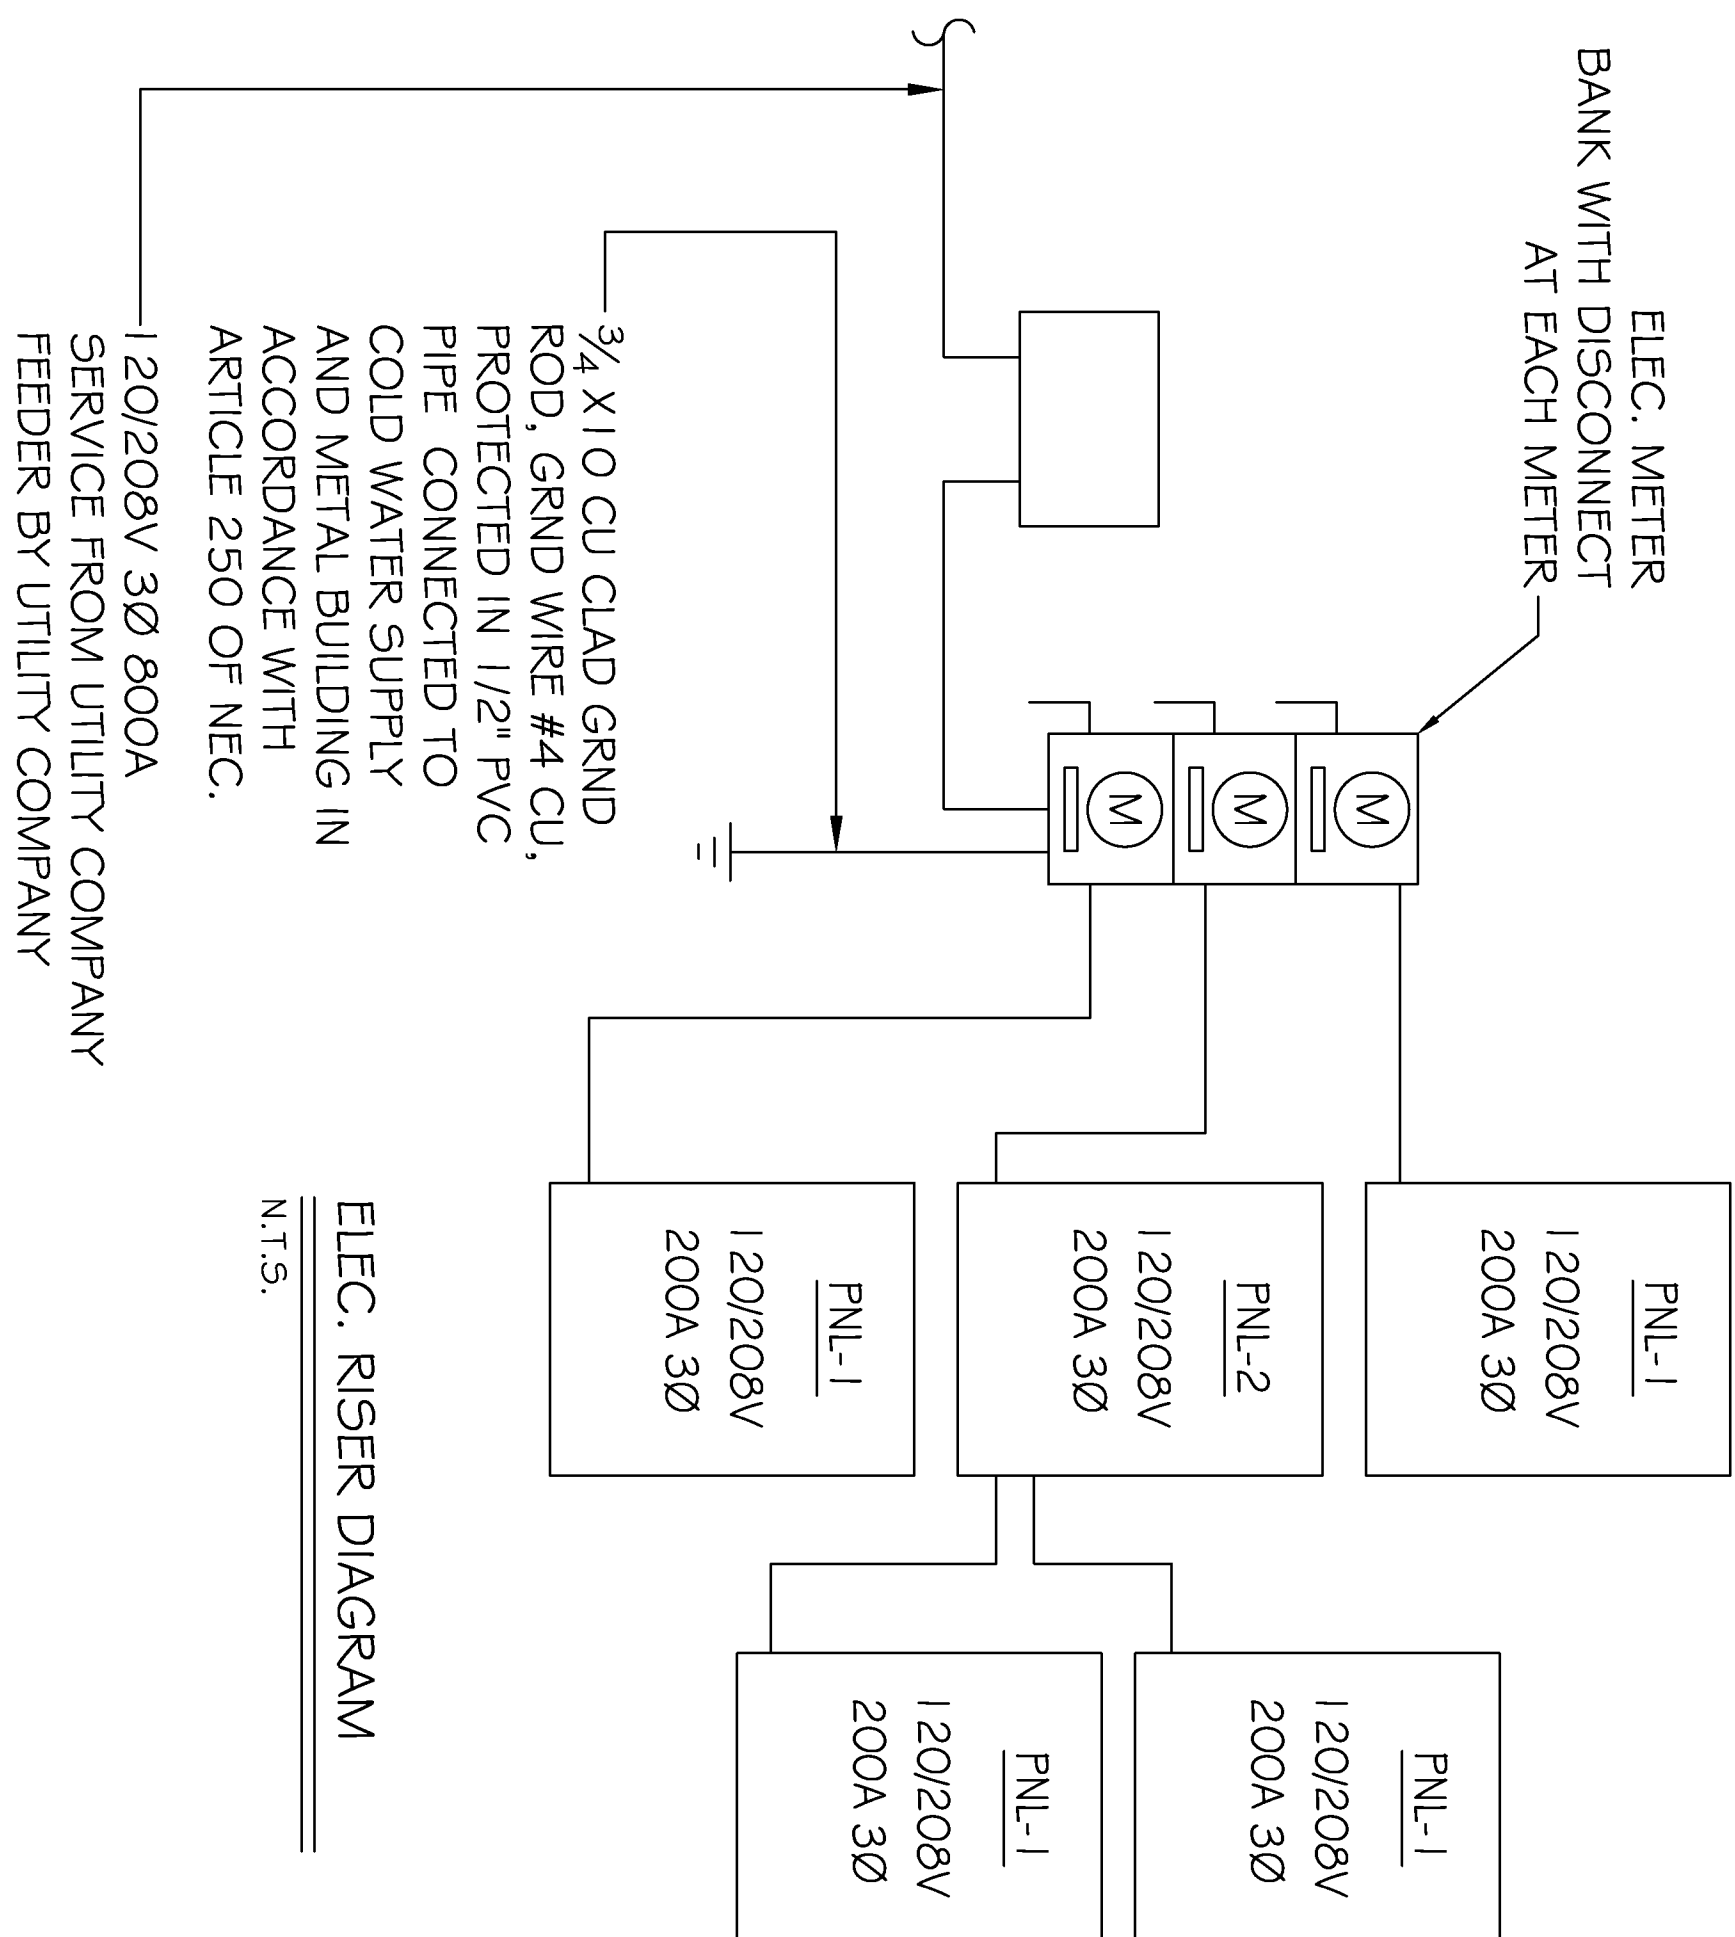
PHYSICAL THERAPY

PANEL: PNL-1										VOLTAGE: 120/208V, 200A 3Ø, 4W									
LOCATION: ROOM #1119										ENCLOSURE: RECESSED W/OUT DOOR BAR									
FEEDER SOURCE: CLECO										W/ALARM BELL AND LOAD CENTER, 20000 AIC									
DISC NO.	TRIP SIZE	LOAD DESCRIPTION	BREAKER AMP	HOLE	LOAD (VA)	AFCI			BREAKER	LOAD (VA)	AFCI			TRIP SIZE	DISC NO.				
		LOCATION				10A	15A	20A			10A	15A	20A						
1		A/C #1 COMPRESSOR UNIT	60	2	21.64				3605						2				
10		5 TON			21.64				3605										
3		WATER HEATER			11600				3605						4				
5		20 GAL	30	2	1600				2000						5				
7									2000						6				
9		TOLLET ROOM OUTLET	20	1	1600				2000						7				
11		OUTLETS	20	1	1600										8				
13		LIGHTING	20	1	1600				1600						9				
15		SHAVE	20	1	1600				1600						10				
17		ENTRANCE SIGNAGE	20	1	1000										11				
19		BLANK	-	-											12				
21		BLANK	-	-											13				
23		BLANK	-	-											14				
25		BLANK	-	-											15				
27		BLANK	-	-											16				
29		BLANK	-	-											17				
					TOTAL CONNECTED LOAD (VA)														
					40W	13629	50W	13629	100W	10000						GROUND WIRE #15			
															GROUND WIRE 60				

ATHLETIC CLUB

[illegible]

SMOOTHIE STORE

[illegible]

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

554 OLD SPANISH TRAIL
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

INVESTIGATION
EXPERT WITNESS

SLIDELL
ATHLETIC
CLUB