STRUCTURAL STEEL FRAMING

SEE SHEET A-102 FOR ALL STRUCTURAL STEEL FRAMING.

GENERAL FOUNDATION NOTES

1. CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4000 PSI AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-318.
2. ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
3. ALL REINFORCING STEEL AND MESH SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
4. THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, DIMENSIONS AND CONFIGURATIONS.
5. GRADE BEAM DIMENSIONS MAY VARY BY -5%, +20%.
6. EXCAVATE FOUR FOOT DEPTH WHERE NEW FOOTINGS ARE LOCATED.
7. FILL, AS A MINIMUM QUALITY, SHALL BE 40% CLAY AND 60% SAND MIXTURE, PLACED IN 6" LIFTS AND COMPACTED TO A MINIMUM OF 95% STANDARD PROCTOR. FOOTINGS ARE DESIGNED TO USE SOIL WITH A BEARING PRESSURE OF 2000 LBS. PER SQUARE FOOT OR MORE. IT IS RECOMMENDED THAT THE CONTRACTOR VERIFY ALLOWABLE SOIL BEARING PRESSURE CAPACITY BY CONTRACTING THE SERVICES OF A SOILS ENGINEERING COMPANY.

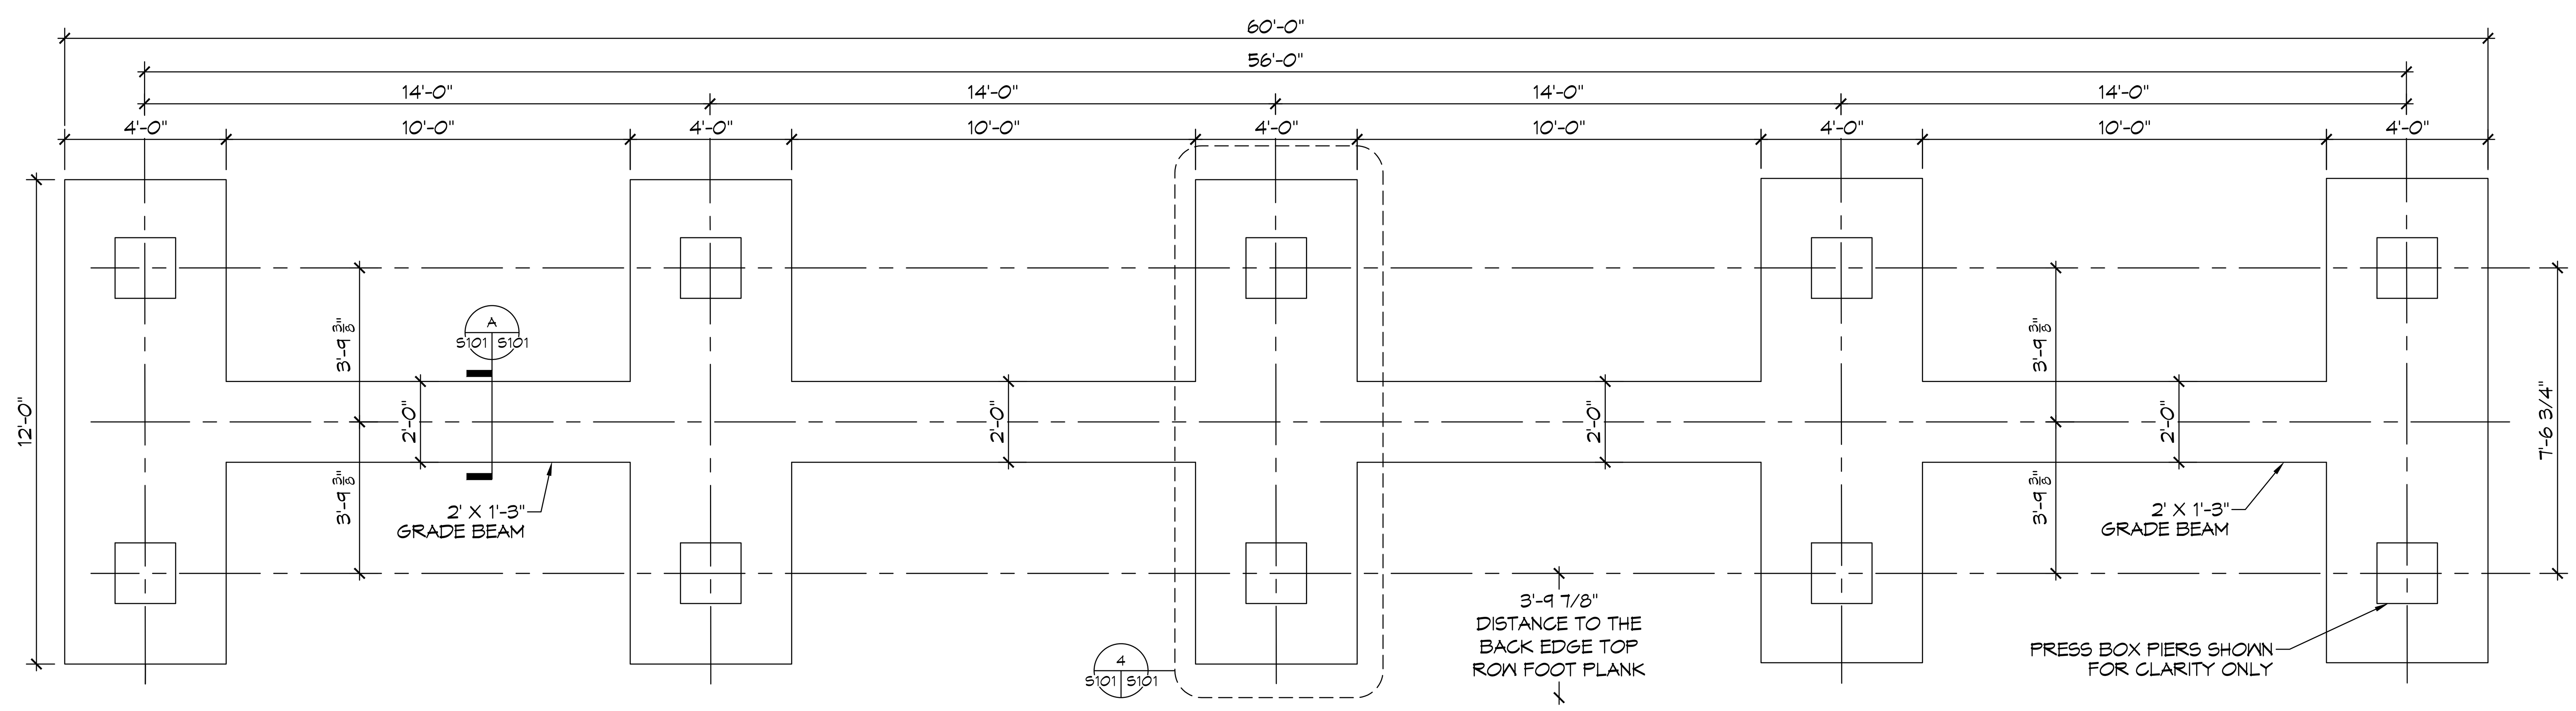

3 FOUNDATION PLAN
SCALE: 3/8" = 1'-0"

PRES BOX FOUNDATION

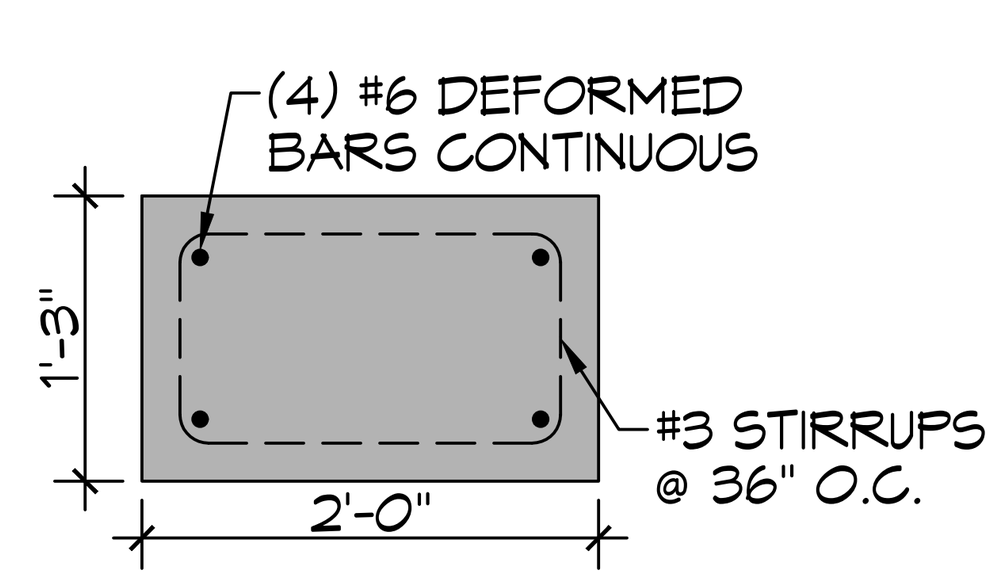

A FOUNDATION DETAIL
S101 S101
SCALE: 3/4" = 1'-0"

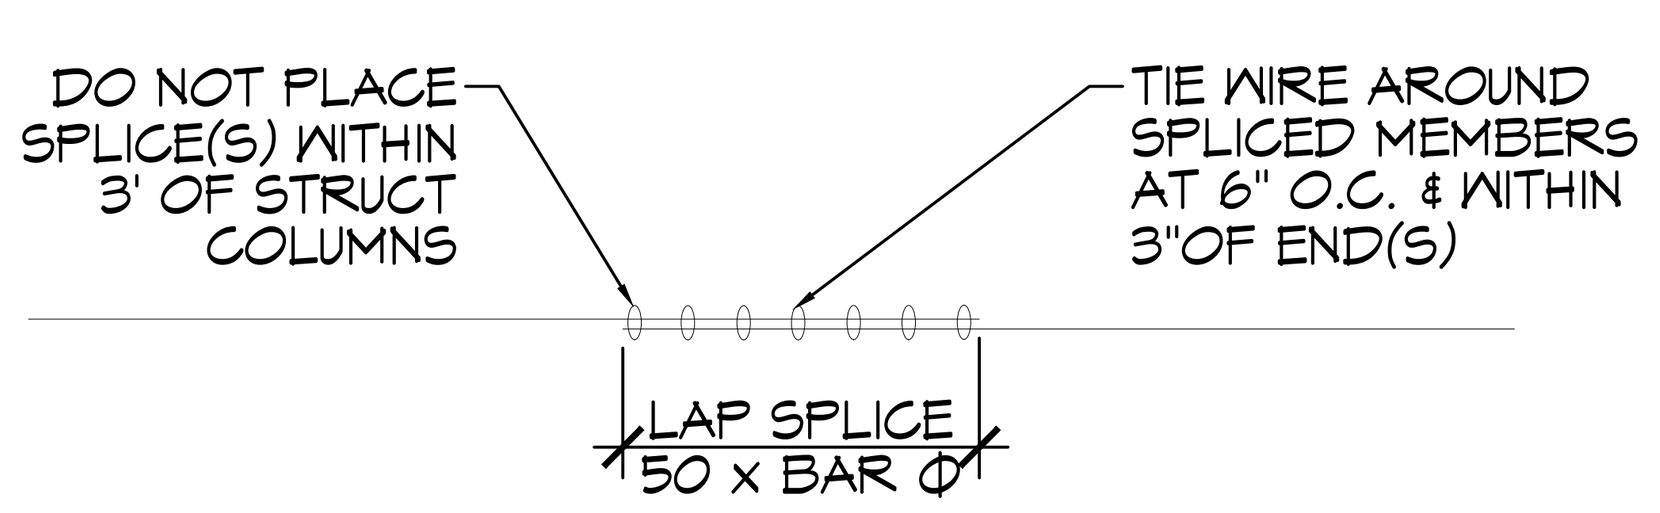

REBAR SPLICE
SCALE: 1/2" = 1'-0"

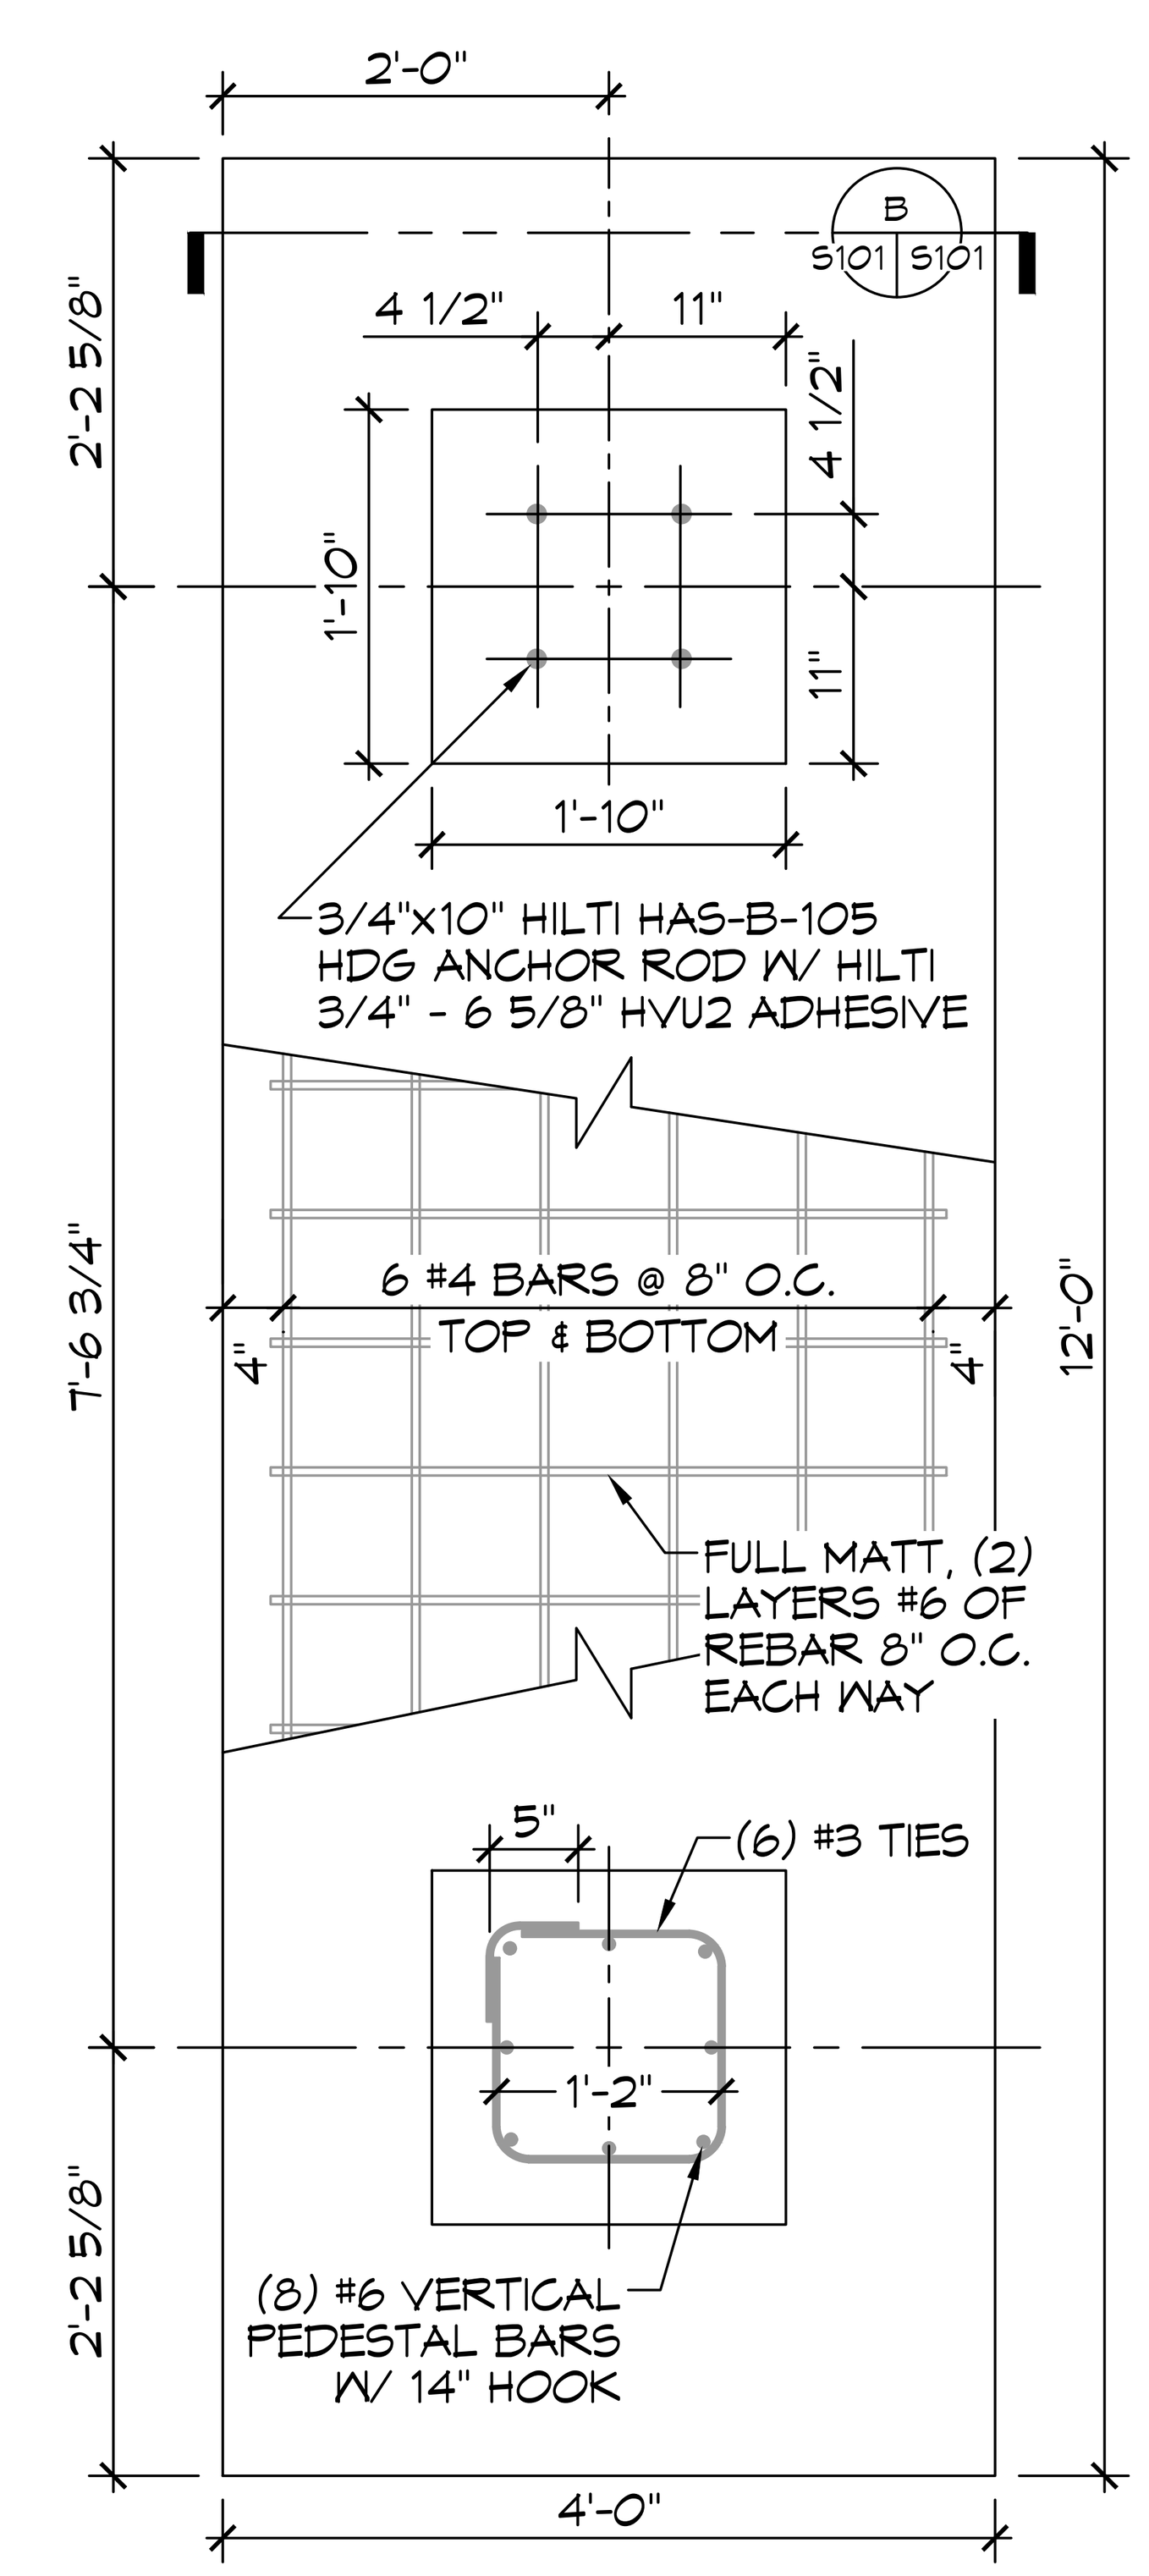

4 FOUNDATION DETAIL
S101 S101
SCALE: 3/4" = 1'-0"

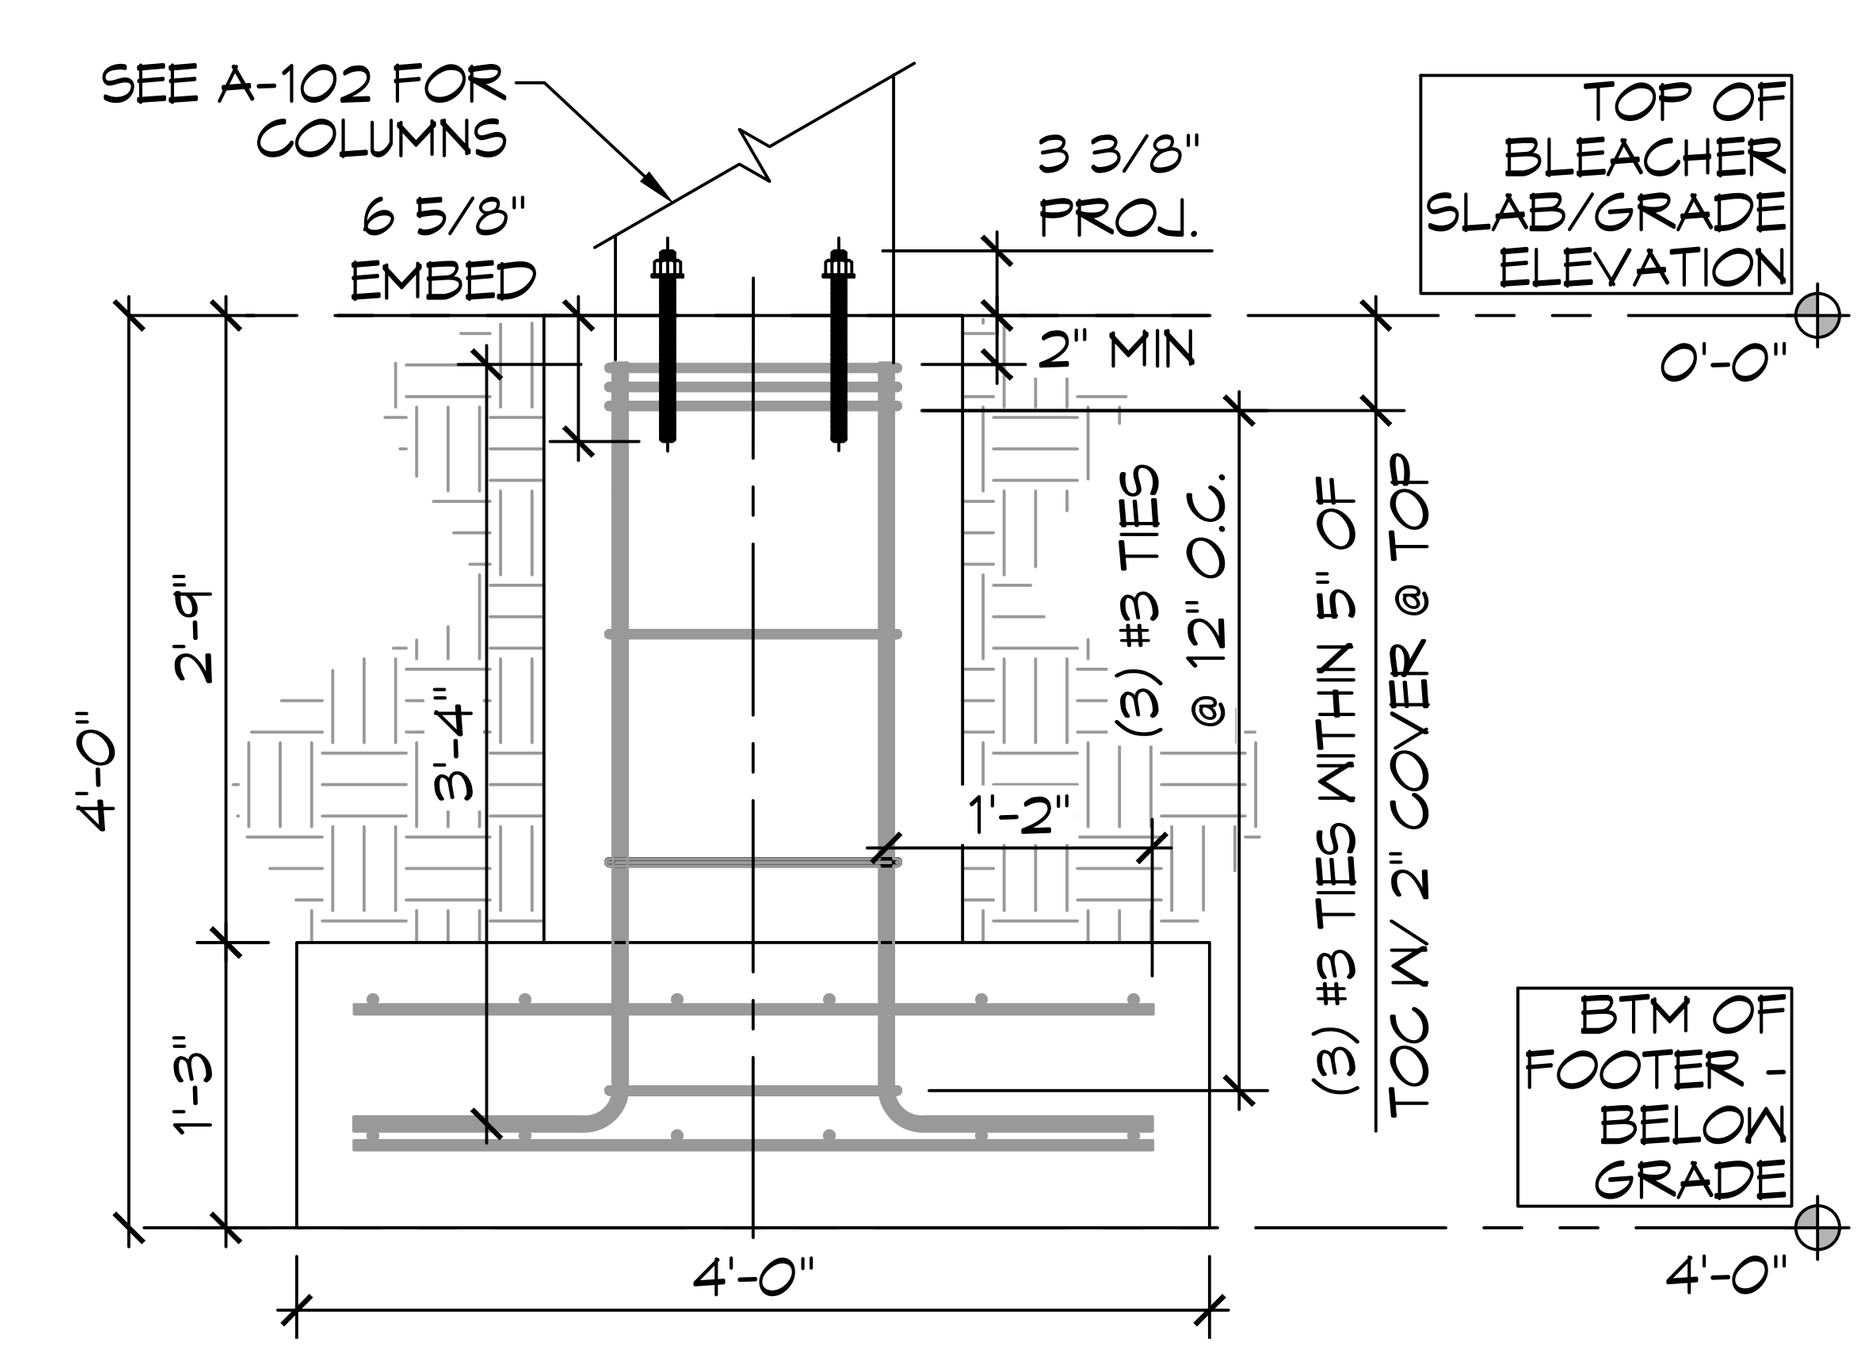

B FOUNDATION SECTION
S101 S101
SCALE: 3/4" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

REVISIONS

#	DESCRIPTION	DATE

SEAL:

STATE OF LOUISIANA
BRIAN A. MISTICH
License No. 30187
8/12/2022
PROFESSIONAL ENGINEER

NEW PRESS BOX
SALMEN HIGH SCHOOL
300 SPARTAN DRIVE
SLIDELL, LA. 70458

JOB No:	2458	DATE:	07-14-2022
DRAWN BY:	TNT	CHECKED BY:	BAM

The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which they have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
FOUNDATION PLAN & DETAILS

DRAWING NUMBER:
S101

SHEET No: 4 of 7