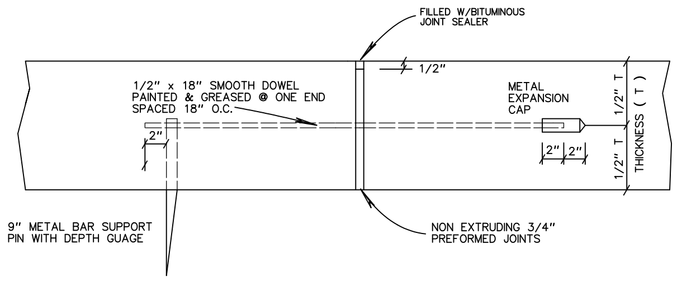

TRANSVERSE EXPANSION JOINT

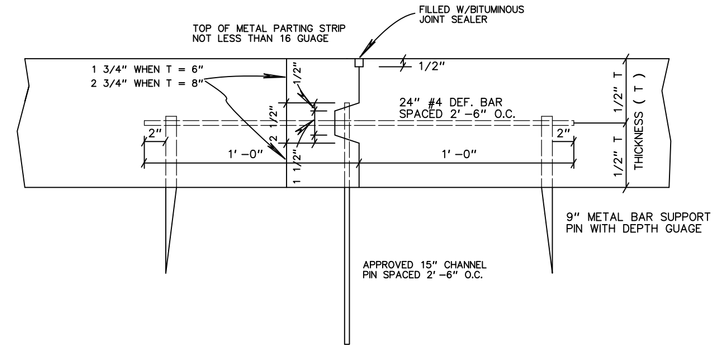

DEFORMED LONGITUDINAL JOINT

CONCRETE PAVEMENT NOTES:

1. UNLESS OTHERWISE SHOWN ALL PAVEMENTS SHALL BE A MINIMUM OF 9" THICK.
2. CONCRETE SHALL BE 4000 PSI MINIMUM OF 28 DAYS. MIX DESIGN CONTROL AND TESTING IN ACCORDANCE WITH SPECIFICATIONS. MINIMUM 5.75 SACKS OF CEMENT PER CUBIC YARD; 6.5 FOR UTILITY CUTS.
3. IF CONCRETE TEMPERATURES MEASURED AT THIS POINT OF DISCHARGE EXCEED 85 DEGREES FAHRENHEIT AT THE TIME OF PLACEMENT A WATER REDUCING RETARDING ADMIXTURE A.S.T.M. CR94 TYPE D SHALL BE DESIGNED INTO MIX.
4. IF CONCRETE TEMPERATURES ARE 95 DEGREES FAHRENHEIT OR HIGHER AT TIME OF PLACEMENT OR IF CONCRETE IS NOT DEPOSITED WITHIN 1 1/2 HOURS AFTER THE INITIAL INTRODUCTION OF THE MIXING WATER SHALL BE REJECTED AND NOT USED.
5. EXACT BASE DESIGN TO BE PROVIDED FROM SOIL INVESTIGATION REPORT OR INSTRUCTED BY THE ENGINEER.
6. A RECOGNIZED TESTING LAB SHALL BE PROVIDED FOR REQUIRED TESTING.
7. SPLIT SLAB CONSTRUCTION ONLY WITH WRITTEN APPROVAL OF THE ENGINEER.
8. PAVEMENT SHALL NOT BE OPEN TO TRAFFIC UNTIL 21 DAYS AFTER PLACEMENT WITHOUT THE APPROVAL OF THE ENGINEER.
9. ALL MANHOLES IN PAVEMENT SHALL BE BOXED-OUT.
10. JOINT SEALER SHALL BE PVC EXTENDED COAL TAR MEETING ALL OF THE REQUIREMENTS OF THE DOTD STANDARD SPECIFICATIONS (LATEST EDITION) AND ALL MANUFACTURERS SPECIFICATIONS FOR APPLICATION. JOINTS SHALL BE WIRED BRUSHED AND BLOWN PRIOR TO APPLICATION.
11. THE LOCATION ON THE PLANS OF EXISTING UTILITIES ARE APPROXIMATE AND MAY NOT REPRESENT ALL EXISTING UTILITIES. THEREFORE, THE CONTRACTOR SHALL CAREFULLY VERIFY THE LOCATIONS AND TAKE WHATEVER PRECAUTIONS NECESSARY TO AVOID DAMAGE TO THESE EXISTING AND ANY OTHER EXISTING UTILITIES. THE CONTRACTOR IS TO CONTACT "DOTTIE" OR ALL APPROPRIATE UTILITY COMPANIES TO MARK THESE LINES.

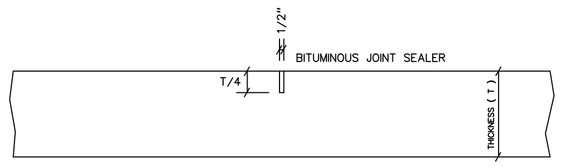

TRANSVERSE DUMMY JOINT

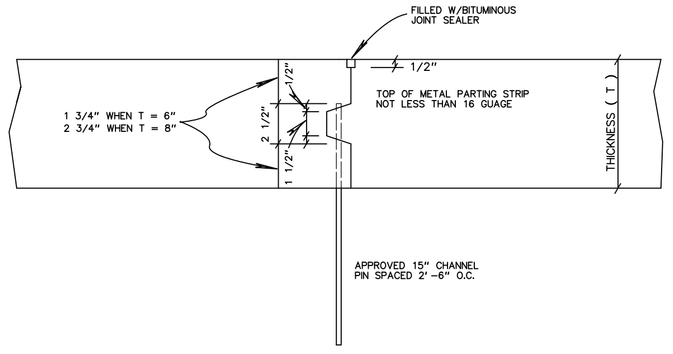

CONSTRUCTION JOINT

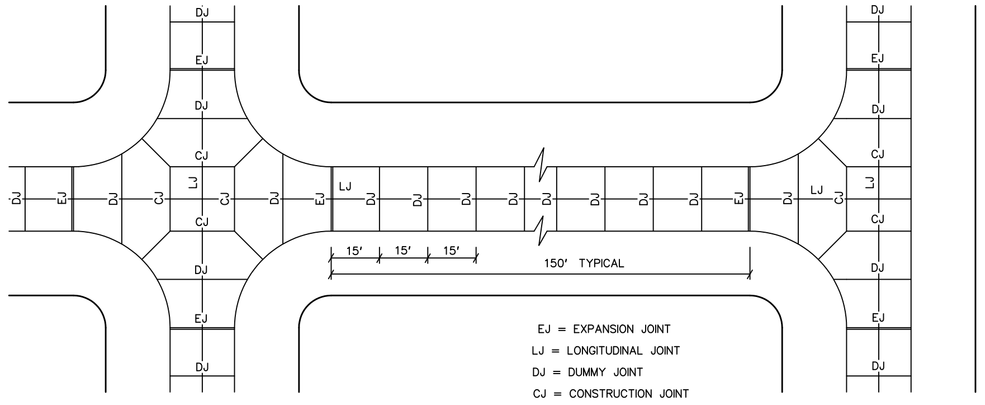

TYPICAL JOINT SPACING

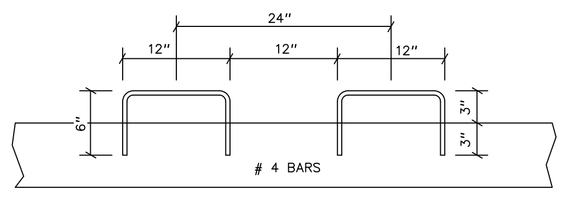

CURB DOWEL DETAIL

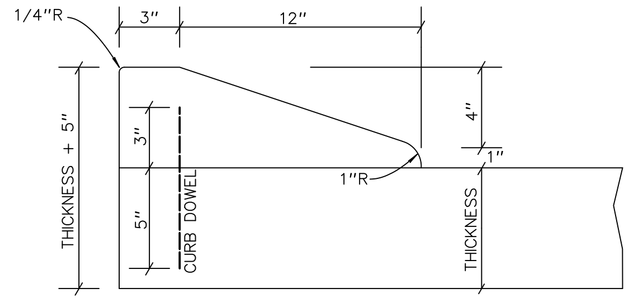

ROLLOVER CURB DETAIL

STANDARD CONCRETE PAVING DETAILS

KELLY McHUGH & ASSOCIATES, INC.
CIVIL ENGINEERS & LAND SURVEYORS
845 GALVEZ ST., MANDEVILLE, LA.
PHONE 985-626-5611 FAX 985-626-5033

SCALE: VARIES | DATE: 12-21-09
DRAWN: DRJ | JOB NO.: 08-194

RIVERVIEW
APARTMENTS IN ST. BERNARD PARISH, LOUISIANA for
PROVIDENT REALTY ADVISORS

OWENS ARCHITECTS, INC.
BEELER GUEST
4545 N. CENTRAL EXPRESSWAY SUITE 300 DALLAS, TEXAS 75205 (214) 520-8878

DATE
01-30-09

PROJECT
08192

SHEET NUMBER
C.2B

COPYRIGHT © Beeler Guest Owens Architects, Inc. ALL RIGHTS RESERVED