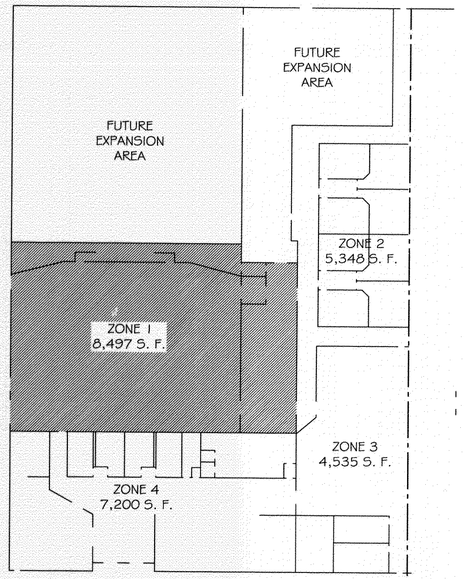

ELECTRICAL KEY PLAN

N. T. S.

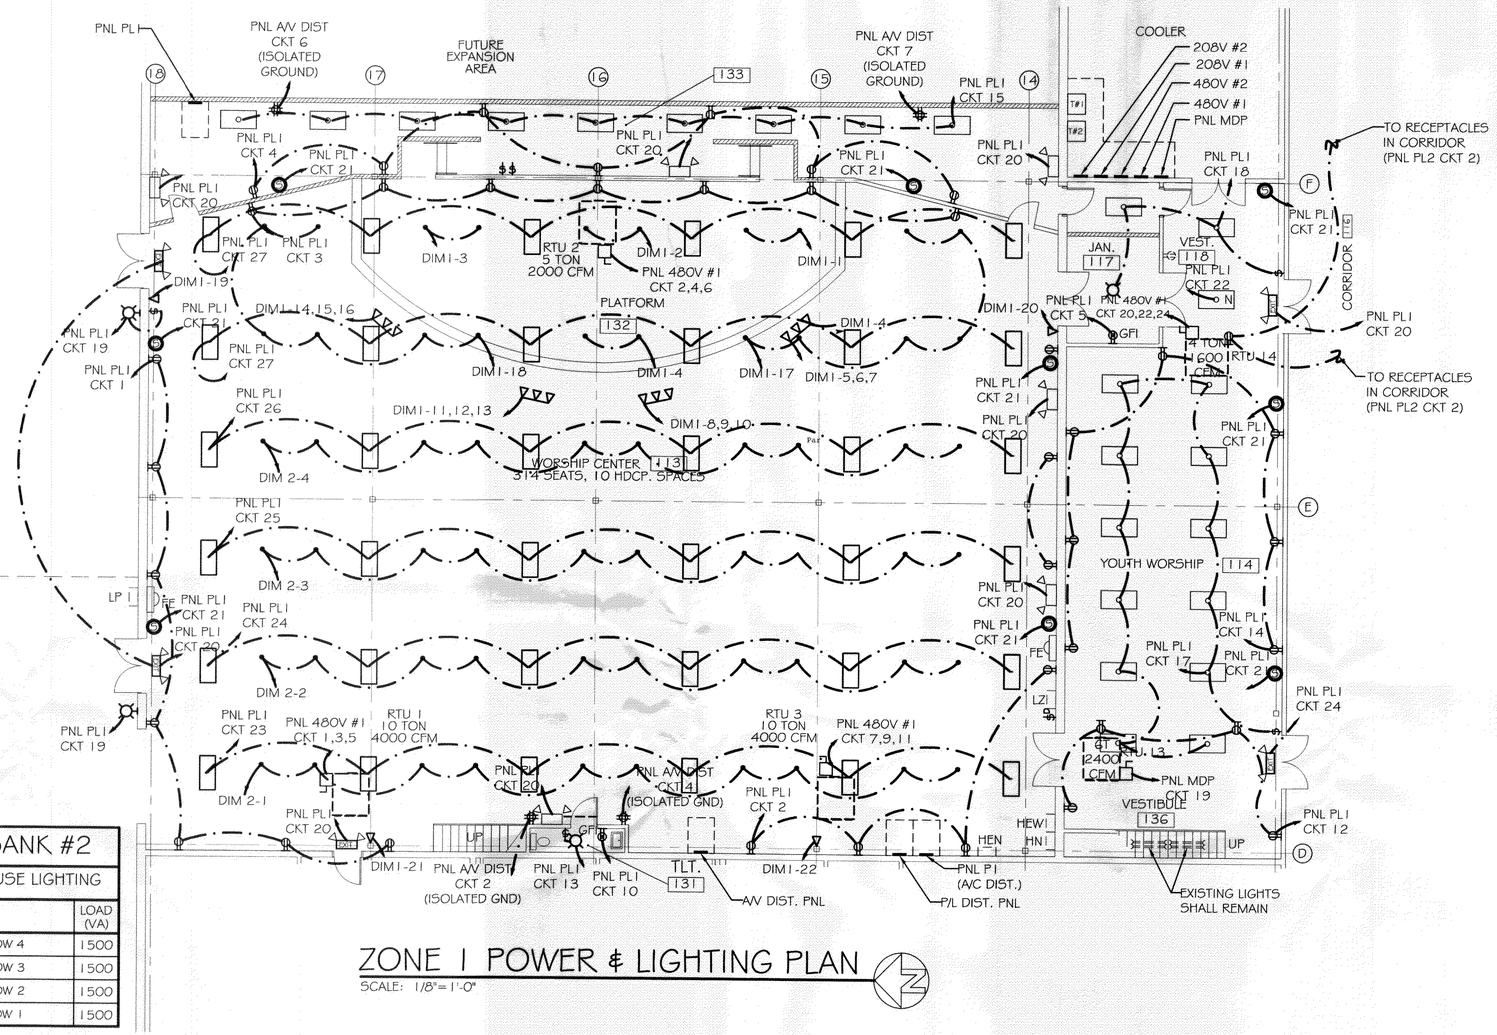

ZONE 1 POWER & LIGHTING PLAN

SCALE: 1/8"=1'-0"

DIMMER BANK #1

CKT. NO	AREA	LOAD (VA)	CONTROLLER
1	PAR 38 STAGE LEFT, INNER	300	1
2	PAR 38 STAGE CENTER, REAR	300	
3	PAR 38 STAGE RIGHT, INNER	300	
4	PAR 38 STAGE CENTER, FRONT	300	
5	STAGE TRACK LIGHT #1-1	150	
6	STAGE TRACK LIGHT #1-2	150	
7	STAGE TRACK LIGHT #1-3	150	
8	STAGE TRACK LIGHT #2-1	150	
9	STAGE TRACK LIGHT #2-2	150	
10	STAGE TRACK LIGHT #2-3	150	
11	STAGE TRACK LIGHT #3-1	150	
12	STAGE TRACK LIGHT #3-2	150	
13	STAGE TRACK LIGHT #3-3	150	
14	STAGE TRACK LIGHT #4-1	150	
15	STAGE TRACK LIGHT #4-2	150	
16	STAGE TRACK LIGHT #4-3	150	
17	PAR 38 STAGE LEFT, OUT	900	
18	PAR 38 STAGE RIGHT, OUT	900	
19	LEFT WALL FRONT	200	
20	RIGHT WALL FRONT	200	
21	LEFT WALL REAR	200	
22	RIGHT WALL REAR	200	
23			
24			
	TOTAL =	3000	

5600W = 15.5A @ 120/208V-3Ø-4W

DIMMER BANK #2

INDIVIDUAL HOUSE LIGHTING

CKT. NO	AREA	LOAD (VA)
1	PAR 38 150W, ROW 4	1500
2	PAR 38 150W, ROW 3	1500
3	PAR 38 150W, ROW 2	1500
4	PAR 38 150W, ROW 1	1500

NOTE:
FIRE ALARM SYSTEM SHALL BE INSTALLED BY A CERTIFIED FIRE ALARM COMPANY.

LEGEND

- -EXISTING DUPLEX OUTLET
- GFI -EXISTING DUPLEX GFI OUTLET
- W/P GFI -EXISTING DUPLEX WEATHERPROOF GFI OUTLET
- -EXISTING QUAD OUTLET
- 208V -EXISTING 208V OUTLET
- 208V W/P -EXISTING WEATHERPROOF 208V OUTLET
- -EXISTING DISCONNECT
- HEN -EXISTING POWER, LIGHTING PANEL
- -EXISTING SWITCH
- -EXISTING 3 WAY SWITCH
- -EXISTING 2 X 4 FLUORESCENT FIXTURE
- -EXISTING 2 BULB FLUORESCENT FIXTURE
- -EXISTING 2 X 4 FLUORESCENT FIXTURE
- -EXISTING EXIT/ EMERGENCY LIGHT
- -EXISTING HALIDE LIGHT
- -EXISTING HPS FIXTURE
- -EXISTING TELEPHONE/ DATA OUTLET
- -DUPLEX OUTLET
- GFI -DUPLEX GFI OUTLET
- W/P GFI -DUPLEX WEATHERPROOF GFI OUTLET
- -QUAD OUTLET
- 208V -208V OUTLET
- -FUSED DISCONNECT
- PNL P1 -POWER, LIGHTING PANEL
- -SWITCH
- -DIMMER SWITCH
- -3 WAY SWITCH
- -2 X 4 FLUORESCENT FIXTURE ("N" INDICATES NIGHT LIGHT- ALWAYS ON)
- -CEILING MOUNTED FIXTURE
- -EXTERIOR WALL SCONCE FIXTURE W/ 90 MIN. BATTERY BACKUP
- -PENDANT LIGHT
- -TRACK LIGHTING
- -REVERSIBLE CEILING FAN (REVERSIBLE @ WALL SWITCH)
- -EXTERIOR WALL SCONCE FIXTURE W. 90 MIN. BACKUP
- EXIT -EXIT LIGHT W/ 90 MIN. BACKUP (ARROW INDICATES DIRECTIONAL EXIT SIGN)
- EXIT -EXIT/ EMERGENCY LIGHT W/ 90 MIN. BACKUP (ARROW INDICATES DIRECTIONAL EXIT SIGN)
- -EMERGENCY LIGHT W/ 90 MIN. BACKUP
- -CABLE TV OUTLET
- -TELEPHONE OUTLET
- -SMOKE DETECTOR
- -VENT
- FE -FIRE EXTINGUISHER AND CABINET- 10 LB. MULTI-USE

367234
REVIEWED FOR STATE FIRE MARSHAL AS PER REVIEW LETTER
BY: LAWRENCE J. DELAUNE, ARCHITECT, CBO

DAMMON
ENGINEERING, INC.

CHIEF ENGINEER
EMMETT
DAMMON, P.E.

CHIEF ARCHITECT
ROBERT
WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

NORTHSHORE CHURCH
KENSINGTON DR.
SLIDELL, LA

ZONE 1 POWER & LIGHTING PLAN

REV:03-23-09

SCALE: AS NOTED

JOB#: 1988

DATE: 09-30-08

SHEET

E-4

OF