

AREA BY USE:  
 TOTAL AREA: 20,000 SQ.FT.  
 COVERED DRIVEWAY: 1,200 SQ.FT.  
 CHURCH GROSS AREA: 18,800 SQ.FT.

PLUMBING FIXTURE COUNT:  
 PER LA STATE PLUMBING CODE 2000 EDITION  
 OCCUPANT LOAD FOR CHURCH BASED ON NUMBER OF SEATS  
 534 SEATS AVAILABLE  
 MENS TOILETS REQUIRED = 4  
 MENS TOILETS PROVIDED = 8 (5 TOILETS AND 6 URINALS)  
 MENS LAVATORY REQUIRED = 3  
 MENS LAVATORY PROVIDED = 7  
 FEMALE TOILETS REQUIRED = 4  
 FEMALE TOILETS PROVIDED = 11  
 FEMALE LAVATORY REQUIRED = 3  
 FEMALE LAVATORY PROVIDED = 7

FLOOR PLAN  
 SCALE: 1/8" = 1'-0"


DOOR & HARDWARE SCHEDULE						
MARK	SIZE	DOOR TYPE	FRAME	HDWR. NO.	STC	REMARKS
EXTERIOR DOORS						
1	PR. 3/0x7/0	STORE FRONT	TO MATCH DOOR	1	NA	
2	PR. 3/0x7/0	FLUSH GALV. HOL. MET. STEEL INSUL.		1	NA	GALVANIZING TO BE G90 PANIC HARDWARE
INTERIOR DOORS						
3	PR. 3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	PROVIDE 4x36 VISION LITE W/ PANIC HARDWARE
4	3/0x7/0	FLUSH GALV. HOL. MET. STEEL INSUL.	PTD. HOL. MET.	3	NA	PANIC HARDWARE
5	3/0x7/0	STORE FRONT	TO MATCH DOOR	4	NA	W/ SIDELITES, MULLION BAR, TRANSOM LITE ABOVE
6	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA	PROVIDE 4x36 VISION LITE
7	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	4	NA	
8	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	5	NA	
9	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	
10	3/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	2	NA	1 HR. FIRE RATED
11	2/0x7/0	FLUSH SOLID CORE WD.	PTD. HOL. MET.	3	NA	

DOOR HARDWARE SCHEDULE:  
 1. AUTO CLOSER, PANIC BAR, AIR RESISTANT METAL THRESHOLD, WEATHERSTRIP, DOOR STOP, EXTERIOR CYLINDER LOCK, (OFFICE/ENTRANCE), BALL BEARING US32D HINGES.  
 2. AUTO CLOSER, DOOR STOP, CYLINDER LOCK (STOREROOM LOCK), BALL BEARING US32D HINGES.  
 3. PASSAGE LOCK, DOOR STOP, US26D HINGES.  
 4. KEYS HANDLE (OFFICE/ENTRANCE), DOOR STOP, US26D HINGES.  
 5. AUTO CLOSER, DOOR STOP, PRIVACY LOCK, BALL BEARING US26D HINGES.

WINDOW SCHEDULE					
MARK	SIZE	WINDOW TYPE	FRAME	GLASS	REMARKS
A	OVERALL UNIT SIZE = 4/0 W x 14/8 H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR ARCH TOP
B	OVERALL UNIT SIZE = 4/0 W x 16/8 H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR ARCH TOP
C	OVERALL UNIT SIZE = 6/0 W x 10/10 H	ALUMINUM STOREFRONT	ALUMINUM 2" x 4"	LOW E	SEE EXT. ELEVATIONS FOR ARCH TOP

WINDOW SCHEDULE NOTES:  
 1. GLAZING TO BE DBL. GLAZED LAMINATED LOW E.  
 2. EXTERIOR WINDOW SYSTEM SHALL BE CAPABLE OF RESISTING 130 MPH WIND LOAD.

- GENERAL NOTES
- INSULATION AND INSULATION ASSEMBLIES SHALL MEET THE REQUIREMENTS OF SECTION 719.
    - CONCEALED INSULATION SHALL HAVE A FLAME SPREAD OF 0-25 AND SMOKE DEVELOPED INDEX OF 0-450. EXCEPT THAT IN COMBUSTIBLE (WOOD FRAME) CONSTRUCTION.
    - FACING SHALL COMPLY WITH IBC 2009.
  - PROVIDE 5x5' LANDINGS, LEVEL WITH FINISHED FLOOR, OUTSIDE EXTERIOR DOORS ON WEST SIDE OF BUILDING. THRESHOLDS SHALL BE NOT MORE THAN 1/2" IN HEIGHT AND SHALL BE BEVELED IF MORE THAN 1/4".
  - CONTRACTOR TO VERIFY ALL SITE CONDITIONS, BUILDING LOCATIONS, AND DIMENSIONS PRIOR TO CONSTRUCTION.
  - MATERIALS SHALL BE NEW AND U.L. LISTED.
  - NO WORK SHALL BE CONCEALED UNTIL APPROVED BY LOCAL INSPECTORS.
  - CONSTRUCTION SHALL COMPLY WITH ALL PARISH, STATE, AND LOCAL CODES.
  - CONTRACTOR TO GUARANTEE WORK FOR ONE YEAR.
  - CONTRACTOR SHALL FURNISH WATER AND POWER FROM EXISTING SOURCES.
  - EXTERIOR CAULKING SHALL BE THICK CAULK.
  - PAINT GRADE TO SHALL BE SHERWIN WILLIAMS OR EQUIVALENT. ALL WORK TO RECEIVE 3 COATS. COLOR SELECTION BY OWNER.
  - PROVIDE CLEANUP ON A REGULAR BASIS. NO TRASH STORED IN BUILDING.
  - ALL BATT INSULATION SHALL HAVE A CLASS "A" (0-25) FLAME SPREAD IN COMPLIANCE WITH APPLICABLE CODE.
  - USE 6" STUDS, OR 4" STAGGERED STUDS AT ALL PLUMBING WALLS.
  - PROVIDE GALVANIZED METAL PAN WITH DRAIN AT WATER HEATER LOCATION.
  - ALL CORNERS SHALL BE PROPERLY BRACED FOR WIND LOADS. A 48" SHEATHING SHALL BE PROVIDED EVERY 20 FEET OF WALL LENGTH.
  - INTERIOR LOCKS ON DOORS IN MEANS OF EGRESS SHALL NOT REQUIRE THE USE OF A KEY, SPECIAL KNOWLEDGE, OR SPECIAL DEVICE TO OPEN IN THE DIRECTION OF EGRESS. ALL DOORS SHALL HAVE LEVER TYPE HANDLES.
  - INTERIOR WALLS AND CEILINGS SHALL HAVE A FLAME SPREAD OF 0-200 AND A SMOKE DEVELOPMENT RATING OF 0-450.
  - ALL WORK SHALL COMPLY WITH THE LATEST EDITION OF ALL LOCAL, STATE, AND NATIONAL CODES COVERING THE TYPE OF WORK BEING PERFORMED.
  - PROVIDE PORTABLE FIRE EXTINGUISHERS IN ACCORDANCE WITH NFPA 101. SEE APPENDIX "E" OF NFPA 101 FOR DISTRIBUTION OF EXTINGUISHERS.
  - ALL FIRE WALLS SHALL EXTEND TIGHT TO ROOF DECK AND BE SEALED WITH AN APPROVED FIRE CAULK.
  - ALL ELECTRICAL, MECHANICAL, AND PLUMBING MATERIALS PENETRATING FIRE WALLS SHALL BE FIRE CAULKED. (PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE SEALED WITH A MATERIAL CAPABLE OF PREVENTING THE PASSAGE OF FLAMES AND HOT GASES WHEN TESTED IN ACCORDANCE WITH ASTM-E814.)
  - SERVICE COUNTER SHALL HAVE A HCP ACCESSIBLE WRITING SURFACE, MAX. 36" FROM F.F. (ADAAG MANUAL 1998, PG 135)

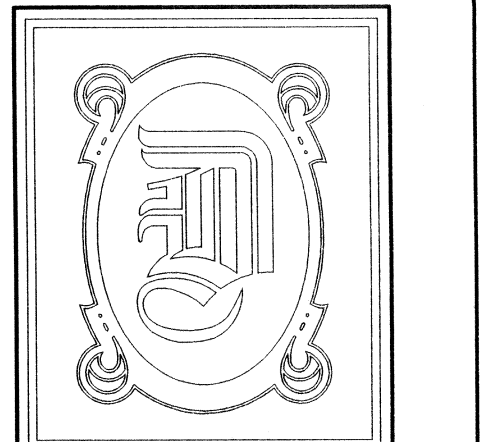

DAMMON ENGINEERING, INC.

CHIEF ENGINEER  
 EMMETT DAMMON, P.E.  
 CHIEF ARCHITECT  
 ROBERT WILTSE  
 554 OLD SPANISH TRAIL  
 SLIDELL, LA. 70458  
 OFFICE: 985-649-5832  
 FAX: 985-641-5950  
 WEBSITE:  
 WWW.DAMMONENGINEERING.COM  
 EMAIL:  
 DAMMONENG@BELLSOUTH.NET  
 ARCHITECTURE  
 ENGINEERING  
 STUDIES  
 PLANNING  
 INVESTIGATION  
 EXPERT WITNESS

LIVING THE WORD INTERNATIONAL

2528 OLD SPANISH TRAIL  
 SLIDELL, LA 70461

FLOOR PLAN

REV: Robert Wiltse

SCALE: AS NOTED

JOB#: 2128

DATE: 01-27-12

SHEET 3

A-1

OF 15