


**ELECTRICAL NOTES**

1. ALL WORK SHALL CONFORM TO THE LATEST EDITION OF THE NATIONAL ELECTRICAL CODE, THE GOVERNING ELECTRICAL CODE, AND ALL OTHER INSPECTION DEPARTMENT HAVING JURISDICTION. OBTAIN CERTIFICATES OR APPROVAL WHERE REQUIRED.
2. ALL MATERIALS FURNISHED SHALL BE NEW AND SHALL BE U.L. LISTED.
3. THE DRAWINGS INDICATE SIZE AND GENERAL LOCATION OF WORK. SCALE DIMENSIONS SHALL NOT BE USED. THE EXACT LOCATION AND ELEVATION OF ALL LIGHTING FIXTURES, RECEPTACLES AND TELEPHONE OUTLETS, ETC. SHALL BE DETERMINED BY ACTUAL CONDITIONS IN THE FIELD. UNLESS NOTED OTHERWISE.
4. PRIOR TO BIDDING, CONTRACTOR SHALL VISIT THE JOB SITE AND FAMILIARIZE THEMSELVES WITH THE EXISTING CONDITIONS.
5. ELECTRICAL CONTRACTOR SHALL COORDINATE HIS WORK WITH OTHER TRADES AND WITH OTHER CONTRACTORS WHOSE WORK MAY AFFECT THIS INSTALLATION.
6. ELECTRICAL CONTRACTOR SHALL COORDINATE INCOMING ELECTRICAL SERVICE WITH UTILITY COMPANY AND INCLUDE IN HIS BID ALL CHARGES AND FEES INCURRED IN MODIFICATIONS.
7. WHERE MORE THAN ONE SWITCH OCCURS IN THE SAME LOCATION, THEY SHALL BE INSTALLED IN A GANG TYPE BOX UNDER ONE COVER PLATE.
8. ELECTRICAL CONTRACTOR SHALL COORDINATE THE TELEPHONE INSTALLATION WITH THE TELEPHONE COMPANY AND THE GENERAL CONTRACTOR.
9. ELECTRICAL CONTRACTOR, BEFORE INSTALLING ANY OF THE WORK, SHALL SEE THAT IT DOES NOT INTERFERE WITH CLEARANCES REQUIRED FOR FINISHED COLUMNS, HUNG CEILING, PLASTER, PARTITIONS, WALLS, ETC. AS SHOWN IN THE ARCHITECTURAL DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND SHALL MAKE SURE THAT ALL NECESSARY CLEARANCES ARE MAINTAINED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND SHALL MAKE SURE THAT ALL NECESSARY CLEARANCES ARE MAINTAINED. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL NECESSARY PERMITS AND SHALL MAKE SURE THAT ALL NECESSARY CLEARANCES ARE MAINTAINED.
10. PERFORM TEST REQUIRED BY THE OWNER OR THE ENGINEER IN CONNECTION WITH THE OPERATION OF THE ELECTRICAL SYSTEM IN THE BUILDING.
11. ALL TESTS SHALL BE MADE IN ACCORDANCE WITH THE LATEST STANDARD OF THE IEEE AND THE NATIONAL ELECTRICAL CODE.
12. MINIMUM CONDUCTOR SIZE SHALL BE #12, 600V INSULATION. MINIMUM SIZE CONDUIT SHALL BE 1/2" RIGID PVC. USE TYPE MNC CABLE COPPER FOR LIGHTS & RECEPTACLE CIRCUITS. EXTERIOR FITTINGS SHALL BE CAST BOXES AND COVERS. INTERIOR FITTINGS SHALL BE CAST WHERE EXPOSED ON WALLS. STAMPED BOXES MAY BE USED ABOVE CEILING IN AIR CONDITIONED SPACES.
13. CONTRACTOR SHALL INSTALL WIRING AND OTHER CIRCUIT COMPONENTS TO MATCH EQUIPMENT ACTUALLY INSTALLED.
14. INSTALL GROUND FAULT RECEPTACLES AT RECEPTACLE LOCATIONS WITHIN 5' OF ALL SINKS OR WATERS, AND AT EXTERIOR LOCATIONS. EXTERIOR RECEPTACLES SHALL BE TYPE GFCI.
15. BONDING AND GROUNDING SHALL BE IN ACCORDANCE WITH NFPA 70:230-63, NFPA 250-23, 250-71, & 250-72.
16. GROUND NEUTRAL IN ACCORDANCE WITH NFPA 70:250-23b.
17. FUSES SHALL BE IT CLASS K5, 250 VOLT, 200,000 AMP INTERRUPTING CAP.
18. PROVIDE SERVICES OF A FIRE/SMOKE DETECTION & ALARM COMPANY TO DESIGN & INSTALL ALARM SYSTEM TO MEET REQUIREMENTS OF THE STATE FIRE MARSHALL.
19. EXTERIOR LIGHTING SHALL BE SHADDED OR UNWARDLY DIRECTED IN SUCH A MANNER SO THAT NO DIRECT LIGHTING OR GLARE IS CAST BEYOND THE PROPERTY LINE. THE INTENSITY OF SUCH LIGHTING SHALL NOT EXCEED ONE FOOT CANDLE AS MEASURED AT THE ADJUTING PROPERTY LINE.
20. ALL ELECTRICAL, MECHANICAL & PLUMBING PENETRATING FIRE PARTITIONS SHALL BE FIRE RATED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE FIRE STOPPED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE FIRE STOPPED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE FIRE STOPPED. PENETRATIONS THROUGH RATED CONSTRUCTION SHALL BE FIRE STOPPED.

NO.	DESCRIPTION	AMPS	POLE	LOAD (VA)	POLE	AMPS	LOAD OCCUPATION LOCATION	NO.
1	LAB	140	2	1400	1	20	RECEPTION	2
2	RESTROOM	20	1	1500	1	20	WALKWAY ARCHIVE	4
3	LABS	20	1	1500	1	20	RECEPTION OUTLETS	6
4	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	8
5	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	10
6	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	12
7	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	14
8	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	16
9	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	18
10	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	20
11	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	22
12	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	24
13	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	26
14	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	28
15	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	30
16	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	32
17	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	34
18	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	36
19	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	38
20	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	40
21	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	42
22	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	44
23	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	46
24	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	48
25	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	50
26	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	52
27	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	54
28	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	56
29	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	58
30	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	60
31	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	62
32	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	64
33	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	66
34	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	68
35	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	70
36	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	72
37	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	74
38	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	76
39	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	78
40	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	80
41	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	82
42	RECEPTION OUTLETS	20	1	1500	1	20	RECEPTION OUTLETS	84

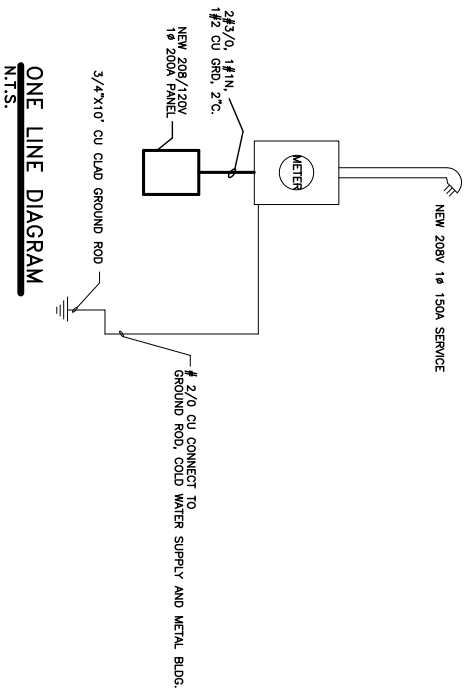

<p>PARISH CAB</p> <p><b>DAMMON ENGINEERING, INC.</b></p> <p>1095 FLORIDA AVENUE 985-449-8888 SLIDELL, LA. 70468</p> <p>DAMMONENGINEERING.COM</p>	<p><b>ELECTRICAL SCHEDULE</b></p> <p>PARISH CAB</p> <p>1189 FREMAUX AVENUE</p> <p>SLIDELL, LOUISIANA</p>	<p>SCALE(S) NOTED</p> <p>FILE:</p> <p>JOB NO. 1847</p> <p>DATE: 3-19-07</p> <p>SHEET</p> <p style="font-size: 2em; font-weight: bold;">E-2</p> <p>OF</p>	
--	--	--	--