


PANEL "LP-1" SCHEDULE

SERVICE MAINS 120/240V. 1Ø-3Ø-W. 3Ø-N. 3Ø-G. 60. HZ. 60. CIP. 2 POLE MAIN BREAKER WITH CIRCUIT BREAKERS
 BRANCHES 3Ø
 CABINET PLUG MOUNTED
 TYPE 3Ø 0-120/240V-4Ø/3Ø-3Ø-ØTA


| CKT. No. | TRIP AMP. | BRKR. FRM. | WIRES No. | WIRE SIZE | GRND. | RACE WAY | LOAD SERVED | LOAD KW | |
|----------|-----------|------------|-----------|-----------|-------|----------|-------------------------------|-----------------|-----|
| 1,2 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.4 | |
| 2 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.0 | |
| 4 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.0 | |
| 7 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.0 | |
| 2 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.8 | |
| 7 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 1.0 | |
| 3 | 20 | | 2 | 12 | 12 | NM | LIGHTING | 0.8 | |
| 8 | 20 | | 2 | 12 | 12 | NM | EXT. LIGHTING | 0.0 | |
| 10,16 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 1.0 | |
| 11,12 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 1.0 | |
| 14,16 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 18,17 | 20 | | 2 | 12 | 12 | NM | WASH. RECEPT. | 0.0 | |
| 8,10 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 15,11 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 20,14 | 20 | | 2 | 12 | 12 | NM | AIR UNITS | 0.8 | |
| 23,25 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 24,28 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.4 | |
| 27,29 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.4 | |
| 30 | 20 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 31 | 25 | | 2 | 12 | 12 | NM | AIR UNIT | 0.7 | |
| 32 | 30 | | 2 | 10 | 10 | NM | RECEPT. | 4.0 | |
| 33 | 30 | | 2 | 12 | 12 | NM | RECEPT. | 0.0 | |
| 34 | 20 | | 2 | 12 | 12 | NM | SOFFIT LIGHTS | 0.5 | |
| * 35 | 20 | | 2 | 12 | 12 | NM | INTRUSION ALARM CONTROL PANEL | 1.0 | |
| 36-38 | 20 | | - | - | - | - | SPACES | 4.0 | |
| | | | | | | | | CONNECTED | 0.7 |
| | | | | | | | | PER M.D. DESIGN | 4.0 |

* PROVIDE LOCK-OUT DEVICE ON BREAKER.

PLAN - OFFICE/LAUNDRY/MAINTENANCE/COMMUNITY BUILDING 1/4"

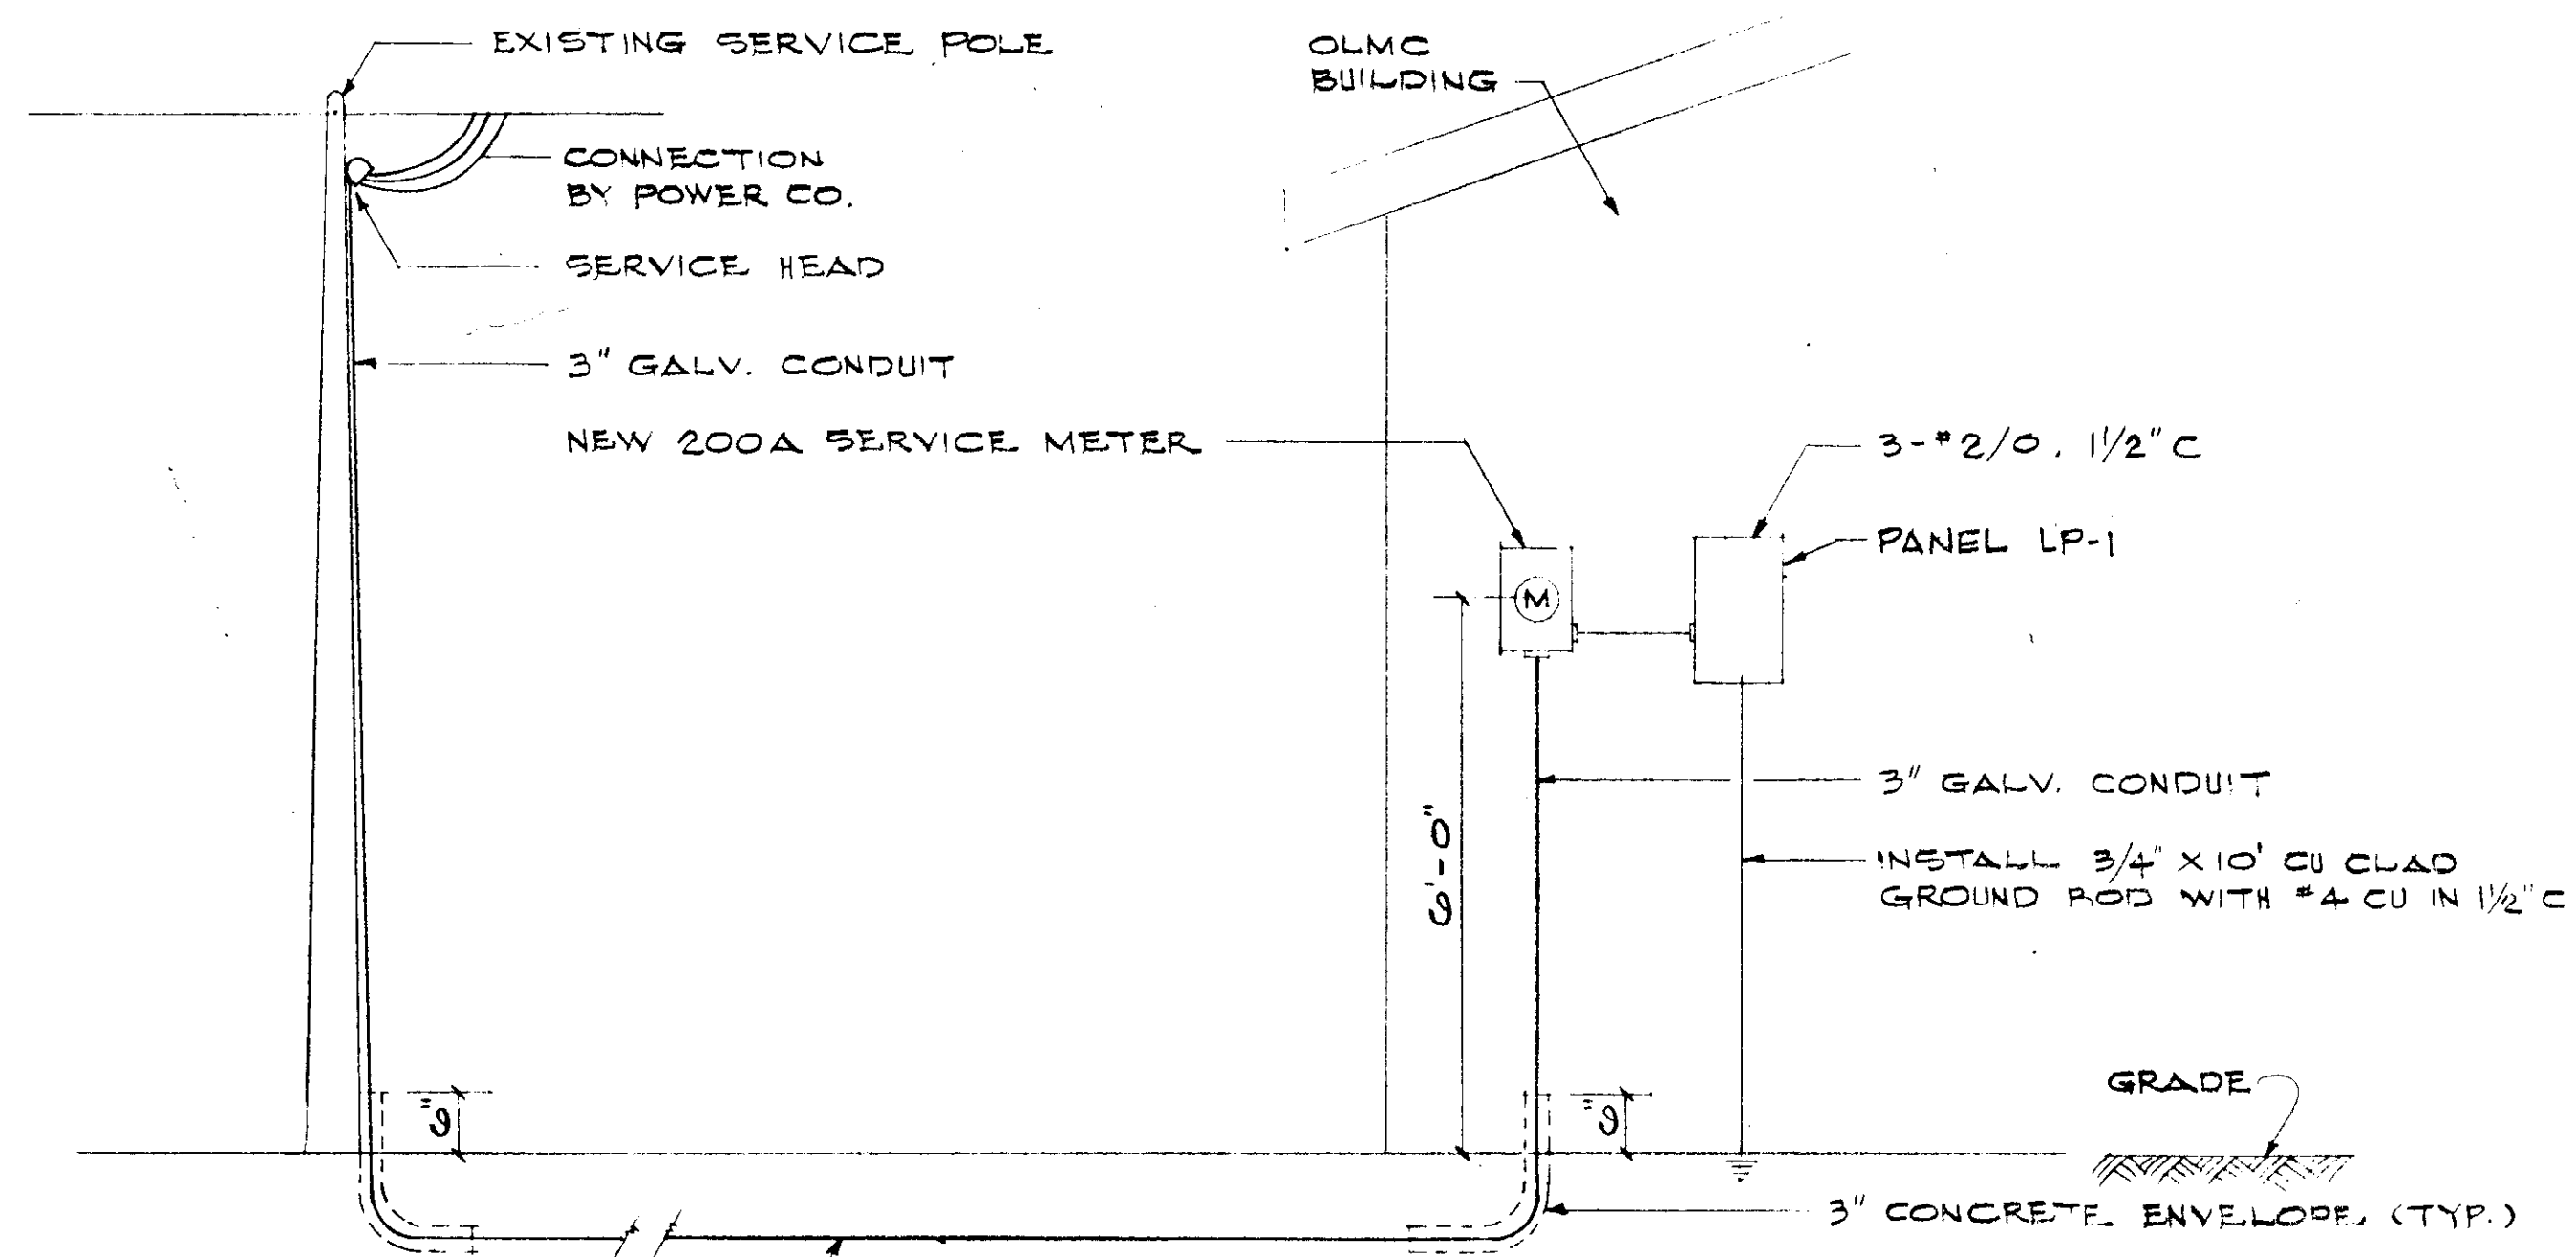

SERVICE ENTRANCE DETAIL NO. 3 (OLMC BUILDING)

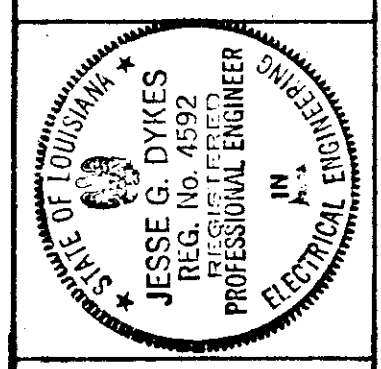

CONTRACTOR SHALL BE RESPONSIBLE FOR VERIFYING ALL EXISTING CONDITIONS AND DIMENSIONS BEFORE COMMENCING WORK AND SHALL REPORT ANY DISCREPANCIES TO ARCHITECT.