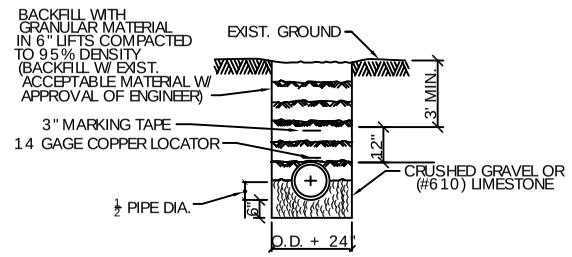

A MIN. 10 FT. HORIZONTAL AND 18" VERTICAL SEPARATION IS REQUIRED BETWEEN WATER & SEWER LINE.

PIPE BEDDING DETAIL FOR SEWER & WATER LINE

N.T.S.

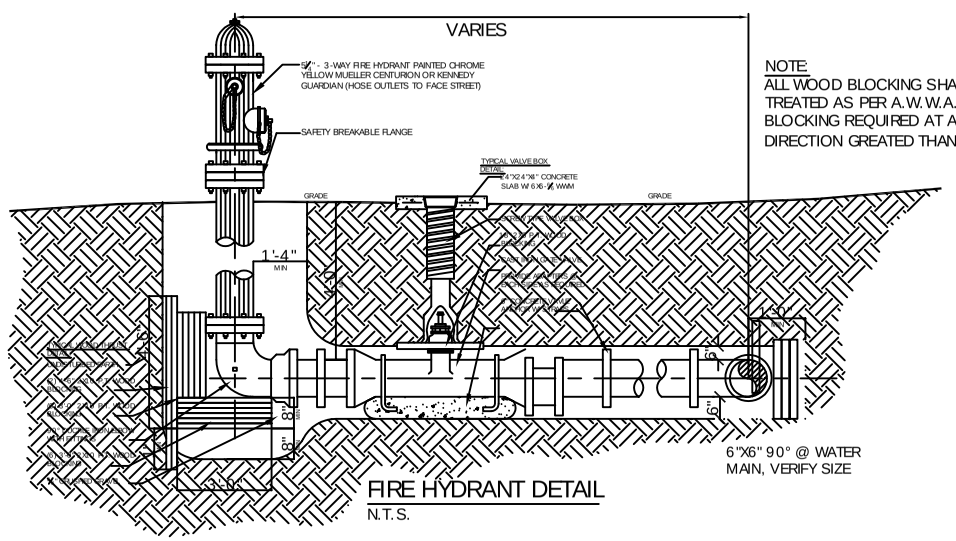

FIRE HYDRANT DETAIL

N.T.S.

NOTE:
ALL WOOD BLOCKING SHALL BE CREOSOTE TREATED AS PER A.W.W.A. SPECS. WOOD BLOCKING REQUIRED AT ALL CHANGES IN DIRECTION GREATED THAN 22½°.

CONTRACTOR NOTE:
INSPECT PROPERTY AROUND THIS SITE FOR AN EXISTING FIRE HYDRANT. NEW HYDRANT NOT REQUIRED IF THERE IS AN EXISTING HYDRANT WITHIN A 300' RADIUS OF THE DAYCARE CENTER.

LEGEND

- PROPERTY LINE
- NEW BLDG. FOOTPRINT
- SETBACK LINE
- NEW FENCE
- 6" CONCRETE CURB
- NEW DRAINAGE CATCH BASIN
- NEW SUBSURFACE ELECTRICAL LINE
- NEW 4" WATER LINE

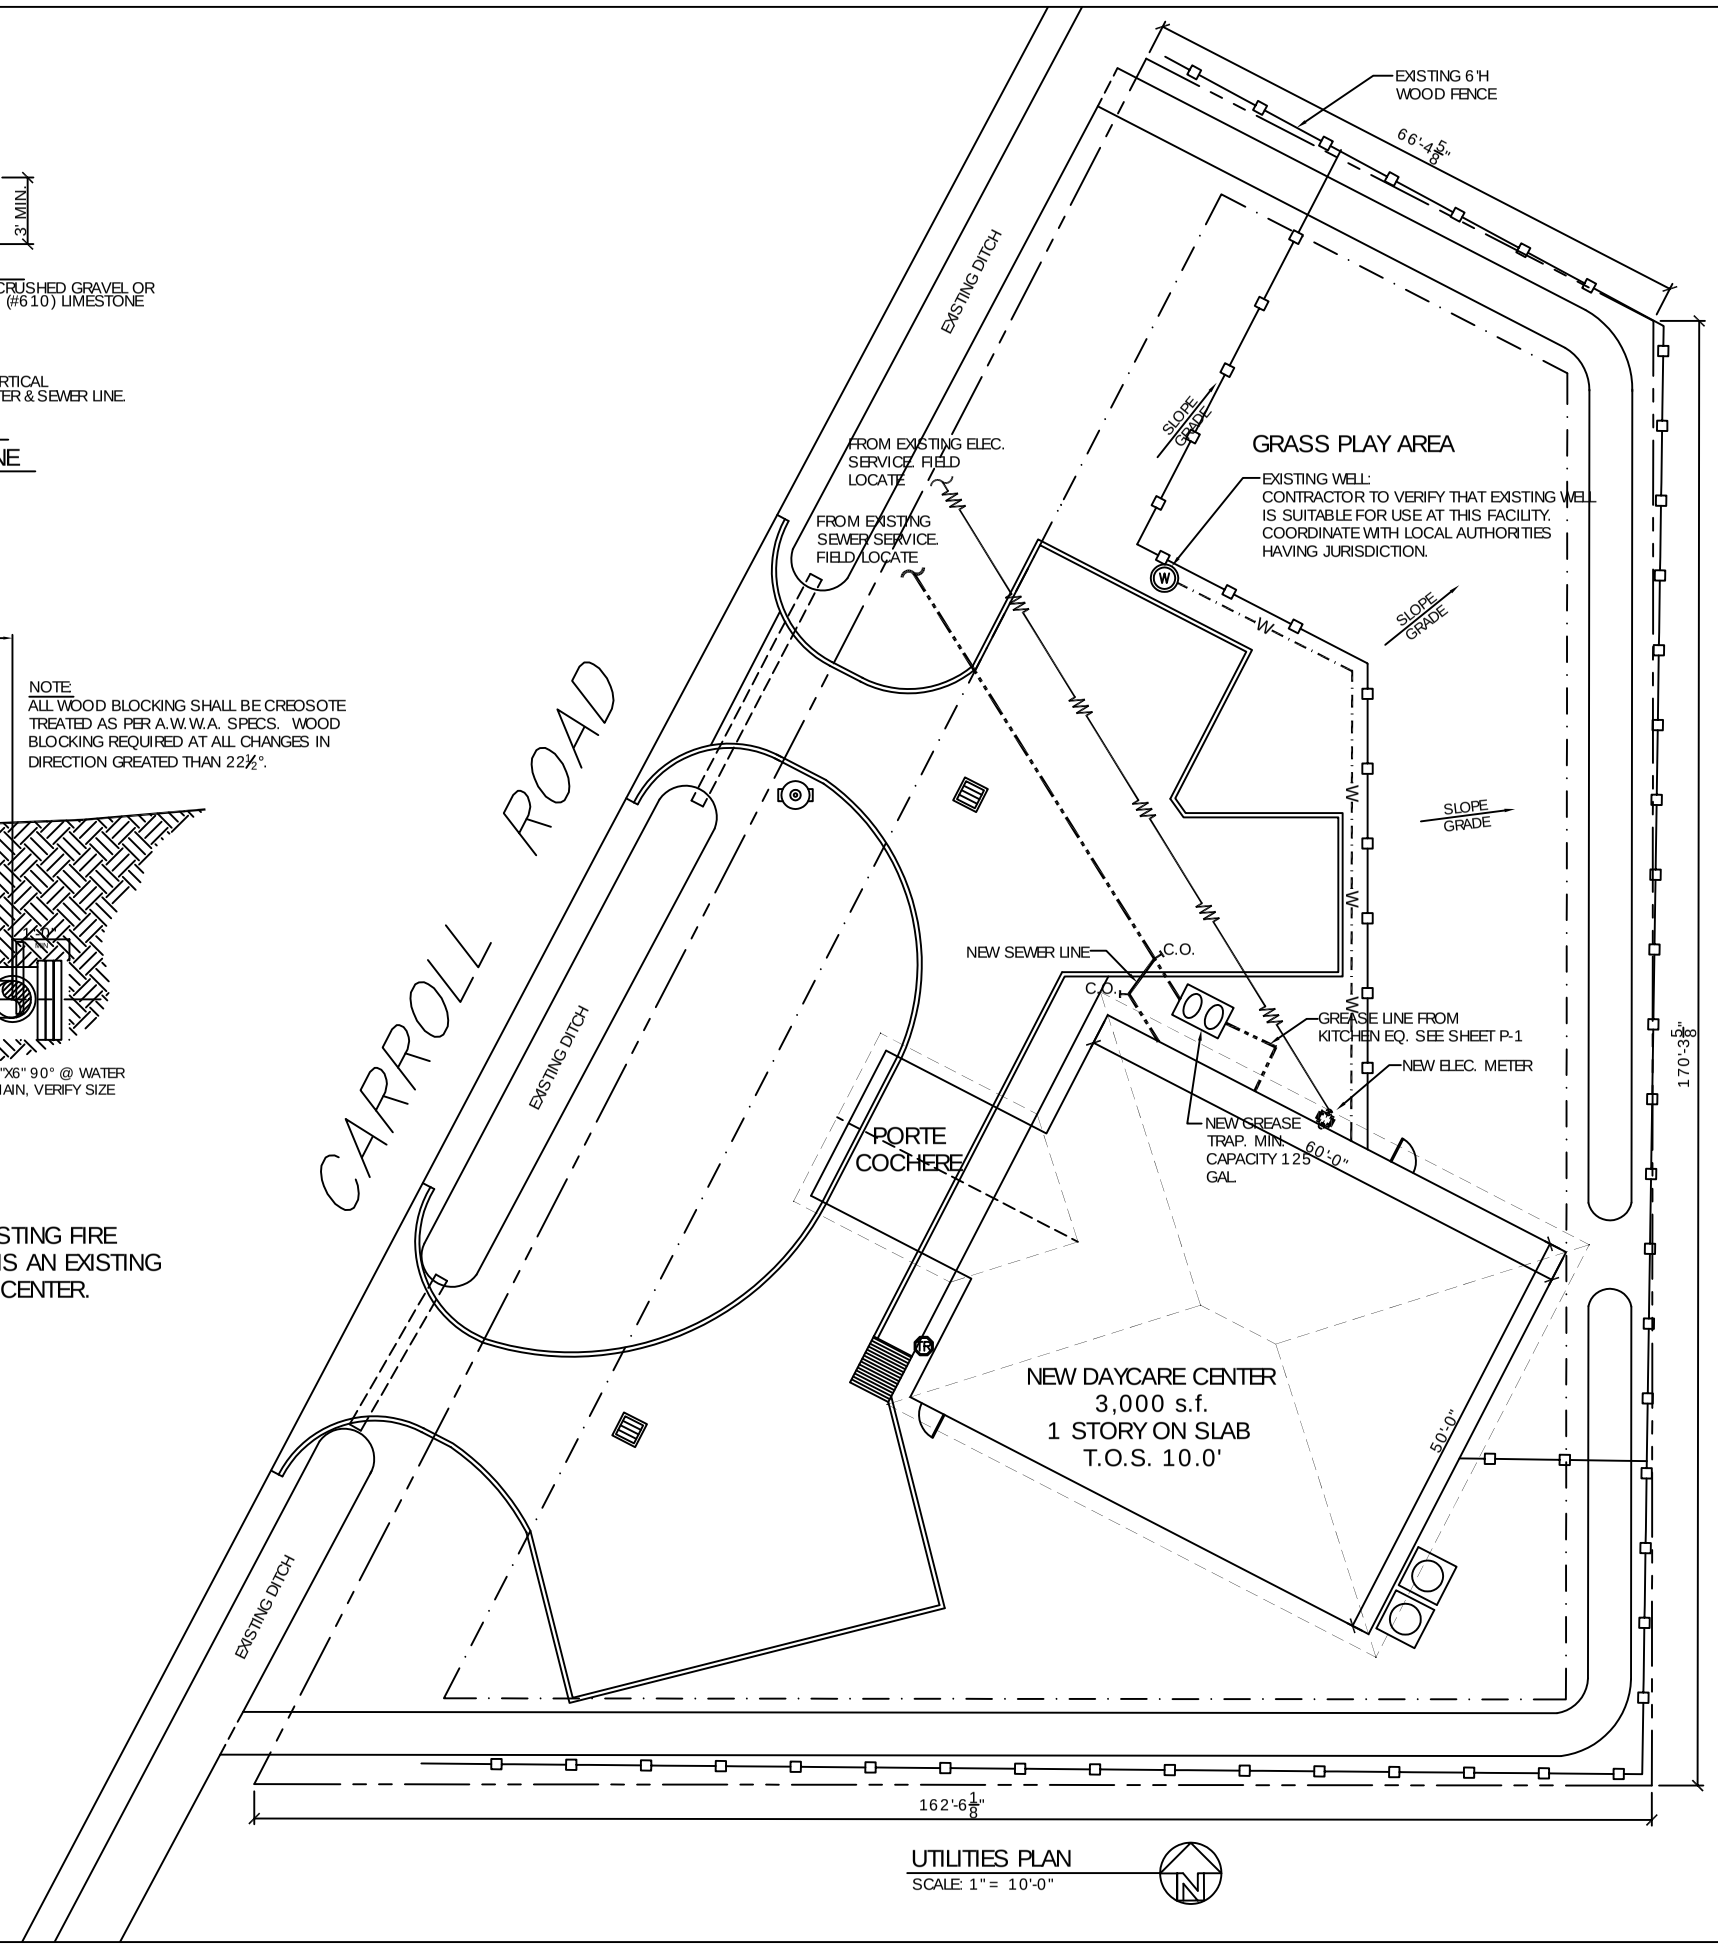

UTILITIES PLAN

SCALE: 1" = 10'-0"

DAMMON ENGINEERING, INC.

CHIEF ENGINEER
EMMETT DAMMON, P.E.

CHIEF ARCHITECT
ROBERT WILTSE

1095 FLORIDA AVENUE
SLIDELL, LA. 70458
OFFICE: 985-649-5832
FAX: 985-641-5950

WEBSITE:
WWW.DAMMONENGINEERING.COM

EMAIL:
DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

PRECIOUS JEWELS DAY CARE CENTER

FRIEDA TORREGANO
58074 CARROLL RD.
SLIDELL, LA
70460

UTILITIES PLAN

REV:

SCALE: AS NOTED

JOB#: 1991

DATE: XX-XX-08

SHEET

C-4

OF