


OLDE TOWN SLIDELL

FIRE DAMAGED BUILDING REHABILITATION

227 & 285 COUSIN STREET
SLIDELL, LA 70458
6,000 SQ.FT. EXISTING
NON-SPRINKLED

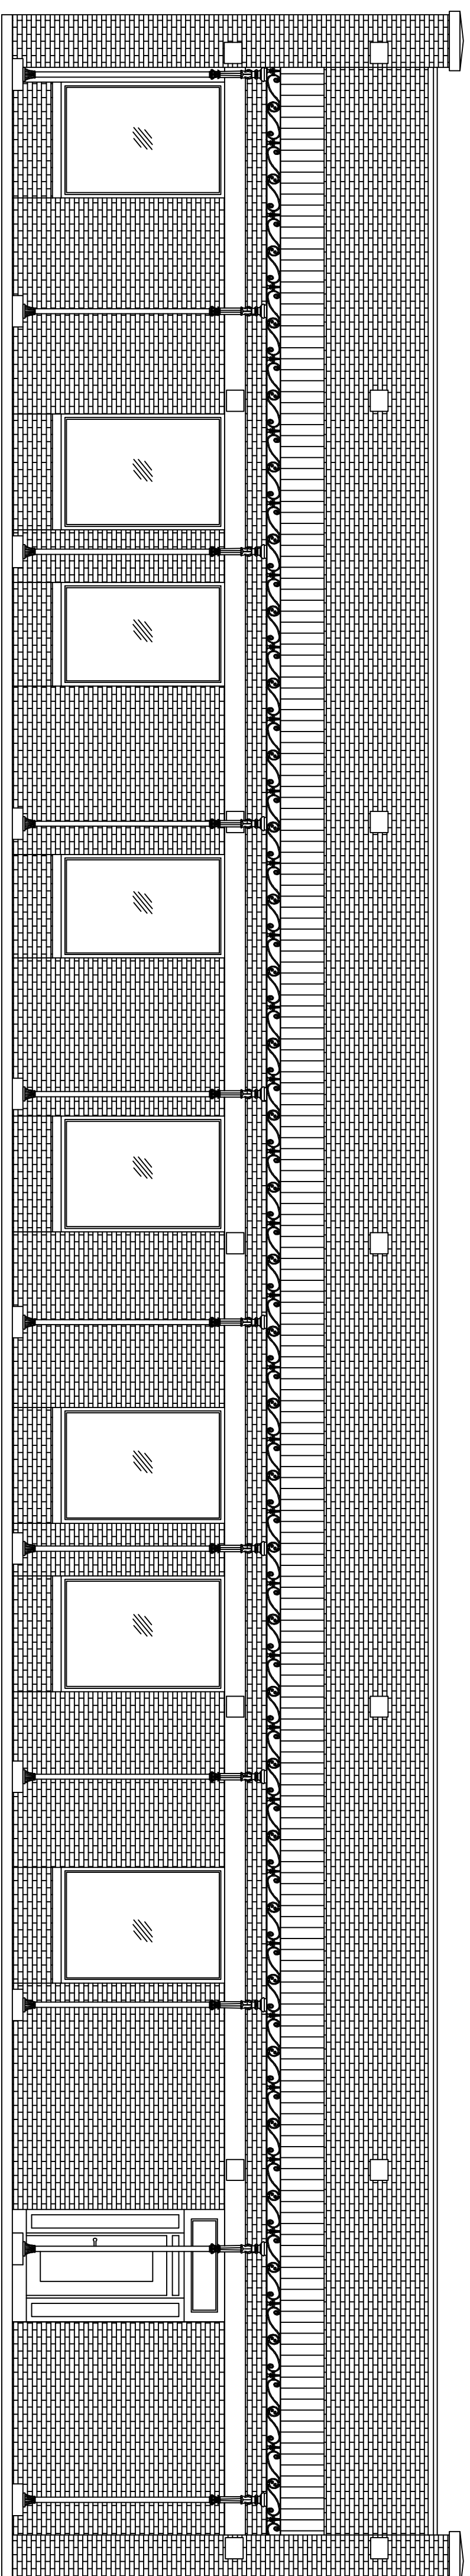

INTERNATIONAL BUILDING CODE 2009 SUMMARY

OCCUPANCY CLASSIFICATION:
BUSINESS GROUP: B (SEC 304.1)

OCCUPANT LOAD: (TBL 1004.1.1)
BUSINESS = 100 GROSS / OCCUPANT = 6,000 / 100 = 60 OCCUPANTS
TOTAL LOAD = 60 OCCUPANTS

EXIT ACCESS REQUIREMENTS: (SEC 1014)
2 EXITS REQUIRED FOR > 50 OCCUPANTS (TBL 1015.1)
MAXIMUM COMMON PATH OF EGRESS TRAVEL = 200' (BUSINESS WITHOUT SPRINKLER, TBL 1016.1)
LONGEST EGRESS PATH IN AREA OF WORK = 50'

CONSTRUCTION CLASSIFICATION: (SEC 602.2)
TYPE IIB

ALLOWABLE HEIGHT AND BLDG. AREA: (TBL 503)
THREE STORY AND 23,000 SQ.FT. (BUSINESS)
THIS BLDG 6,000 SQ.FT. / 1 STORY

FIRE RESISTANCE RATING REQUIREMENTS FOR BLDG. ELEMENTS: (TBL 601)
STRUCTURAL FRAME = 0 HRS.
BRACING WALLS (INTERIOR AND EXTERIOR) = 0 HRS.
NON-BEARING WALLS = 0 HRS.
FLOOR CONSTRUCTION = 0 HRS.
ROOF CONSTRUCTION = 0 HRS.

FIRE RESISTANCE RATING REQUIREMENTS FOR EXTERIOR WALLS: (TBL 602)
EXTERIOR WALLS WITH >= 30' FIRE SEPARATION DISTANCE = 0 HRS.
EXTERIOR WALLS WITH < 5' FIRE SEPARATION DISTANCE = 1 HR.

MAX. AREA OF EXTERIOR WALL OPENINGS: (TBL 705.8)
BLDG'S WITH >= 30' FIRE SEPARATION DISTANCE ALLOWED UNLIMITED PROTECTED AND UNPROTECTED OPENINGS

AUTOMATIC SPRINKLER SYSTEM REQUIREMENTS: (SEC 903)
THIS BLDG. DOES REQUIRE NOT AN AUTOMATIC SPRINKLER SYSTEM.

FIRE PROTECTION SYSTEM REQUIREMENTS: (SEC 907)
THIS BLDG. SHALL BE NOT REQUIRED TO HAVE AN APPROVED FIRE PROTECTION SYSTEM IN ACCORDANCE WITH SEC 907.2.2.

CONSTRUCTION DOCUMENTS: (SEC 1603)
THIS BLDG. SHALL BE DESIGNED IN ACCORDANCE WITH IBC SECTION 1609 AS A FULLY ENCLOSED BLDG. USING THE FOLLOWING INFORMATION:
WIND DESIGN DATA:
DETERMINATION OF WIND LOADS SHALL BE IN ACCORDANCE WITH IBC SECTION 1609.4
BASIC WIND SPEED (3 SECOND GUST) = 130 MPH (FIG 1609)
IMPORTANCE FACTOR: CATEGORY II BLDG., IE = 1.00, IS = 1.0, IW = 1.00 (TBL 1604.5)
EXPOSURE B
DESIGN WIND PRESSURE (ASCE 7-05 FIG. 6-2): 33.6 PSF
INTERVAL PRESSURE COEFFICIENT (ASCE 7-05 FIG. 6-5): ± 0.18
OFFICE (TBL 1607.1): 50 PSF
ROOF LIVE LOAD (TBL 1607.1) = 20 PSF UNIFORM, 300 LB. CONCENTRATED
GROUND SNOW LOAD (FIG. 1608.2) = 5 PSF

NATIONAL FIRE PROTECTION ASSOCIATION 2009 SUMMARY

BUILDING AREA:
TOTAL BUILDING AREA = 6,000 SQ.FT.
AREA TO BE RENOVATED = 6,000 SQ.FT.

OCCUPANCY CLASSIFICATION:
EXISTING GROUP B (BUSINESS)


OCCUPANT LOAD: (TBL 7.3.1.2)
BUSINESS = 100 GROSS SQ.FT. / OCCUPANT = 6,000 / 100 = 60 OCCUPANTS

SPRINKLER SYSTEM: (SEC 39.2.5)
THIS BUILDING SHALL NOT BE REQUIRED TO HAVE AN AUTOMATIC SPRINKLER SYSTEM AT THIS TIME.

FIRE ALARM SYSTEM: (SEC 39.3.4.1)
A FIRE ALARM SYSTEM IS NOT REQUIRED.

EXIT ACCESS:
2 EXITS REQUIRED (SEC 39.2.4.1)
2 EXITS PROVIDED
ALLOWABLE EXIT ACCESS TRAVEL DISTANCE = 200' (SPRINKLED, SEC 39.2.6.2)
LONGEST EGRESS PATH IN AREA OF WORK = 50'

INDEX OF DRAWINGS		REVISED
SHT #	DWG #	DRAWING NAME
1	D-1	COVERSHEET
2	5-1	DEMOLITION PLAN
3	A-1	FOUNDATION PLAN
4	A-1	FLOOR PLAN
5	A-2	SECTION
6	A-3	BUILDING ELEVATIONS
7	A-4	SCHEDULE & DETAILS
8	E-1	ELECTRICAL PLAN
9	P-1	PLUMBING PLAN

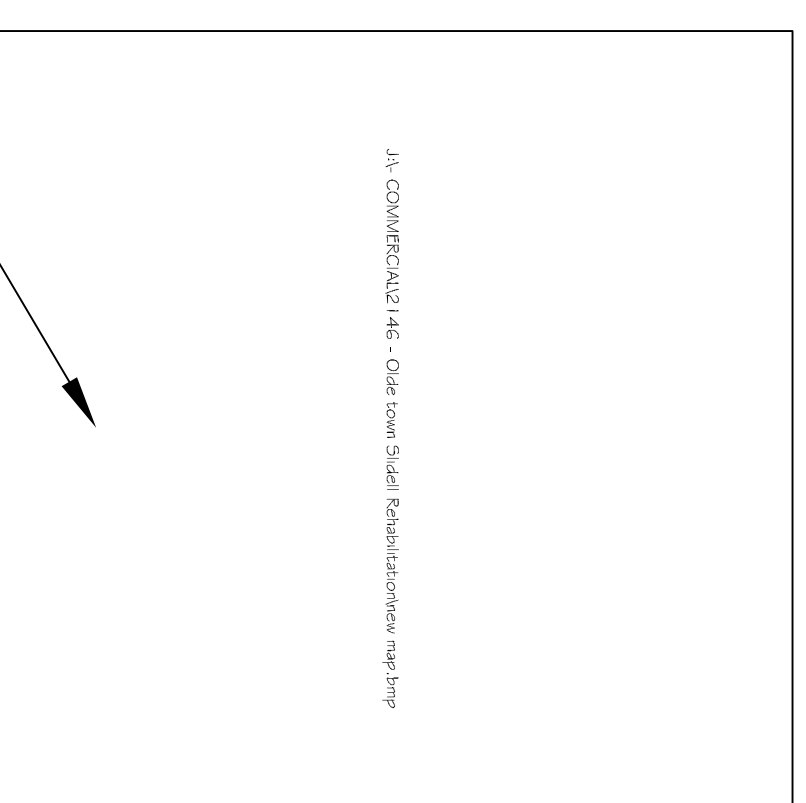

AREA OF WORK

VICINITY MAP

N.T.S.

CHIEF ENGINEER: EMMETT DAMMON, P.E.
CHIEF ARCHITECT: ROBERT WILTSE
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

www.dammonengineering.com
dammoneng@bellsouth.net
PHONE: 985-649-5832
FAX: 985-641-5950

J:\DAMMON\Dammon Logo\Dammon Logo.jpg

OLDE TOWN SLIDELL
FIRE DAMAGED BUILDING REHABILITATION
227 & 285 COUSIN STREET
SLIDELL, LA

JOB No:	2200	DATE:	07/11/2012
DRAWN BY:	BSN	CHECKED BY:	BSN

The above drawings and specifications, designs and arrangements are the property of Dammon Engineering, and no part thereof shall be copied, altered or used in connection with any work on project other than the specific project for which they have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.