



CMU LINTEL SCHEDULE			
WIDTH (W)	CLEAR SPAN	DEPTH (D)	HORIZ. REINF.
8" TYP AT ALL CMU WALLS	UP TO 3'-4"	8"	(1) #6 BOTTOM
	UP TO 6'-4"	16"	(1) #6 T&B
	UP TO 14'-0"	24"	(2) #6 T&B


PROVIDE 3000 PSI PEA-GRAVEL CONCRETE FILL FOR ALL LINTELS.

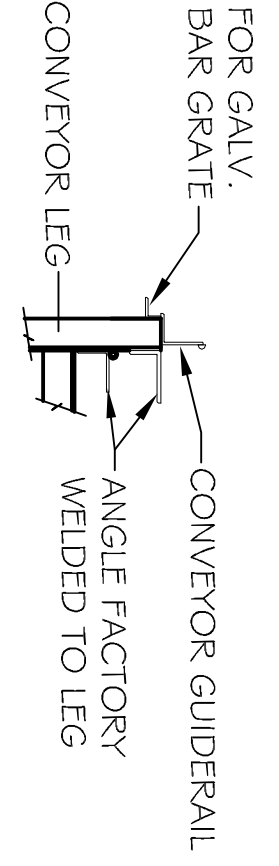


DETAIL 1
N.T.S.

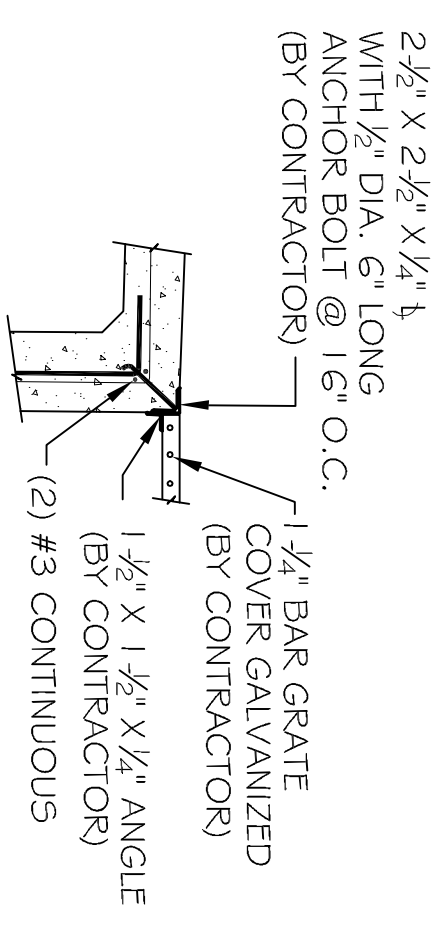


DETAIL 2
N.T.S.

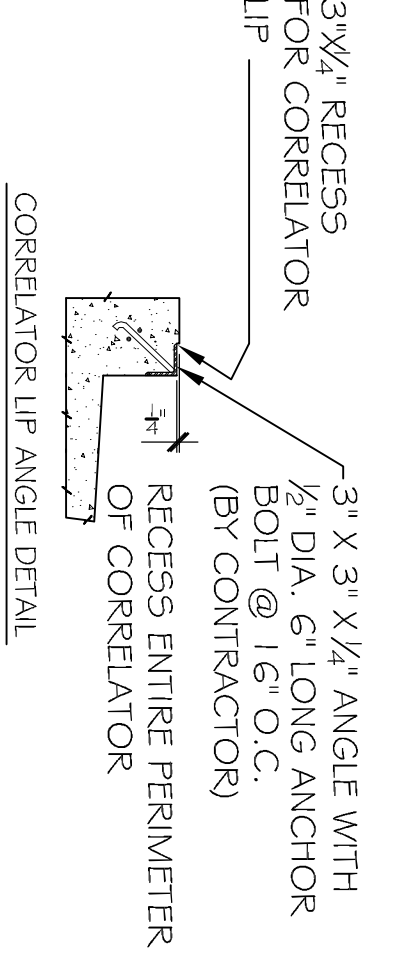


DETAIL 3
N.T.S.

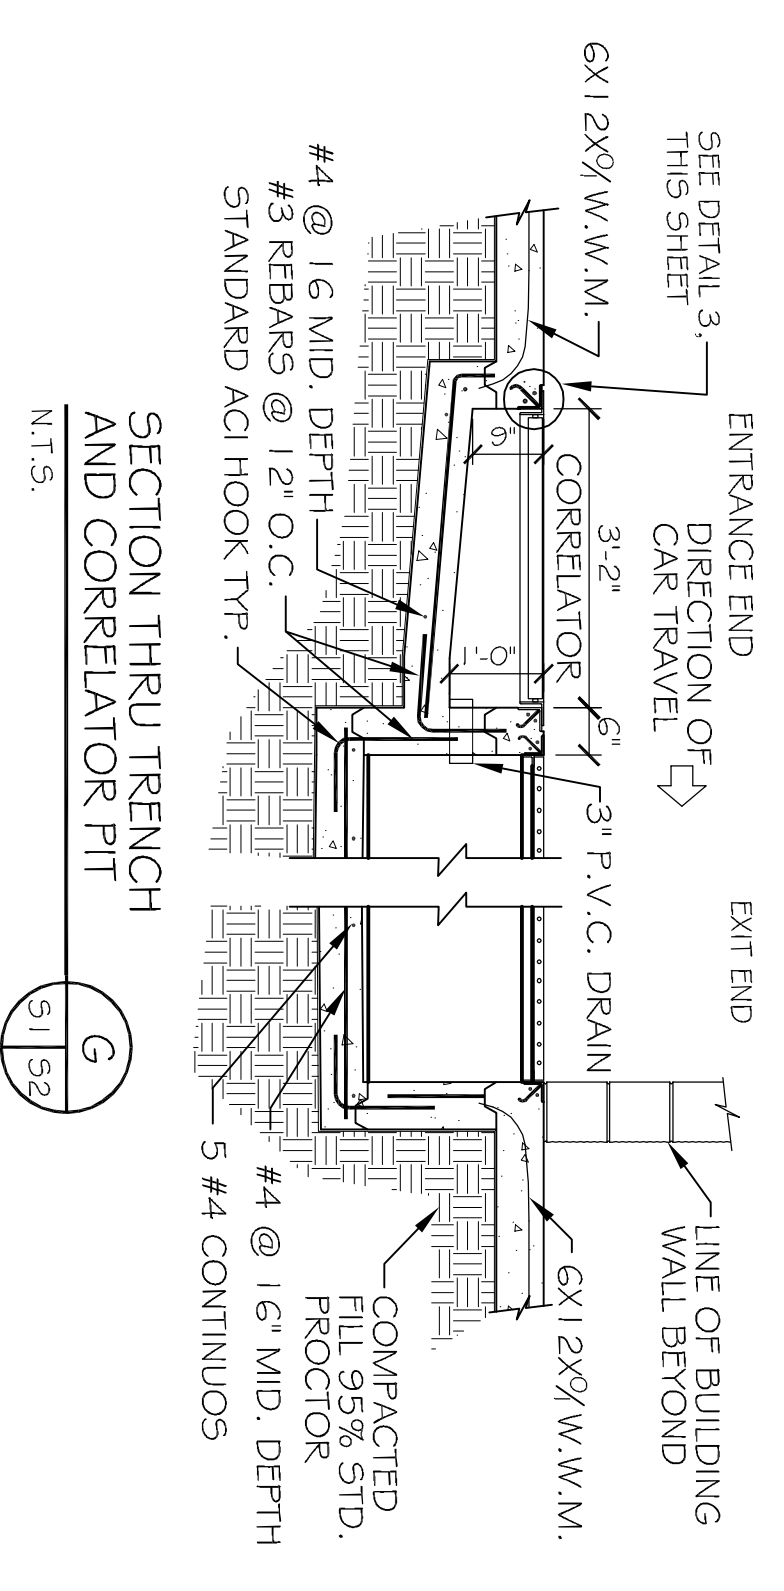


SECTION THRU TRENCH AND CORRELATOR PIT
N.T.S.

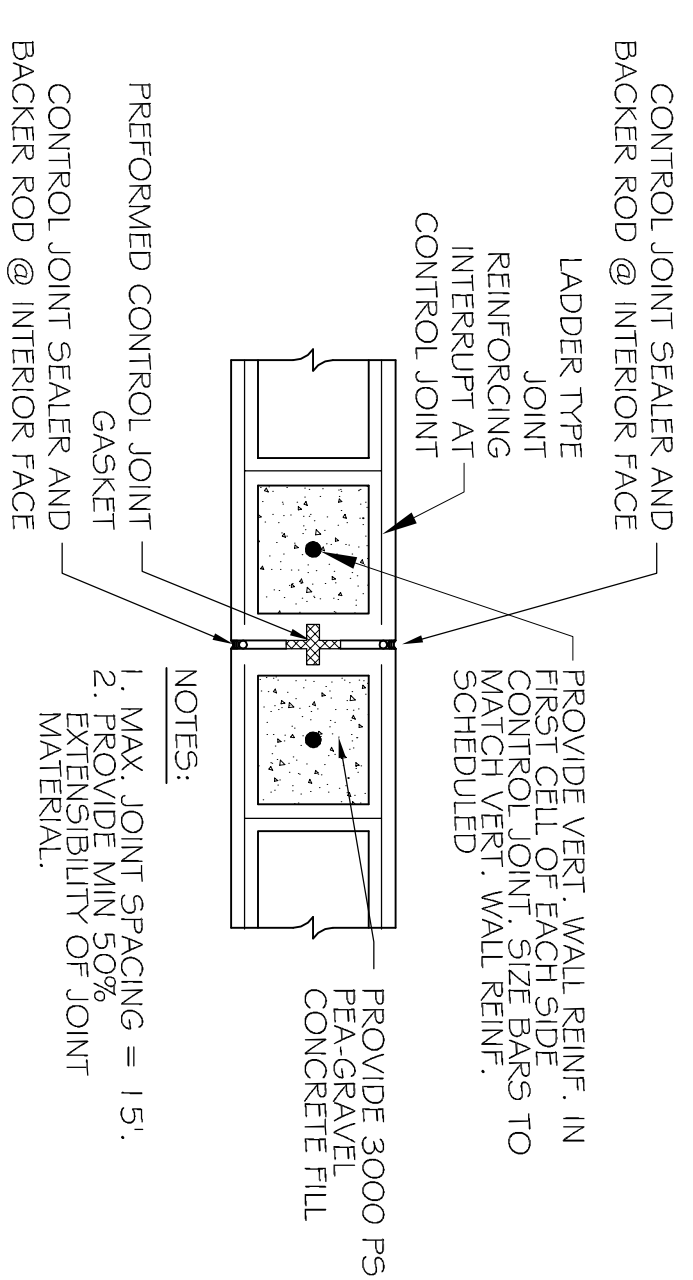



TYPICAL MASONRY CONTROL JOINT
SCALE: N.T.S.

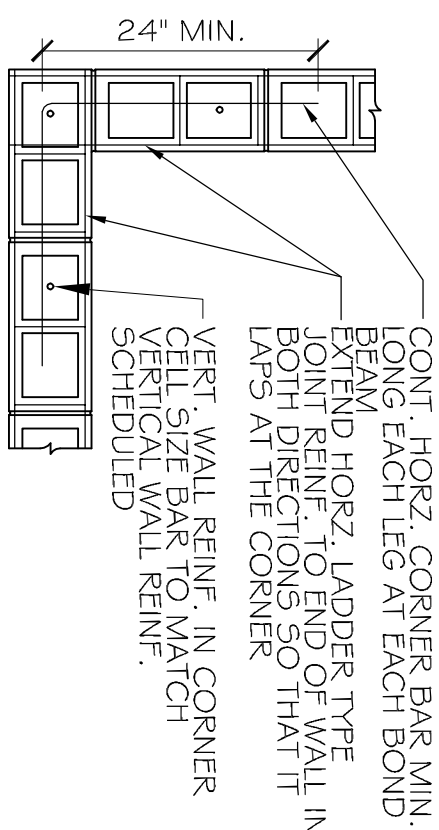

TYPICAL REINF. @ CORNER OF MASONRY
SCALE: N.T.S.

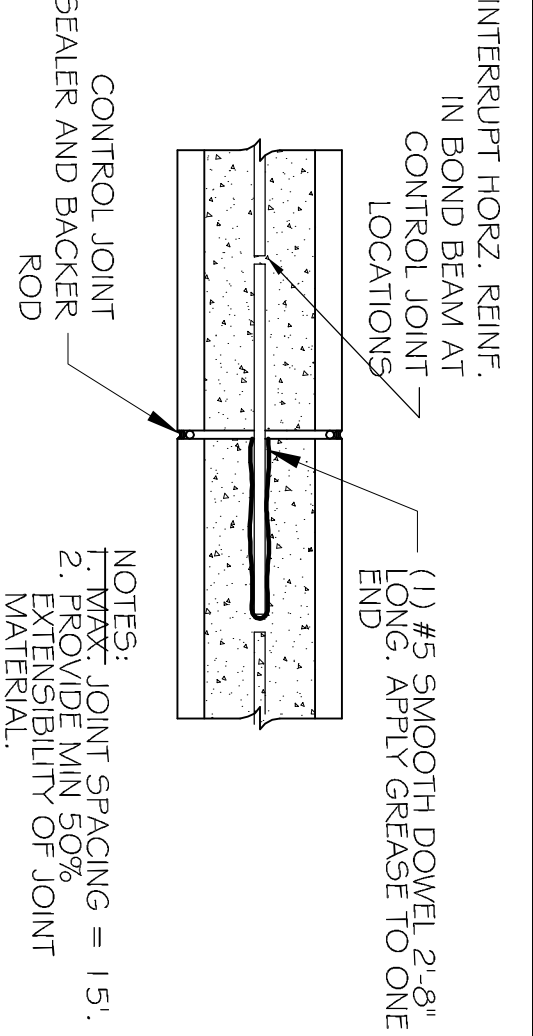

CONTROL JOINT @ BOND BEAM
SCALE: N.T.S.

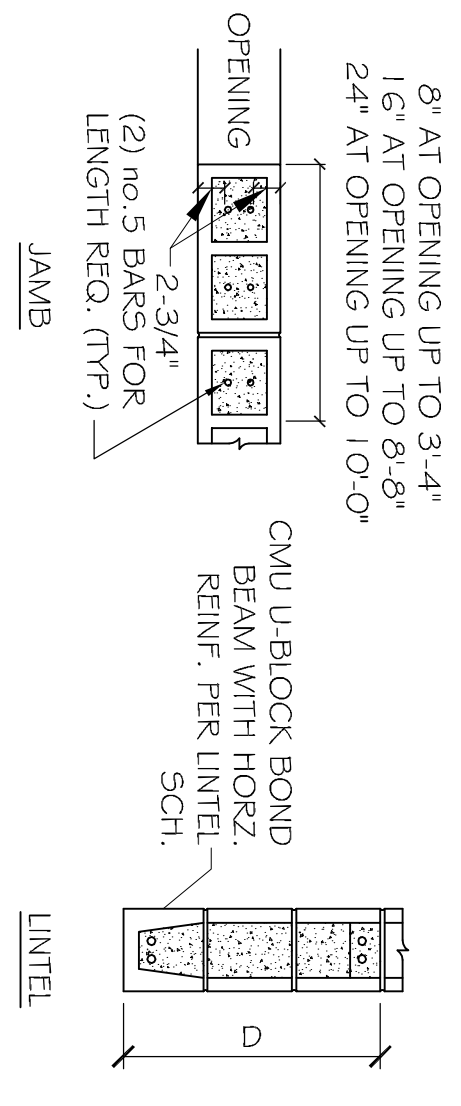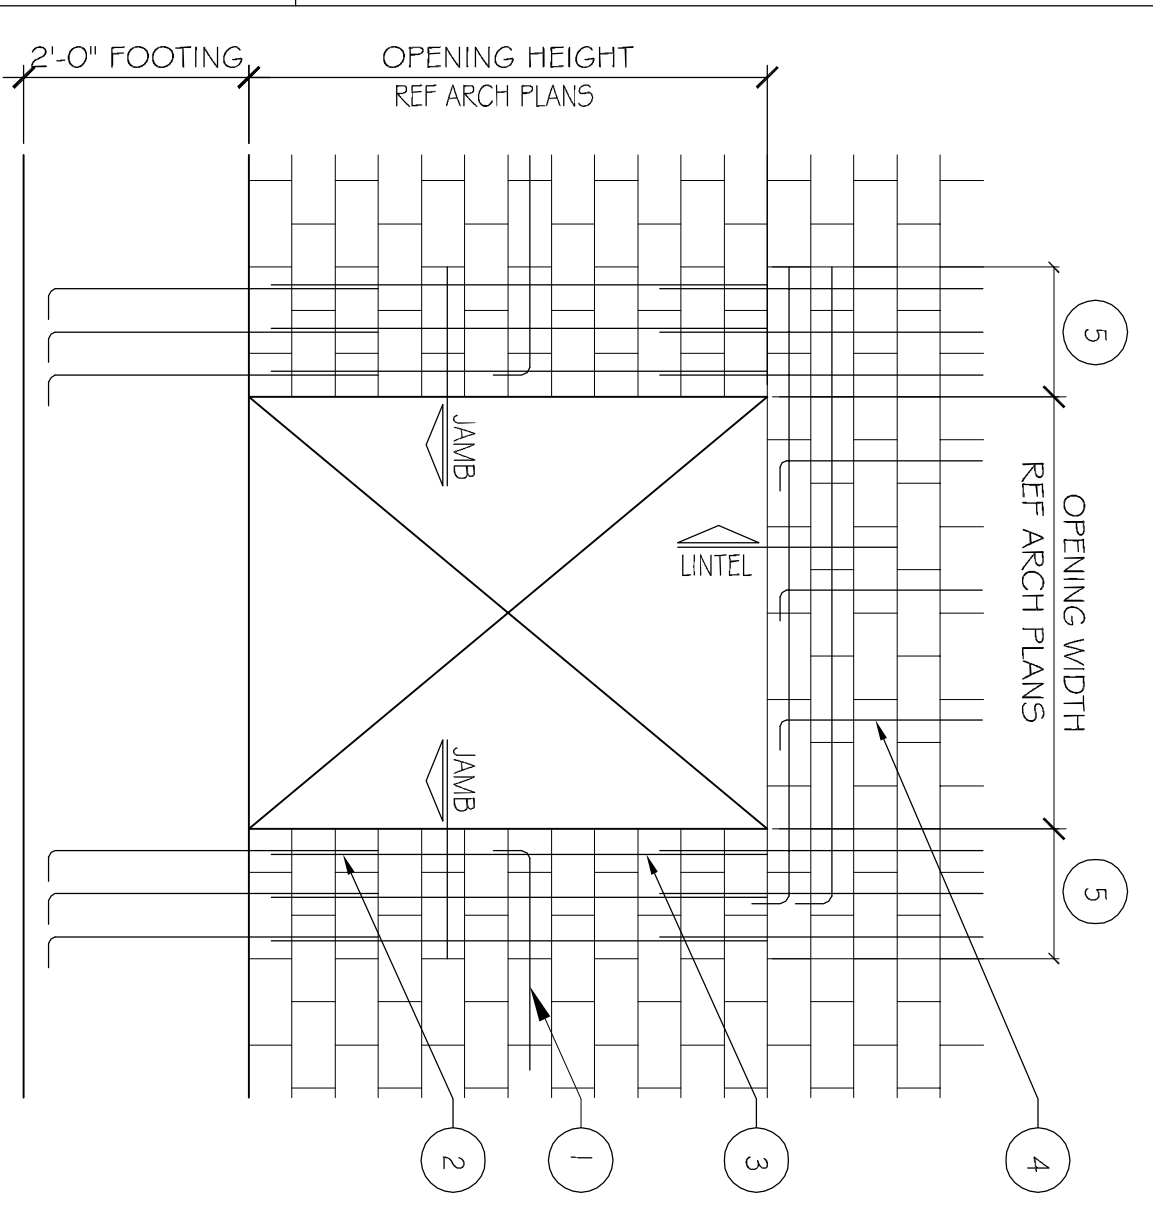

NOTES: #

- WHERE HORIZ. REINFORCEMENT IS INTERRUPTED BY OPENING OR CONTROL JOINT PROVIDE STANDARD ACI HOOK WITH VERT. WALL REINF. AT JOINT.
- SPICES IN VERT. REINF. REF. WALL SECTIONS 5-3.
- ALL VERT. BARS AT DOOR JAMBS TO BE FULL HEIGHT.
- CONTINUE VERT. WALL REINF. OVER OPENING. ANCHOR VERT. REINF. INTO LINTEL BEAM WITH 5\"/>
- FOR STRAIGHT LINTEL REINF. AND 1'-0\"/>

TYPICAL MASONRY WALL OPENING DIAGRAM
SCALE: N.T.S.



DAMMON
ENGINEERING, INC.

CHIEF ENGINEER, EMMETT DAMMON, P.E.
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

dammoneing@earthlink.net
dammoneng@bellsouth.net
PHONE: 985-649-5832
FAX: 985-641-5950

RAINFOREST CARWASH

5026 HARDY ST.
HATTIESBURG, MISSISSIPPI

JOB No: 2176 DATE: 06-28-2013
DRAWN BY: JTL CHECKED BY: CD

The above drawings and specifications, designs and arrangements represented hereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, exhibited to others, or used in connection with any work or project other than the specific project for which they have been prepared and distributed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conductance of acceptance of these restrictions.

REVISIONS		
#	DESCRIPTION	DATE
A	ADDED RESTROOMS	07-19-13

CARWASH
FOUNDATION
DETAILS

SHEET No: 6 OF 22

S-2