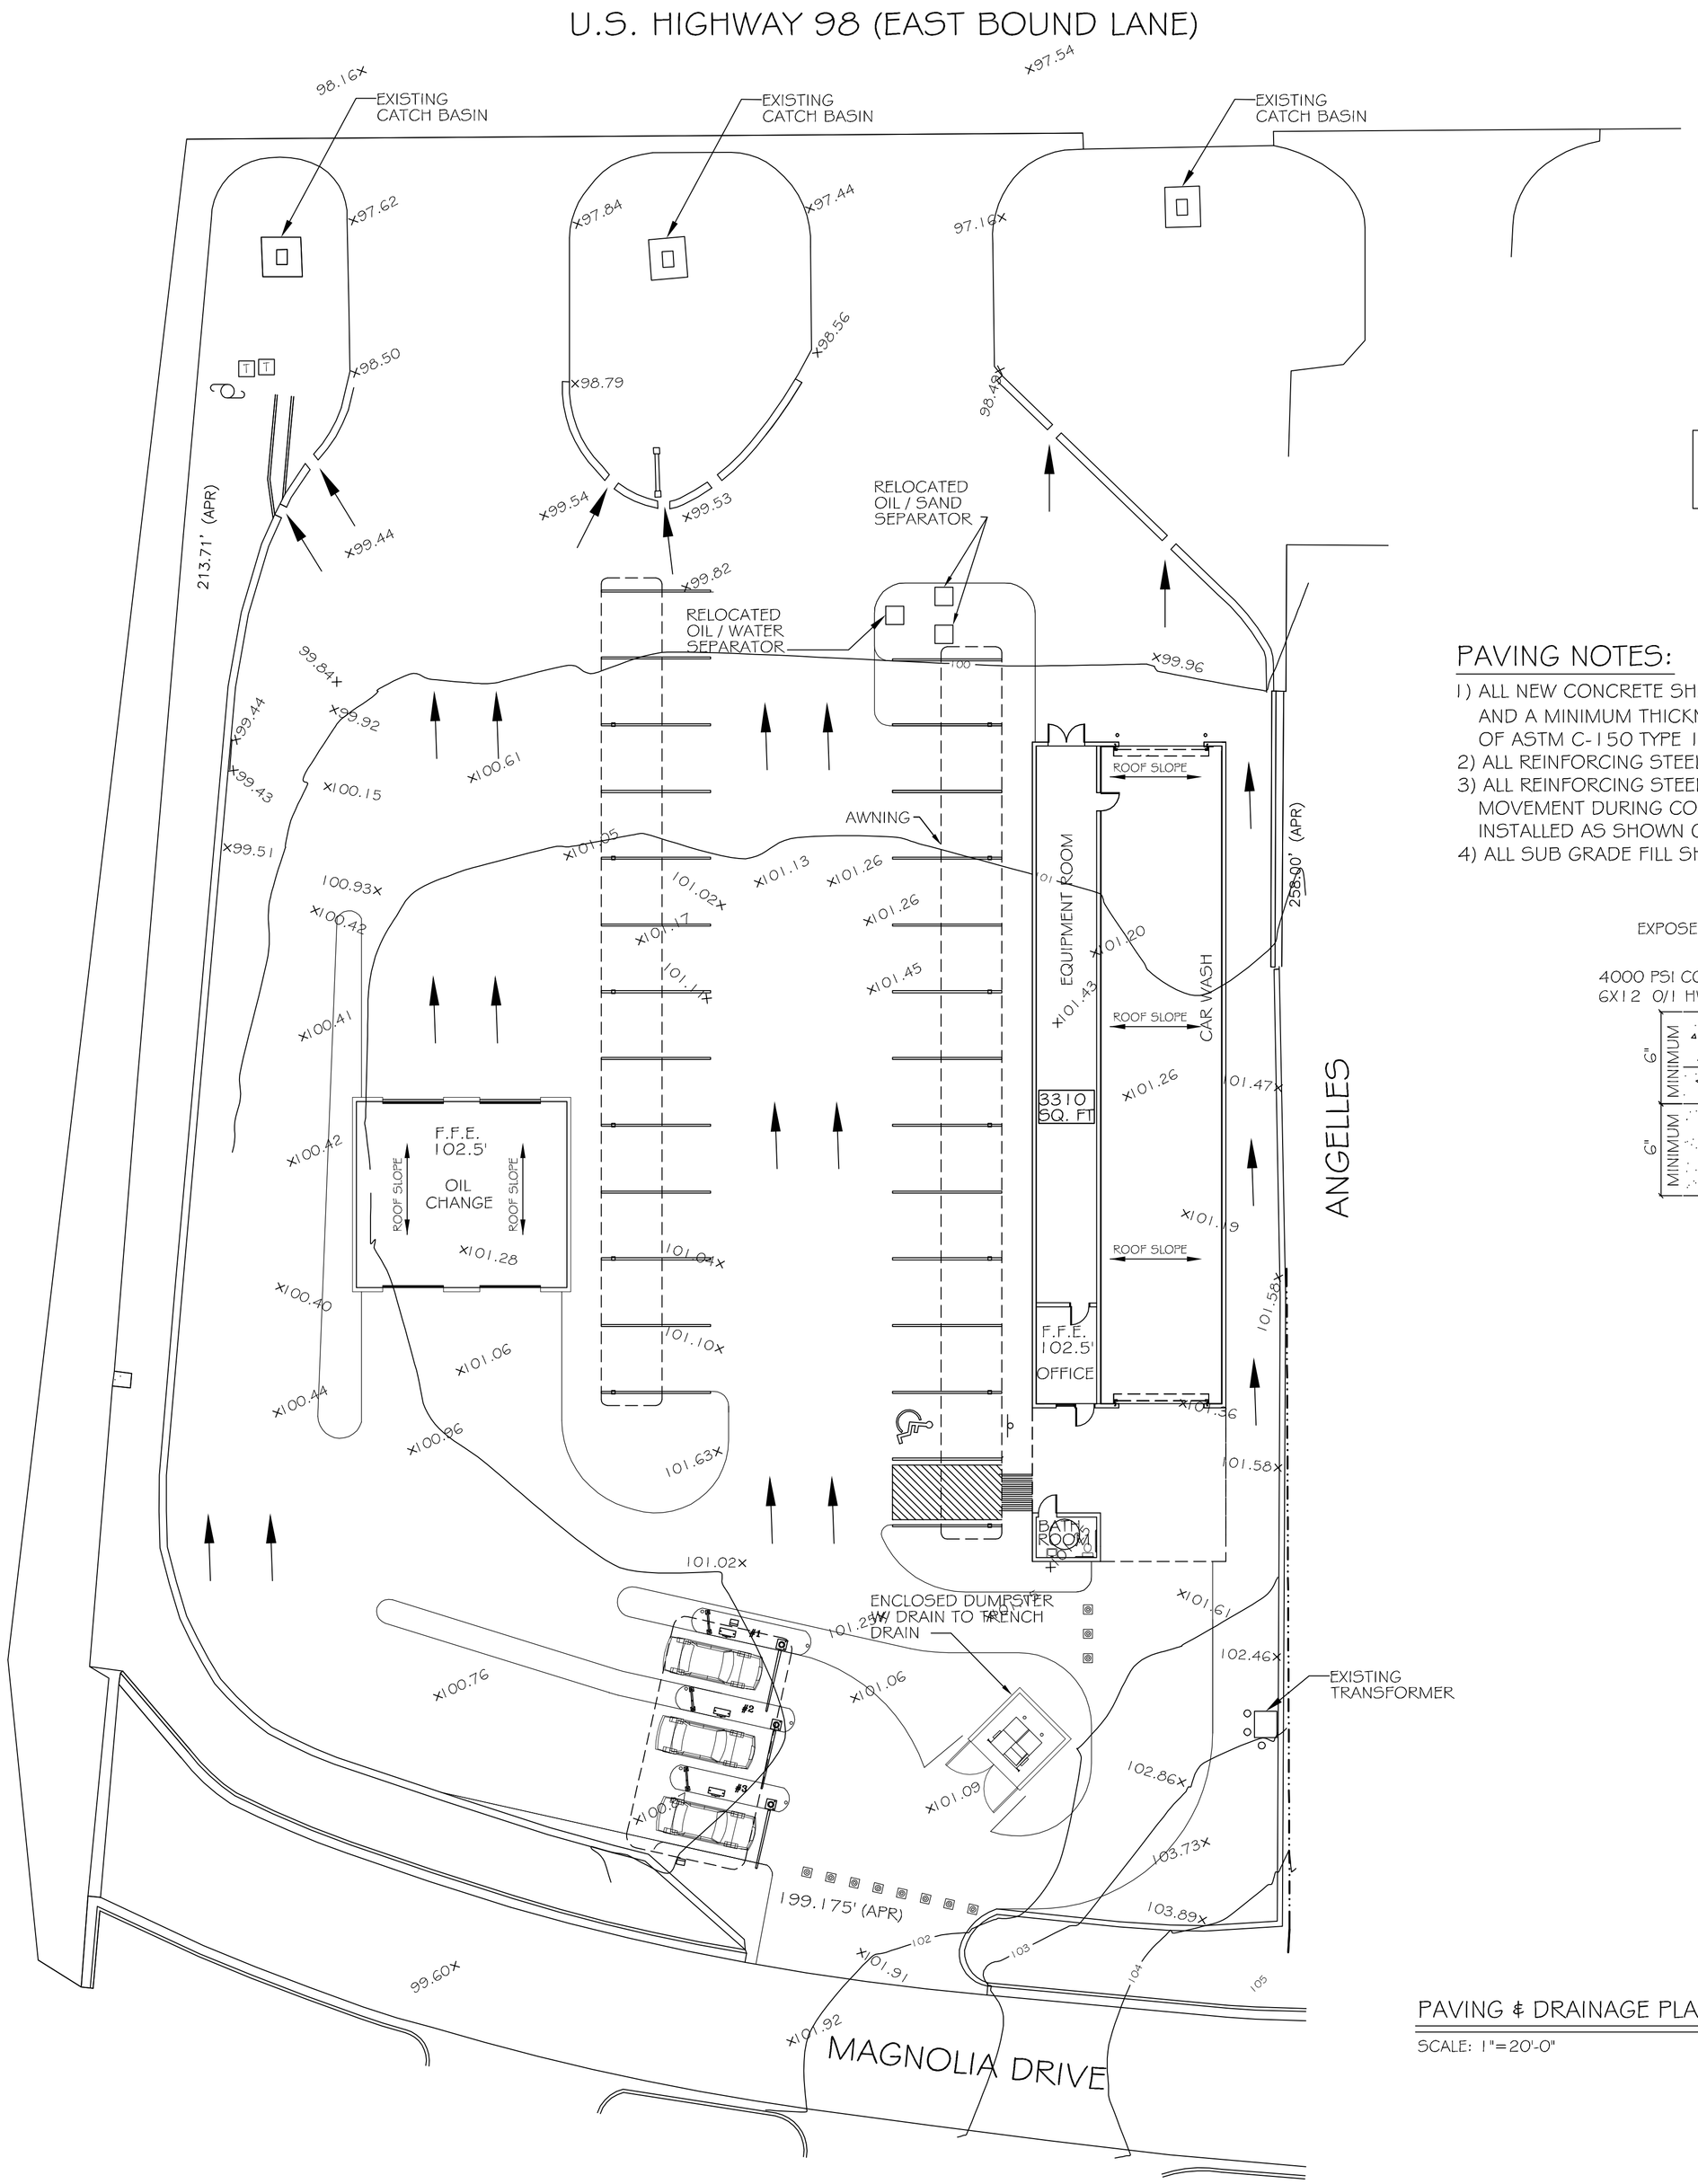

LEGEND

← - SLOPE LINES

x00.00' - EXISTING ELEVATIONS

NOTE:
ALL WATER SHALL SHEET FLOW INTO THE EXISTING CATCH BASINS LOCATED AT FRONT OF PROPERTY.

PAVING NOTES:

1) ALL NEW CONCRETE SHALL SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI AT 28 DAYS AND A MINIMUM THICKNESS OF 6". CONCRETE MIX SHALL BE IN ACCORDANCE WITH THE LATEST REVISION OF ASTM C-150 TYPE 1.
2) ALL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
3) ALL REINFORCING STEEL SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT. ALL CONTROL AND EXPANSION JOINTS SHALL BE LOCATED AND INSTALLED AS SHOWN ON THE PAVING PLAN AND IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS.
4) ALL SUB GRADE FILL SHALL BE COMPACTED TO 95 % PROCTOR.

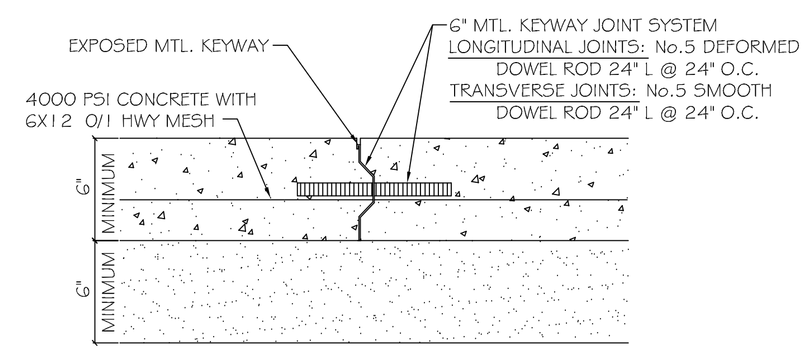

PAVEMENT JOINT DETAIL
N.T.S.

PAVING & DRAINAGE PLAN
SCALE: 1"=20'-0"

DAMMON ENGINEERING, INC.
dammoneng@bellsouth.net
PHONE: 985-649-3832
FAX: 985-641-5950
CHIEF ENGINEER: EMMETT DAMMON, P.E.
554 OLD SPANISH TRAIL
SLIDELL, LA 70458

The drawings, plans and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering and may not be used in whole or in part without the consent of Dammon Engineering. They are not to be used on any other project. Upon request, they will be returned to Dammon Engineering. Visual contact with these drawings and specifications shall constitute prima facie evidence of acceptance of these restrictions.

RAINFOREST CARWASH
502 S HANDY ST.
HATTIESBURG, MISSISSIPPI

JOB No:	DATE:	CHECKED BY:
2158	05-14-2013	CD
DRAWN BY: JCT		

REVISIONS

#	DESCRIPTION	DATE

PAVING & DRAINAGE PLAN

SHEET No: C3