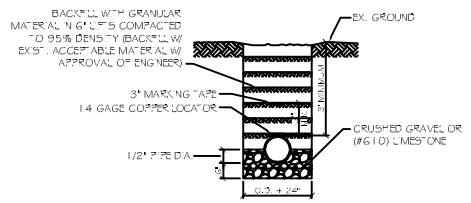

PIPE BEDDING DETAIL FOR SEWER AND WATER

SCALE: N.T.S.

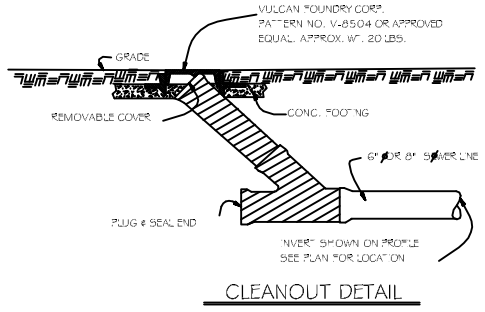

CLEANOUT DETAIL

N.T.S.

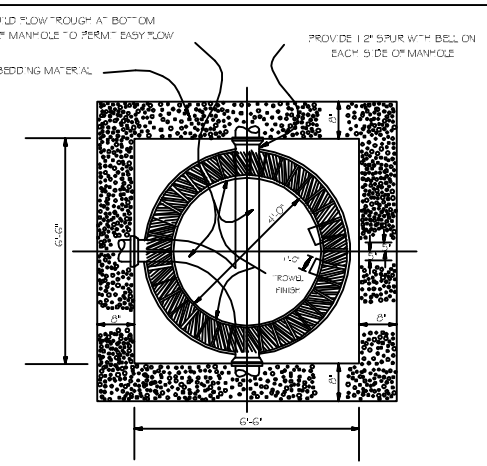

TYPICAL SEWER MANHOLE BOTTOM

N.T.S.

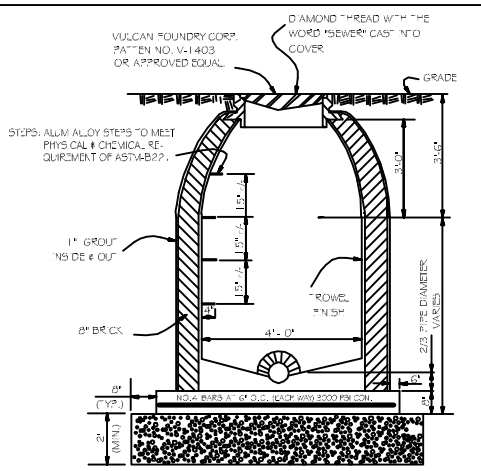

TYPICAL STANDARD SEWER MANHOLE

N.T.S.

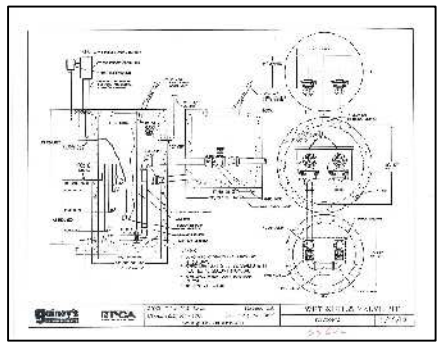

TYPICAL PUMP STATION LAYOUT

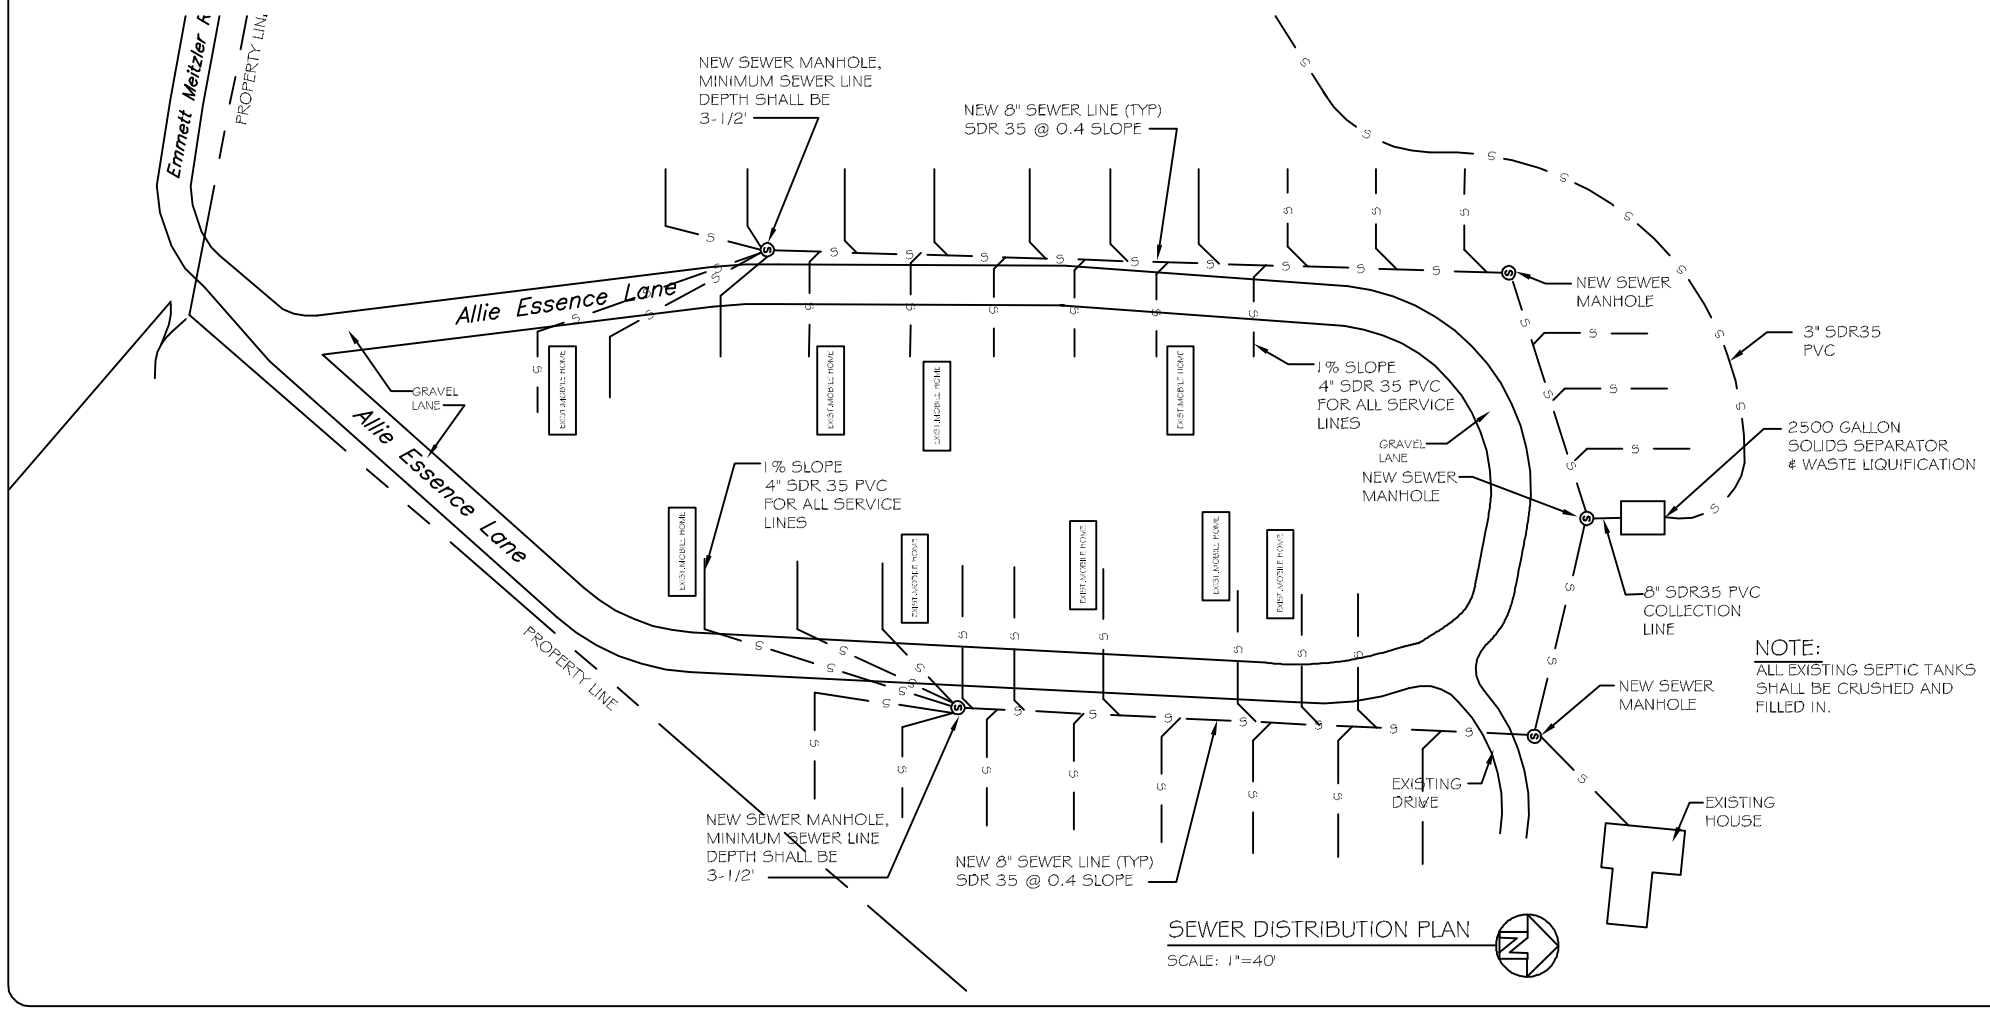

SEWER DISTRIBUTION PLAN

SCALE: 1"=40'

PLUMBING NOTES:

1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM.
2. ALL WORK AND MATERIAL SHALL CONFORM STRICTLY TO THE LOCAL CITY, COUNTY, STATE AND NATIONAL GOVERNING CODES.
3. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS AND SIZES PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR PUBLIC UTILITIES CONNECTIONS.
4. CONTRACTOR IS RESPONSIBLE TO VERIFY THE EXISTING INVERTS AND BE FOR INVERTS OF SEWERAGE AND DRAINAGE PIPES.
5. SEWERAGE LINES 3" INCH AND SMALLER SHALL BE SLOPED ¼" PER FOOT AND LINE 4" INCH AND LARGER SHALL BE ⅛" PER FOOT.
6. TEST ALL PIPING AT REQUIRED PRESSURE.
7. ALL PLUMBING SHALL BE CLOSELY COORDINATED WITH WATER SYSTEM.
8. DO NOT SCALE DRAWINGS.
10. ALL SEWER LINES SHOWN ARE DIAGRAMATIC.

PRELIMINARY (NOT FOR CONSTRUCTION)

DAMMON ENGINEERING, INC.

dammoneng@aol.com
dammoneng.com
PHONE: 985-649-5032
FAX: 985-644-5950

CHIEF ENGINEER: EMMETT DAMMON, P.E.
554 OLIVIER TRAIL
SLIDELL, LA 70458

DREAMLAND MOBILE HOME PARK
SYSTEM UPGRADE & REHABILITATION

ALLIE ESSENCE LANE
NICHOLSON, MISSISSIPPI

JOB No:	DATE:	CHECKED BY:	DRAWN BY:
2182	09-18-2013	BM	JTL

#	DESCRIPTION	DATE
1	-	

REVISIONS

SEWER DISTRIBUTION PLAN

SHEET No: 2 OF 3

C – 2