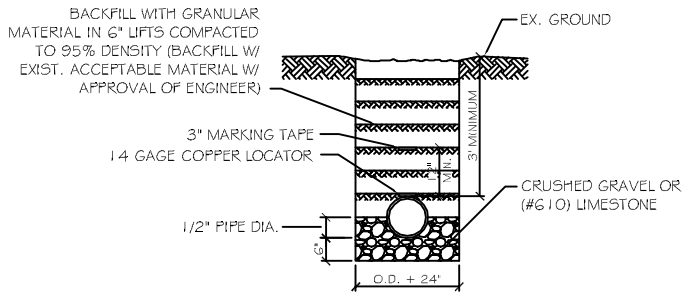

NOTE: A MINIMUM 10' HORZ. AND 18" VERT. SEPARATION (WITH WATER MAIN ON TOP) IS REQUIRED BETWEEN WATER AND SEWER LINES.

PIPE MAIN BEDDING DETAIL FOR SEWER AND WATER

SCALE: N.T.S.

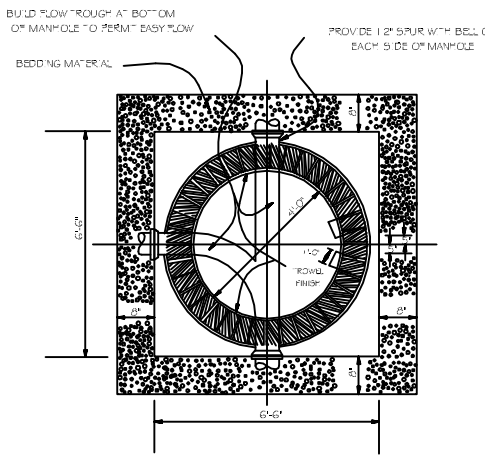

TYPICAL SEWER MANHOLE BOTTOM

N.T.S.

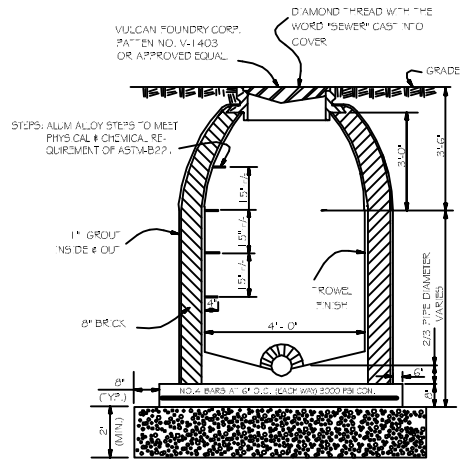

TYPICAL STANDARD SEWER MANHOLE

N.T.S.

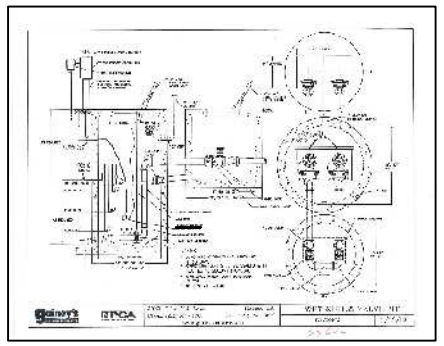

TYPICAL 72" PUMP STATION LAYOUT

2 ZOLLER PUMPS, MODEL #820
WITH CONTROLS & QUICK DISCONNECT

EXISTING TRAILER PARK 3.4 ACRE (ADDITION OF SEWER PUMP STATION/ FORCE MAIN & POTABLE WATER TO CONNECT WITH NICHOLSON WATER & SEWER ASSOCATION, INC.)

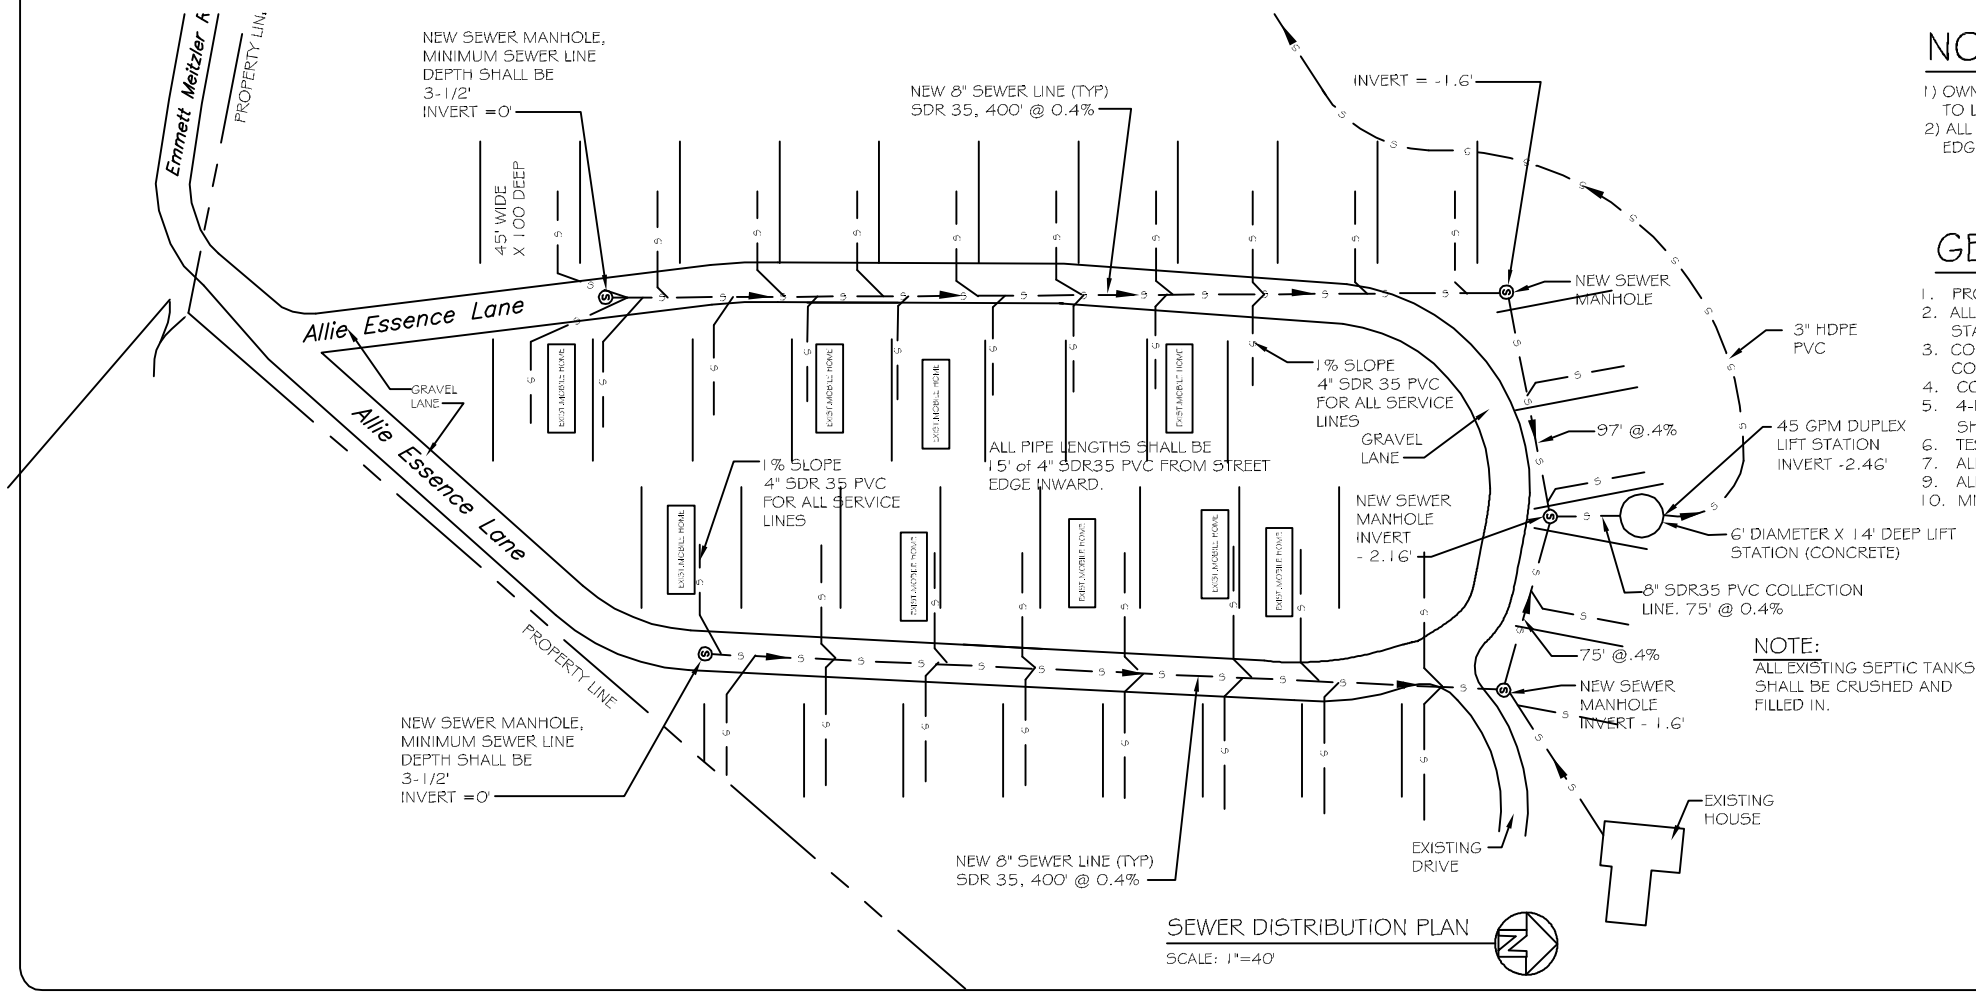

SEWER DISTRIBUTION PLAN

SCALE: 1"=40'

NOTE:

1) OWNER SHALL IDENTIFY ALL TRAILER SPACING FOR CONTRATOR TO LAYOUT SEWER WORK.
2) ALL PIPE LENGTHS SHALL BE 15' of 4" SDR35 PVC FROM STREET EDGE INWARD.

GENERAL NOTES:

1. PROVIDE ALL LABOR, MATERIAL AND EQUIPMENT FOR A COMPLETE OPERATING SYSTEM.
2. ALL WORK AND MATERIAL SHALL CONFORM STRICTLY TO THE LATEST LOCAL, CITY, COUNTY, STATE AND NATIONAL GOVERNING CODES.
3. CONTRACTOR IS TO FIELD VERIFY ALL EXISTING UTILITY LOCATIONS, ELEVATIONS AND SIZES PRIOR TO COMMENCING ANY WORK. CONTRACTOR SHALL PAY NECESSARY FEES FOR THE UTILITIES CONNECTIONS.
4. CONTRACTOR IS RESPONSIBLE TO SET NEW INVERTS OF SEWERAGE PIPES.
5. 4-INCH SEWER LINES SHALL BE SLOPED 1/8" PER FOOT. SHALL BE 1/8" PER FOOT.
6. TEST ALL PIPING AT REQUIRED PRESSURE.
7. ALL PLUMBING SHALL BE CLOSELY COORDINATED WITH WATER SYSTEM.
9. ALL SEWER LINES SHOWN ARE DIAGRAMATIC.
10. MINIMUM PIPE MAIN BURIAL SHALL BE 3'-0"

NOTE:

ALL EXISTING SEPTIC TANKS SHALL BE CRUSHED AND FILLED IN.

DAMMON ENGINEERING, INC.
Architects & Engineers
CHIEF ENGINEER, BRIAN MISTICH, P.E.
CHIEF ARCHITECT, KEVIN KINCHEN
554 OLD SPANISH TRAIL
SLIDELL, LA 70459
dammoneng@bellsouth.net
PHONE: 985-641-5932
FAX: 985-641-5950

DREAMLAND MOBILE HOME PARK
ALLIE ESSENCE LANE
NICHOLSON, MISSISSIPPI

JOB No: 2182
DATE: 05-19-2014
DRAWN BY: CKD
CHECKED BY: BM

#	DESCRIPTION	DATE
	REVISIONS	

SEWER DISTRIBUTION PLAN

SHEET No: 02 OF 03

C2