



BACKFILL WITH GRANULAR MATERIAL IN 6" LIFTS COMPACTED TO 95% DENSITY (BACKFILL W/ EXIST. ACCEPTABLE MATERIAL W/ APPROVAL OF ENGINEER)

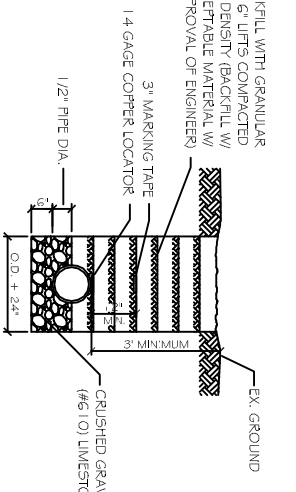


NOTE: A MINIMUM 1'0" HORIZ. AND 1'8" VERT. SEPARATION IS REQUIRED BETWEEN WATER AND SEWER LINES.

PIPE BEDDING DETAIL FOR SEWER AND WATER
SCALE: N.T.S.

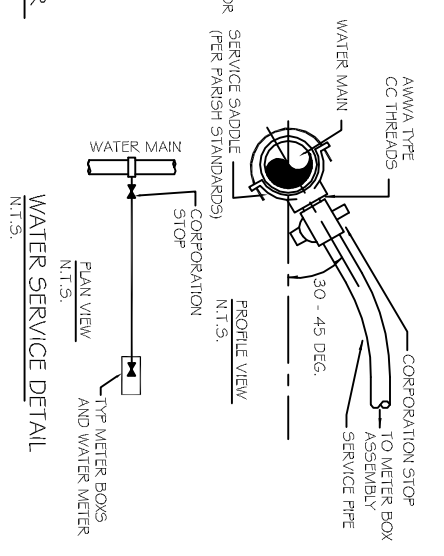


WATER SERVICE DETAIL
N.T.S.

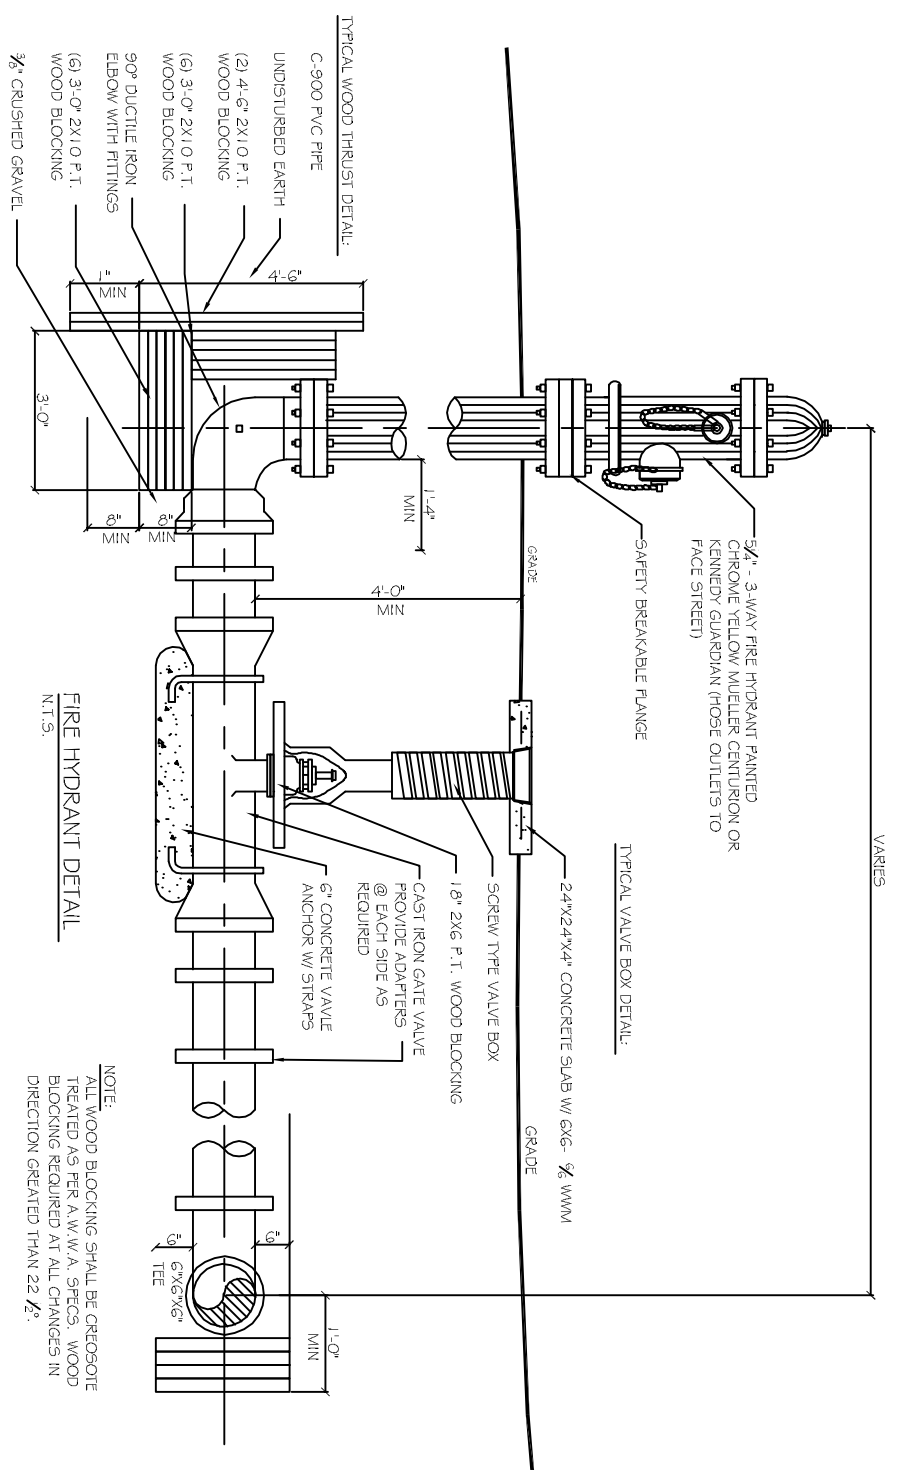

FIRE HYDRANT DETAIL
N.T.S.

NOTE:
ALL WOOD BLOCKING SHALL BE CREOSOTE TREATED AS PER A.W.W.A. SPECS. WOOD BLOCKING REQUIRED AT ALL CHANGES IN DIRECTION GREATER THAN 22 1/2°.

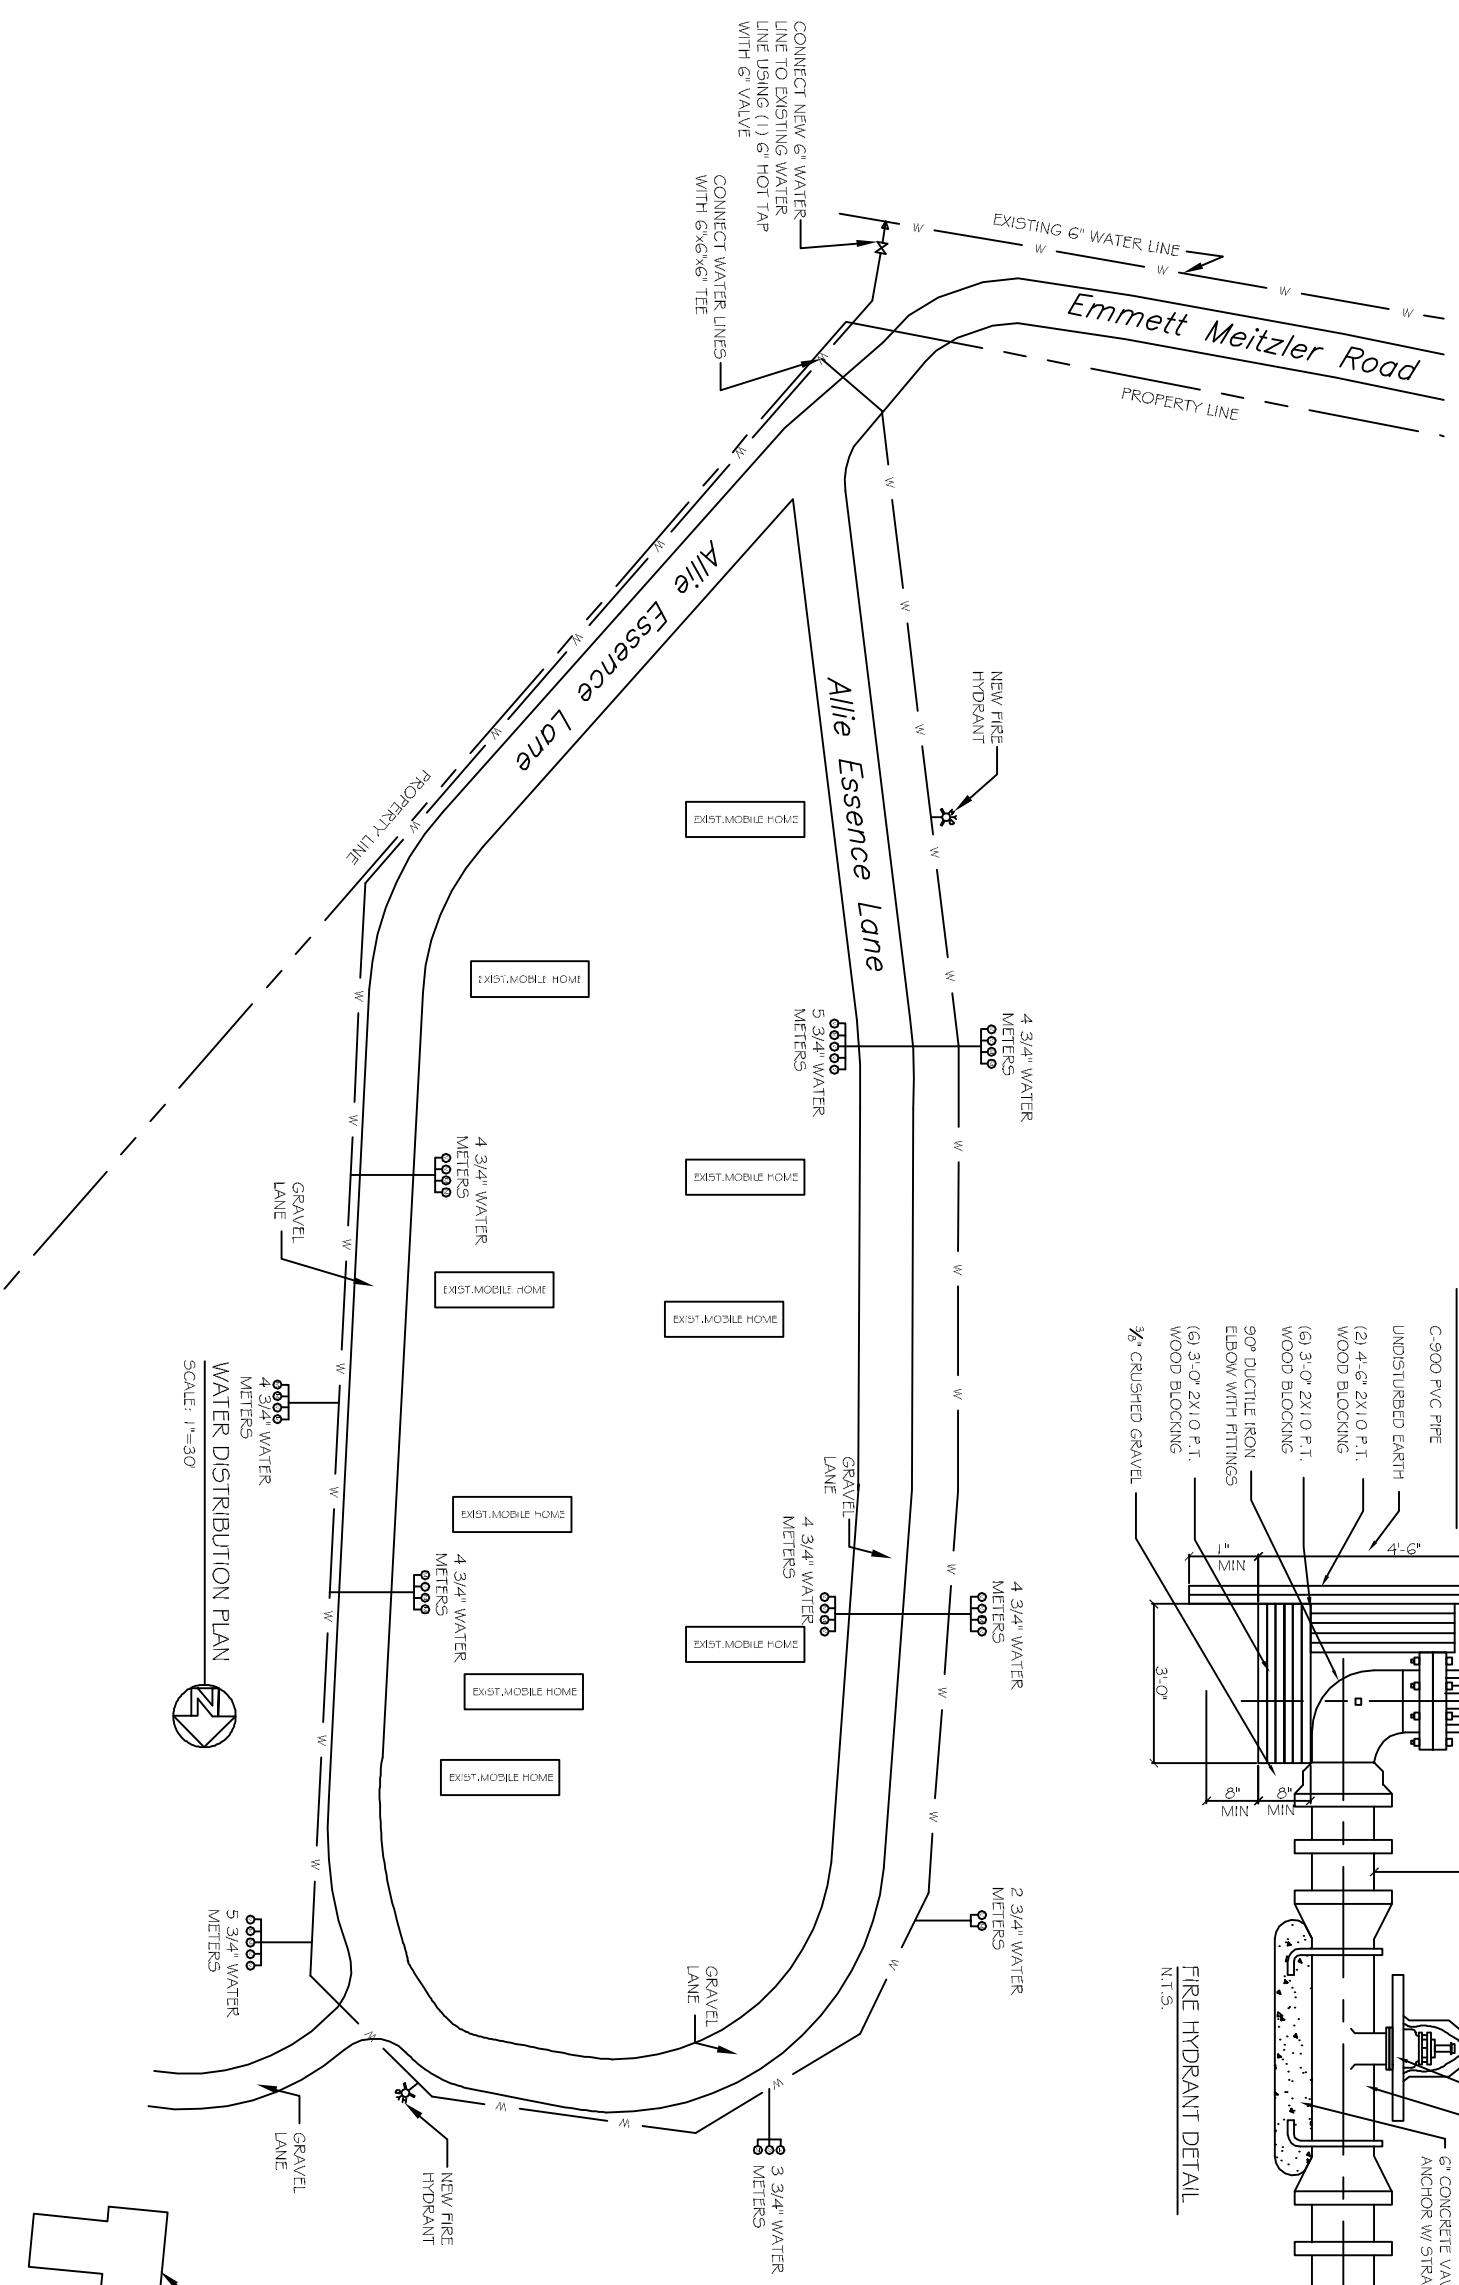

WATER DISTRIBUTION PLAN
SCALE: 1"=30'

| REVISIONS | | |
|-----------|-----------------|------------|
| # | DESCRIPTION | DATE |
| 1 | ADDED SIDEWALKS | 07-15-2013 |
| | | |
| | | |
| | | |
| | | |
| | | |

DREAMLAND MOBILE HOME PARK SYSTEM UPGRADE & REHABILITATION

ALLE ESSENCE LANE
NICHOLSON, MISSISSIPPI

JOB No: 2182 DATE: 08-06-2013

DRAWN BY: JTL CHECKED BY: CD

DAMMON ENGINEERING, INC.

CHIEF ENGINEER: EMMETT DAMMON, P.E.

554 OLD SPANISH TRAIL
SUDELL, LA 70450

dammonegineering.com
dammoneng@dammoneng.net
PHONE: 985-649-5832
FAX: 985-641-5950

WATER DISTRIBUTION PLAN

SHEET No: C-3

- OF -