PARKING

1 - WELCOME OFFICE 1,400 SQ. FT. WITH 15 PARKING PLACES

5 - SHOWER / WASHER AREA = 607 SQ. FT. EACH

R/V PARKING

38 - 21' X 30' R/V PADS
54 - 21' X 70' R/V PADS

TOTAL OF 92 PARKING PADS

Tim:

I am leaving it up to you coordinate the power lines with the piping.

I drew in the underground feeders, but the routing should be modified to minimize the amount of trenching needed.

RED is 480V GREEN IS 240V

Please use different line fonts to designate the voltage as follows:

– – – – – – – 240V UNDERGROUND FEEDER
—— – – —— 480V UNDERGROUND FEEDER

Design concept:

I am writing this so that you can wrap your head around the design.
The 480V will come into the site at the pad mounted transformer and feed the Main Switchboard in the Welcome Center.
A 480V feed will be run from the Main Switchboard to each Restroom building.
Each restroom building will have a transformer and a 600 Amp Power Panel.
240V radial feeds will be routed from the Power Panels in the restroom, to a Power Pedestal at each Camp Site. The pedestals will be daisy chained together with a maximum of 6 Pedistals to a circuit.

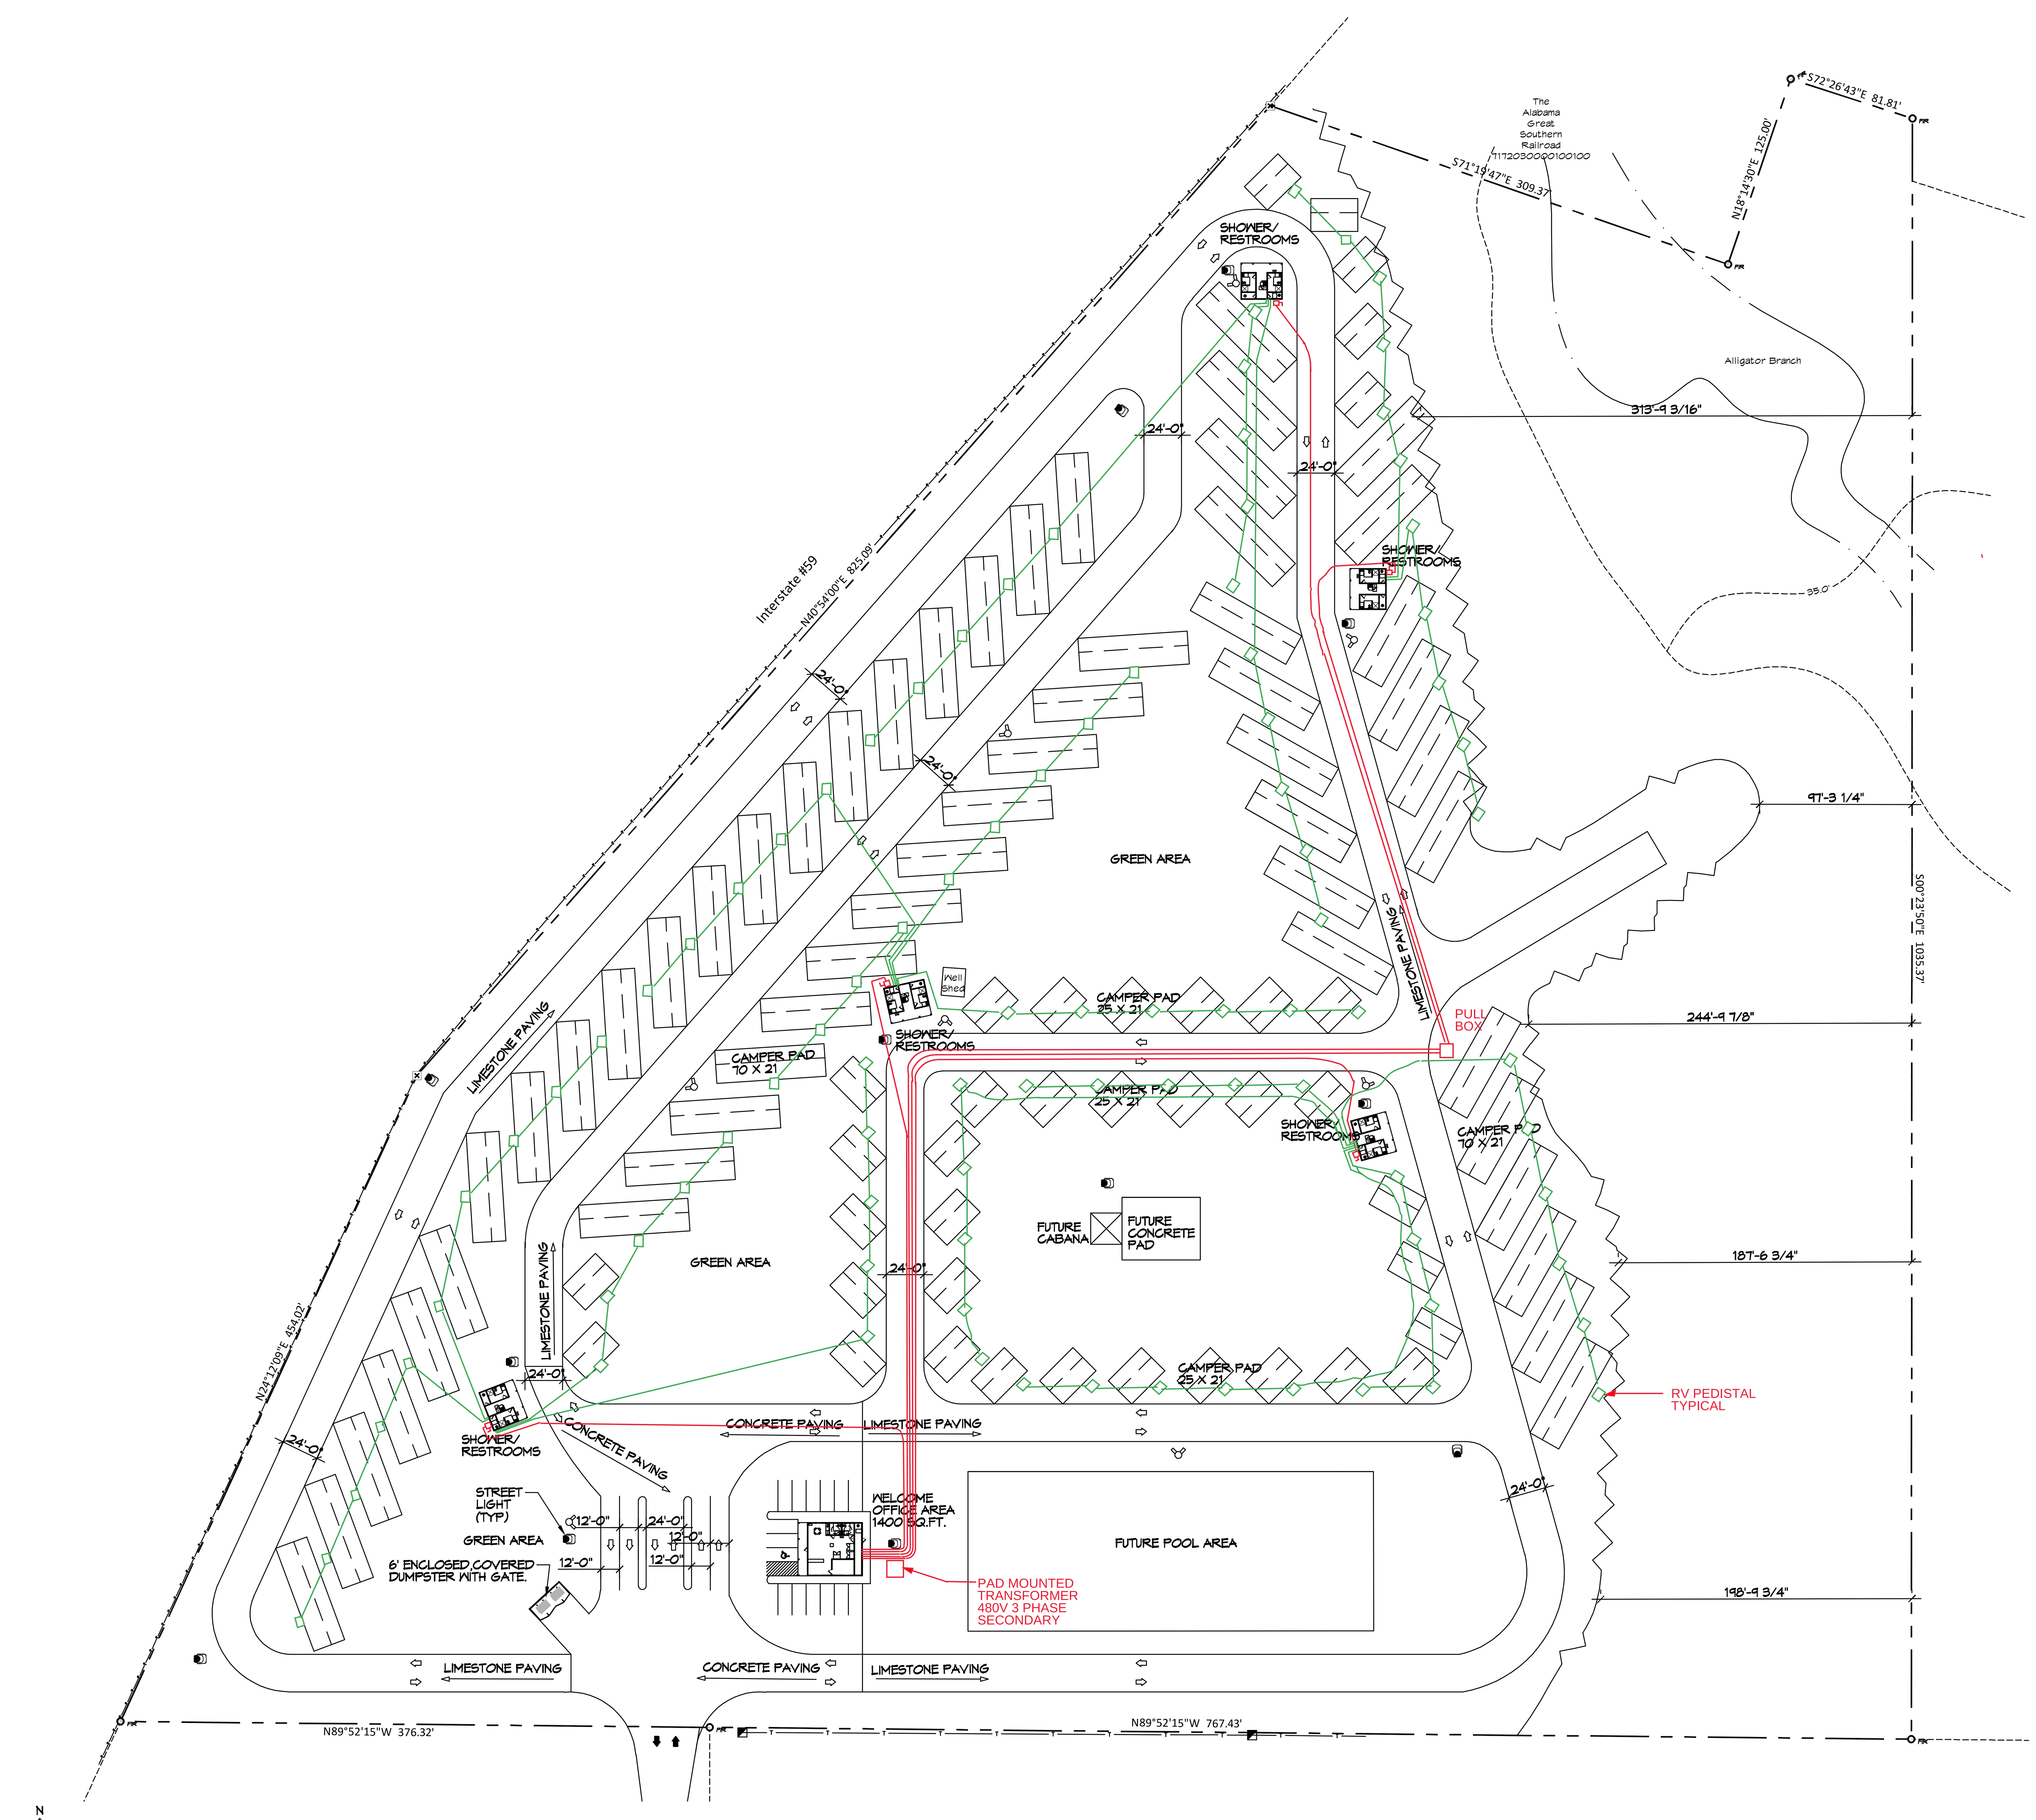

1 NEW RECREATIONAL R/V SITE
SCALE: 1" = 60'-0"

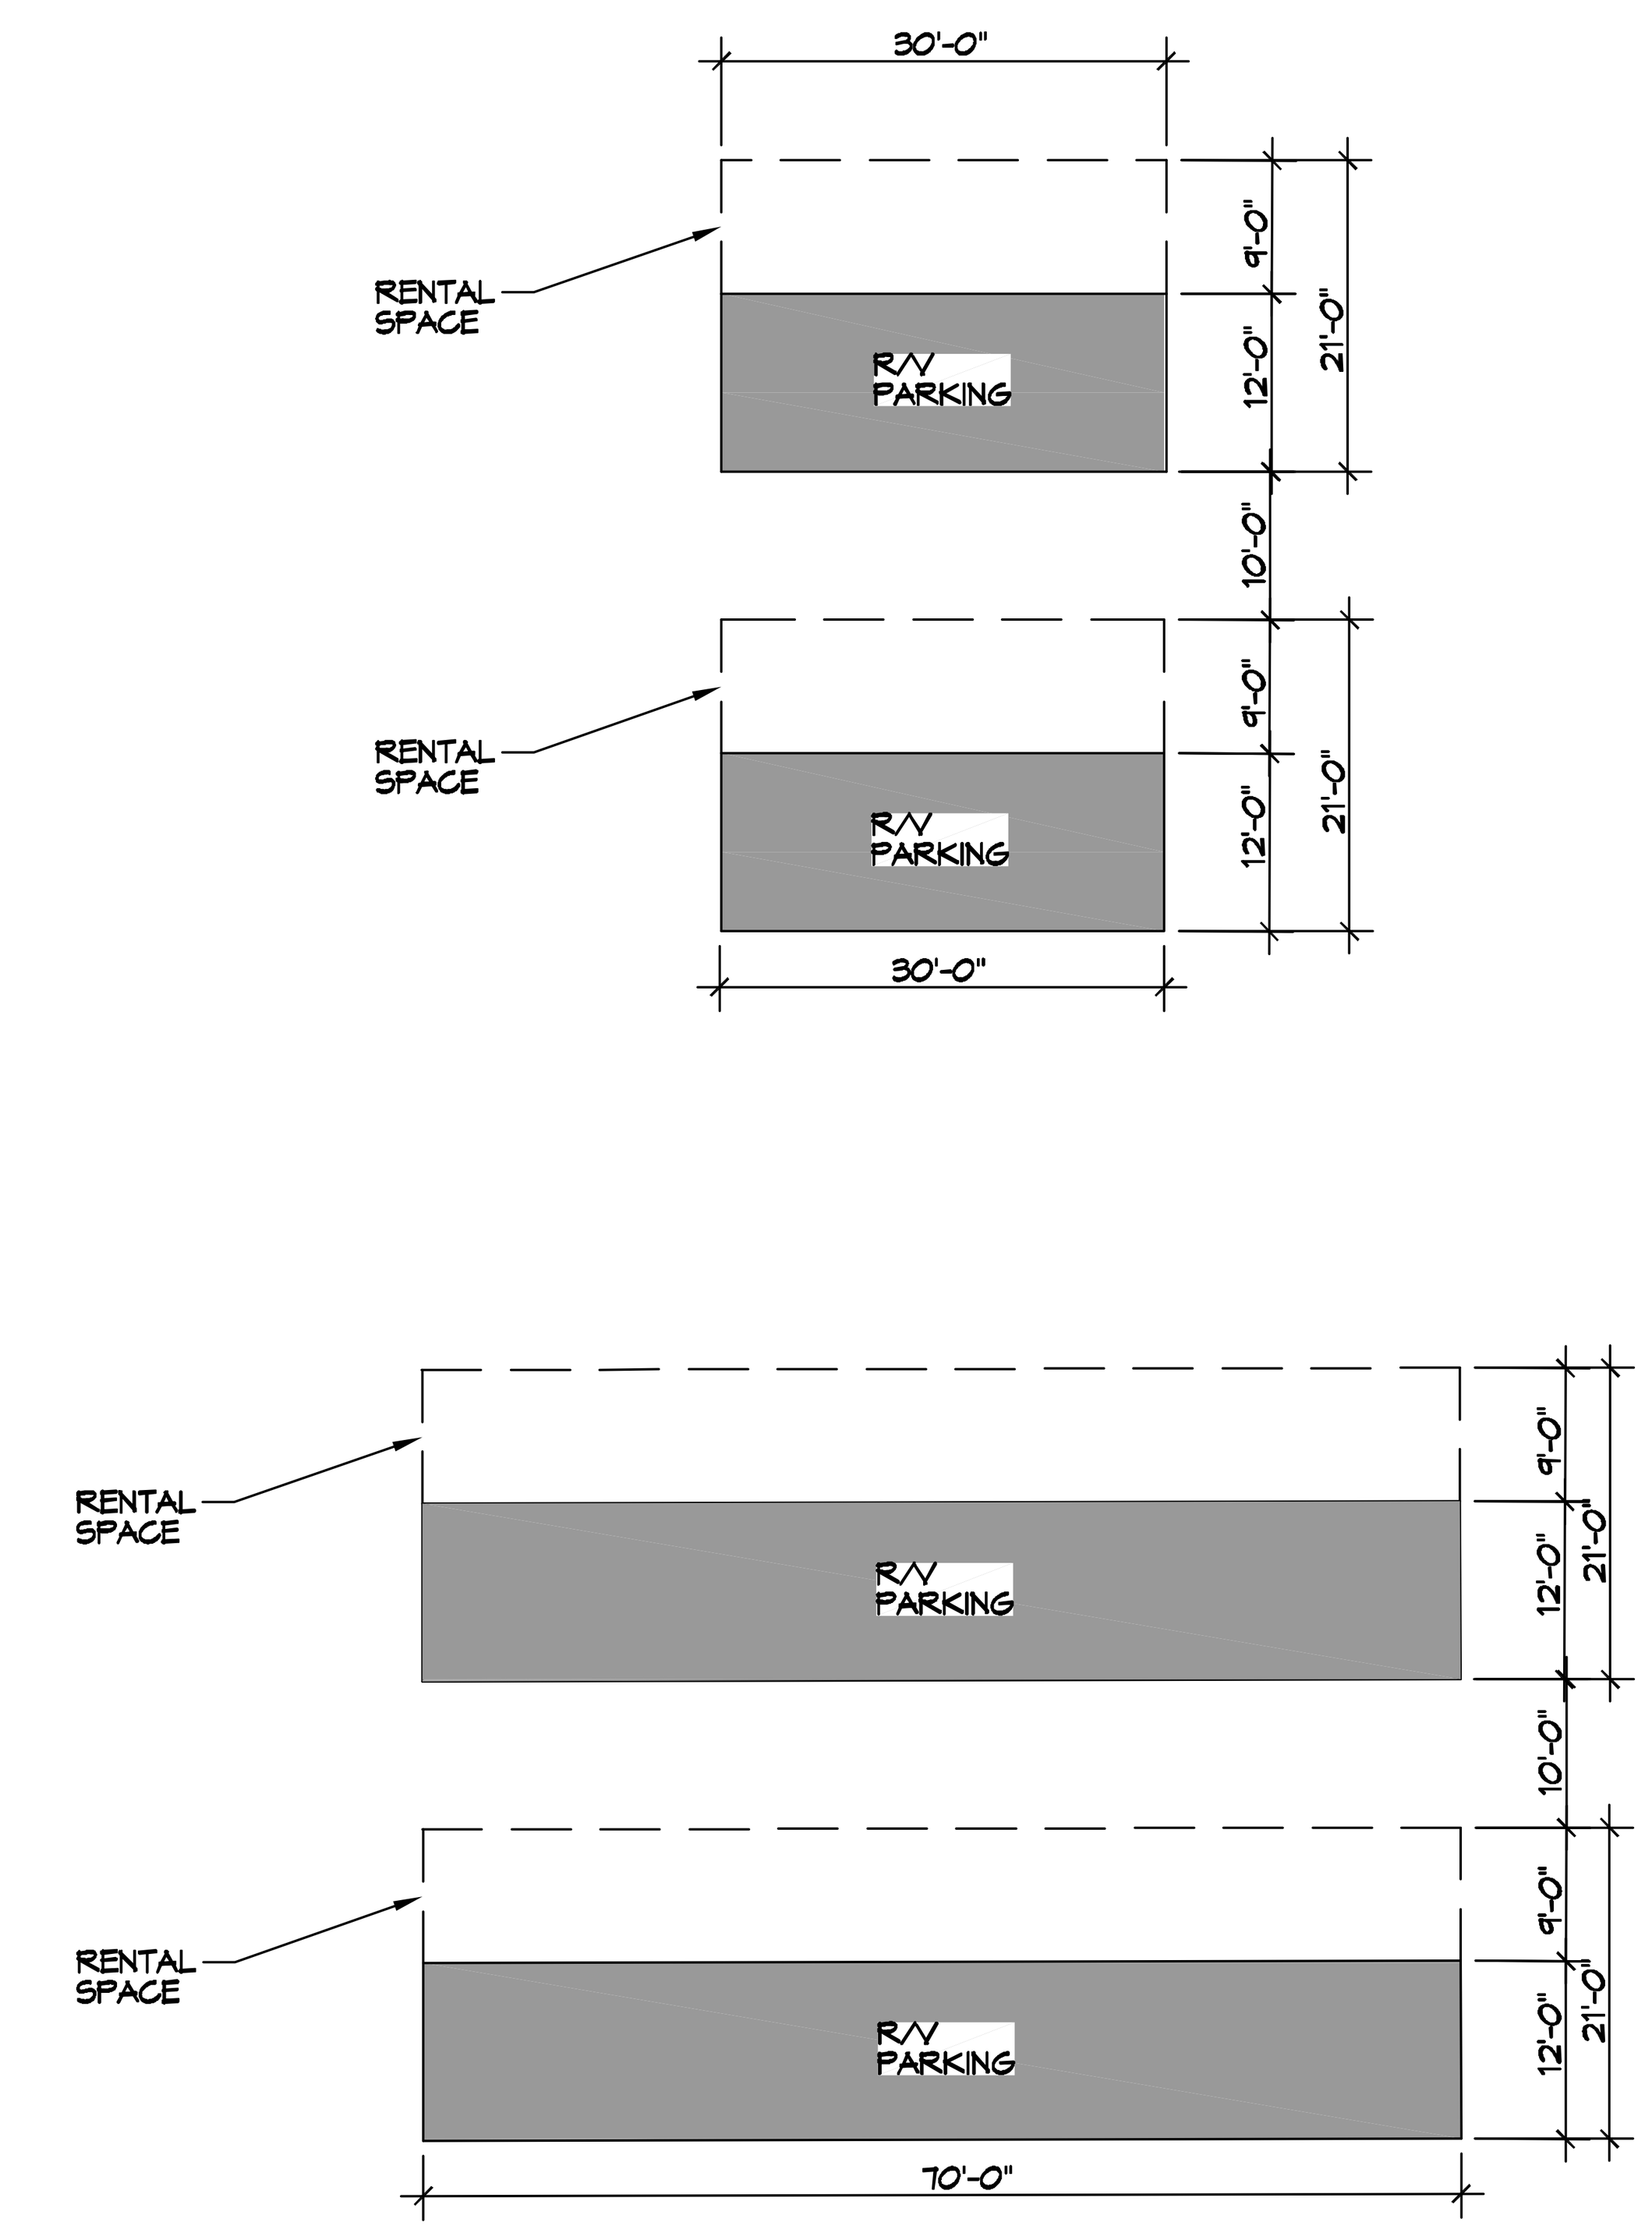

2 TYPICAL R/V PAD LAYOUT
SCALE: 1/16" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832

#	DESCRIPTION	DATE
REVISIONS		

SEAL:

NEW RECREATIONAL R/V SITE
EXIT 1 R.V. RESORT, LLC.
CLYDE MEITZER ROAD
NICHOLSON MS MISSISSIPPI 39466

JOB No:	2436	DATE:	01-31-2022
DRAWN BY:	CKD	CHECKED BY:	CKD

SHEET TITLE:
OVERALL R/V SITE PLAN

DRAWING NUMBER:
C101

SHEET No: 1 of 1