NOTES FOR BILL

- SQUARE FEET: 3585
- WE ARE USING A 10 TON AHU.
- REUSING EXISTING SUPPLY GRILLES AND DUCTWORK.
- BOTH RESTROOMS REQUIRE NEW EQUIPMENT.
- VERIFY WE HAVE ENOUGH RETURN AIR GRILLES. 2'X4' RETURN AIR GRILLE HAS TO BE RELOCATED.

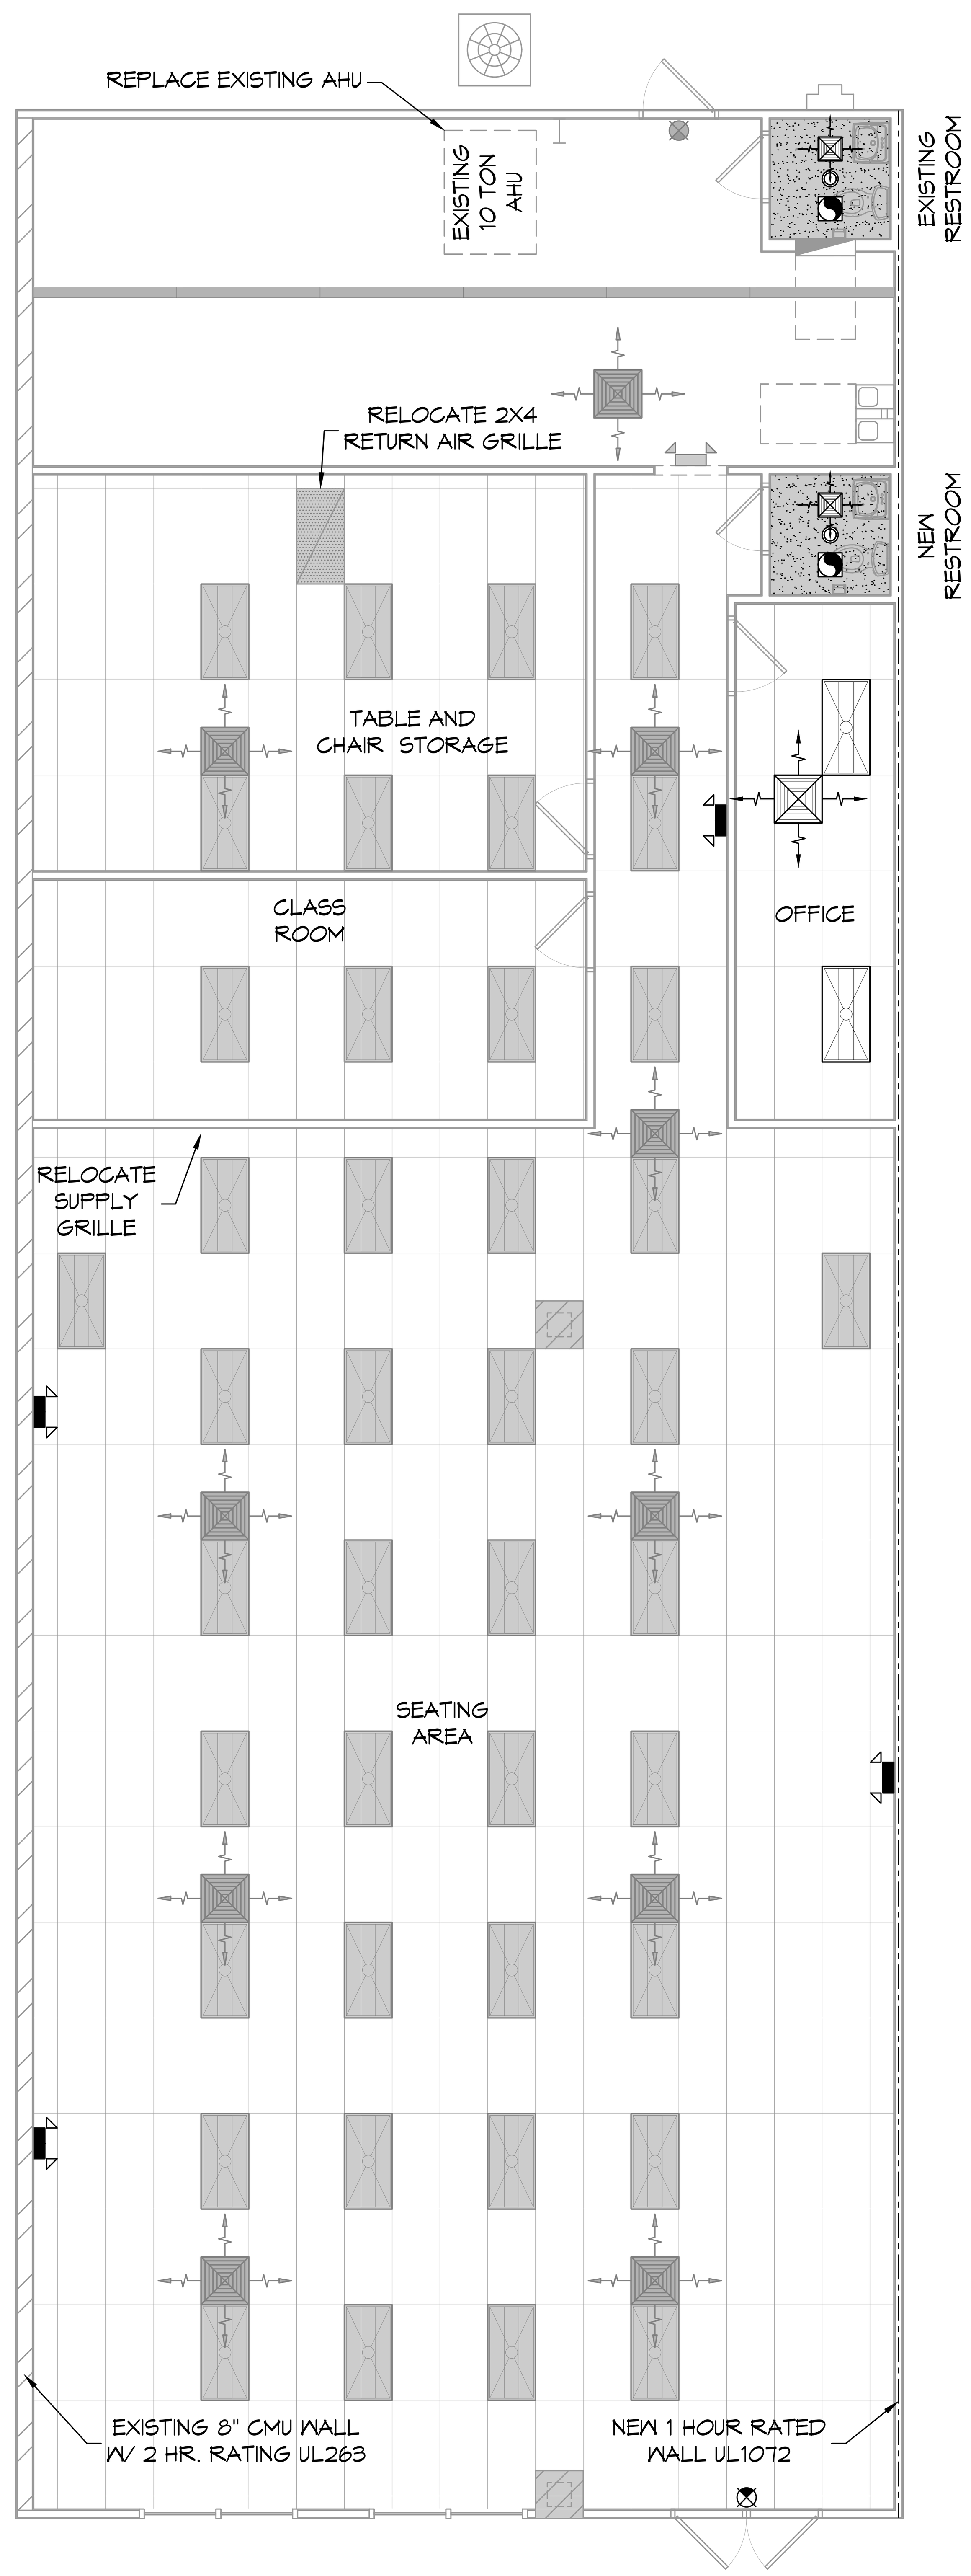

3 REFLECTIVE CEILING PLAN
SCALE: 3/16"=1'-0"

LIGHTING LEGEND

- EXISTING CEILING MOUNTED EXIT LIGHT
- NEW CEILING MOUNTED EXIT LIGHT
- EXISTING EMERGENCY LIGHT
- NEW EMERGENCY LIGHT
- EXISTING 2X4 LIGHT FIXTURE
- NEW 2X4 LIGHT FIXTURE
- NEW 6" RECESSED LIGHT FIXTURE
- EXISTING 6' FLUORESCENT LIGHT FIXTURE

NOTE: REUSE EXISTING LIGHTS. REPLACE MISSING OR DAMAGED LIGHTS

MECHANICAL LEGEND

- EXISTING 24X24 SUPPLY AIR GRILLE
- NEW 12X12 SUPPLY AIR GRILLE
- NEW EXHAUST FAN
- EXISTING 24X24 RETURN AIR GRILLE
- EXISTING 24X24 RETURN AIR GRILLE

NOTE: REUSE EXISTING DUCTS. REPLACE MISSING OR DAMAGED EQUIPMENT

CEILING LEGEND

- EXISTING 2X4 SUSPENDED CEILING GRID
- NEW SHEET ROCK

NOTE: REUSE EXISTING CEILING GRID. REPLACE MISSING OR DAMAGED TILES

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832 F: 985.641.5950

#	DESCRIPTION	DATE

REVISIONS

REID MOCHERMAN
IGLESIA CRISTIANA LLINAJE DE CRISTO INC.
1000 CARUSO BLVD, BUILDING 1 UNIT 165 SLIDELL, LA 70461

JOB No:		DATE:	11/29/2021
DRAWN BY:	RLD	CHECKED BY:	JAS

The above drawings and specifications, designs and arrangements represented thereby are and shall remain the property of Dammon Engineering, and no part thereof shall be copied, disclosed to others, or used in connection with any work or project other than the specific project for which the have been prepared and developed without written consent of Dammon Engineering. Visual contact with these drawings or specifications shall constitute conclusive evidence of acceptance of these restrictions.

SHEET TITLE:
REFLECTIVE CEILING PLAN

DRAWING NUMBER:
A100

SHEET No: 3 of XX