


- PLAN NOTES, UNLESS NOTED OTHERWISE:**
- TOP OF SLAB EL. 60'-0". TOP OF SLAB AT DEPRESSED ROOF EL. ?????.
 - EXISTING CONCRETE Waffle JOIST FLOOR SYSTEM (14'-3" CONCRETE SLAB=17"± TOTAL THICKNESS).
 - (E) - INDICATES EXISTING CONSTRUCTION.
 - (N) - INDICATES NEW CONSTRUCTION.
 - (S) - INDICATES FLOOR SYSTEM TO CONSIST OF LIGHT WEIGHT CONCRETE (1150CF, F=4000 psi) ON 1/2" DEEP 20 GAGE GALVANIZED COMPOSITE METAL DECKING. TOTAL THICKNESS=6". REINFORCE CONCRETE SLAB WITH 6x6-W1.4XW1.4 W.W.F. LOCATED 1" BELOW TOP OF SLAB. TOP OF STEEL EL. 59'-7 1/2". TOP OF STEEL AT DEPRESSED ROOF TERRACE SEE PLAN.
 - (I) - INDICATES NEW IN-FILL SLAB TO CONSIST OF 3" THICK CONCRETE SLAB THROUGHOUT (F=4,000PSI, NORMAL WEIGHT). TOP OF SLAB EL. TO MATCH EXISTING. COORD. WITH EXIST. FINISHES.
 - (T) - INDICATES NEW SLAB EXTENSION TO CONSIST OF 6" THICK CONCRETE SLAB THROUGHOUT (F=4,000PSI, NORMAL WEIGHT). TOP OF SLAB EL. TO MATCH EXISTING. COORD. WITH EXIST. FINISHES.
 - (L) - INDICATES FLOOR SYSTEM TO CONSIST OF LIGHT WEIGHT CONCRETE (1150CF, F=4000 psi) ON 1/2" DEEP 20 GAGE GALVANIZED COMPOSITE METAL DECKING. TOTAL THICKNESS=6". REINFORCE CONCRETE SLAB WITH 6x6-W1.4XW1.4 W.W.F. LOCATED 1" BELOW TOP OF SLAB. TOP OF STEEL EL. 59'-8 1/2".
 - (X) - INDICATES NEW EPOXY TOPPING SLAB AT EXISTING DEPRESSION.
 - (R) - INDICATES ROOF SYSTEM TO CONSIST OF 1/2" DEEP TYPE "20" 20 GAGE GALVANIZED METAL ROOF DECKING. SEE ARCHITECTURAL DRAWINGS FOR INSULATION & ROOF TOP OF DECKING.
 - (D) - INDICATES DIRECTION OF SPAN OF STEEL DECKING.
 - (W) - INDICATES W16x26 BEAM WITH 36"-3/4" AUTOMATIC END WELDED SHEAR CONNECTORS EQUALLY SPACED ALONG CENTERLINE OF BEAM. STUDS ARE TO BE FIELD INSTALLED.
 - (M) - INDICATES MOMENT CONNECTION. SEE SHEET S-1.
 - (S) - INDICATES MSC. OPNS. SEE S-1. COORD. SIZE & LOCATION W/ ARCH.
 - (B) - INDICATES BUILT UP FLOOR SYSTEM ON TOP OF CONCRETE ON METAL DECK TO CONSIST OF 3" CONCRETE SLAB ON RIGID STYROFOAM BOARD FILL. REINF. SLAB W/ 6x6-W1.4XW1.4 W.W.F. LOCATED AT MID-DEPTH OF SLAB.
 - (K) - INDICATES K-BRACING. SEE 3/2-7.
 - (S) - INDICATES SINGLE STRUT BRACING. SEE 4/2-7.

600 LEVEL FRAMING PLAN
1/8"=1'-0"

PRELIMINARY
NOT FOR CONSTRUCTION

No.	Date	Issue	No.	Date	Issue
1	12.23.10	SD PRICING SET			
2	01.18.11	100% SD SET			
3	05.18.11	LNO Meeting			
4	09.15.11	100% DD/ PRICING			

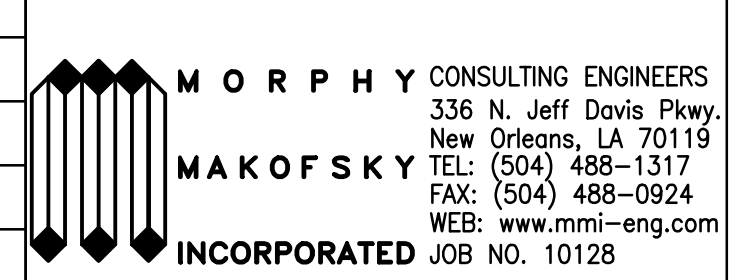

Holabird & Root / Holly & Smith LLC expressly disclaims any responsibility arising from any unauthorized use of these plans, drawings and notes. Any authorization must be in writing.
This drawing copy may have been reproduced at a size different than originally drawn. The Owner and Architect assume no responsibility for use of incorrect scale. Drawings are not to be scaled.
Not published - All rights reserved.

HOLABIRD & ROOT
140 South Dearborn Avenue
Suite 500
Chicago, IL 60660
312.357.1771 (toll)
312.357.1909 (fax)
www.holabird.com

HOLLY & SMITH LLC
541 Julia Street
Suite 201
New Orleans, LA 70130
504.585.1315 (toll)
504.585.1316 (fax)
www.hollyandsmith.com

Project Number	15248.00
Drawn	RAB
Checked	JAS
Proj. Arch./Eng.	JAS



600 LEVEL FRAMING PLAN
Sheet Name
Drawing No. S2-6