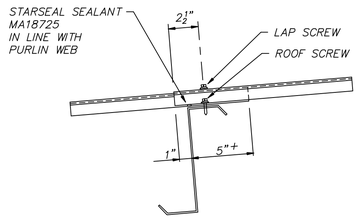


ENDLAP DETAIL




SIDELAP DETAIL

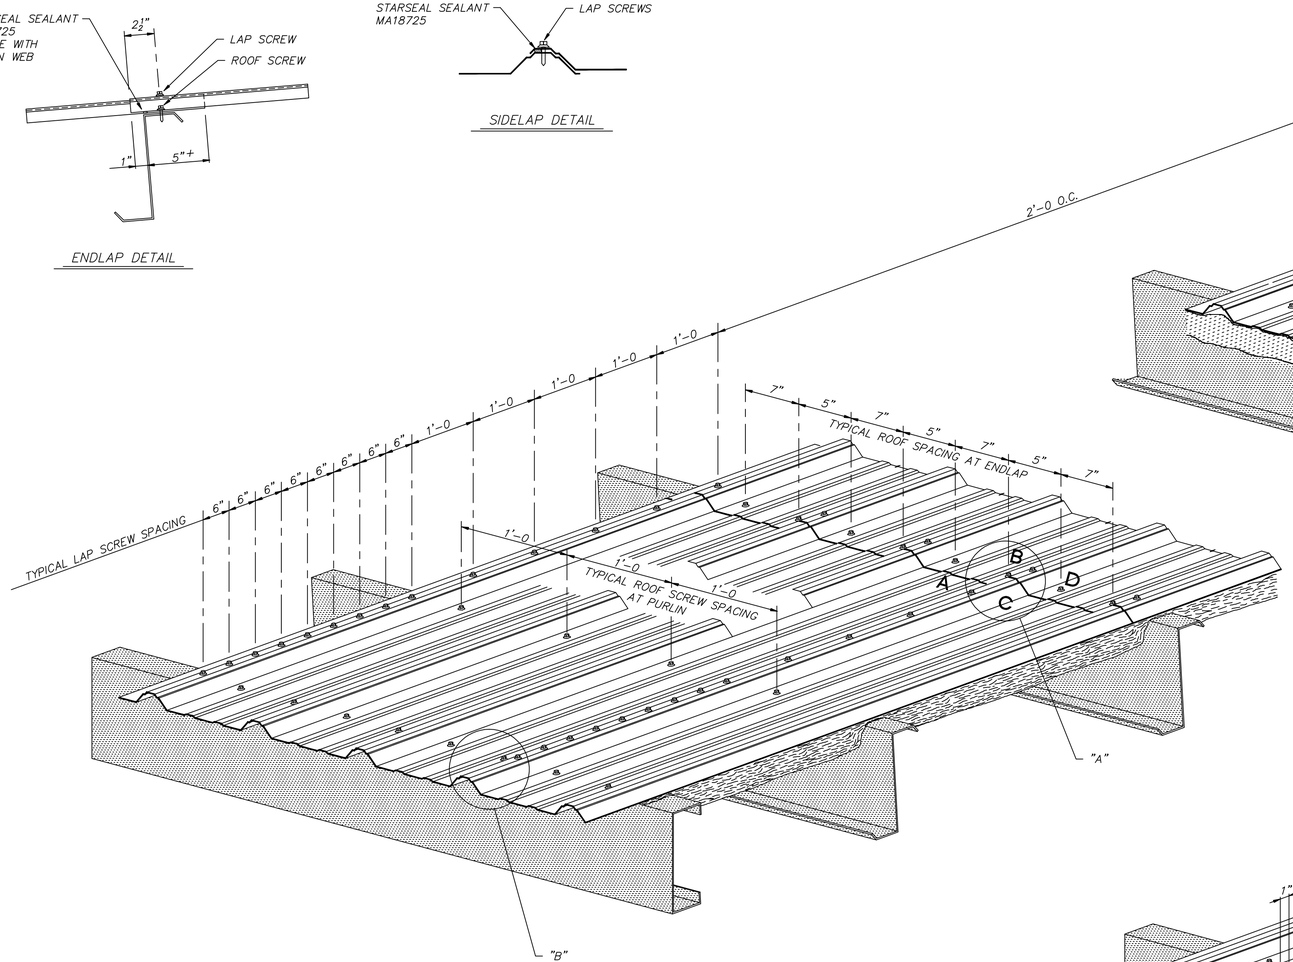


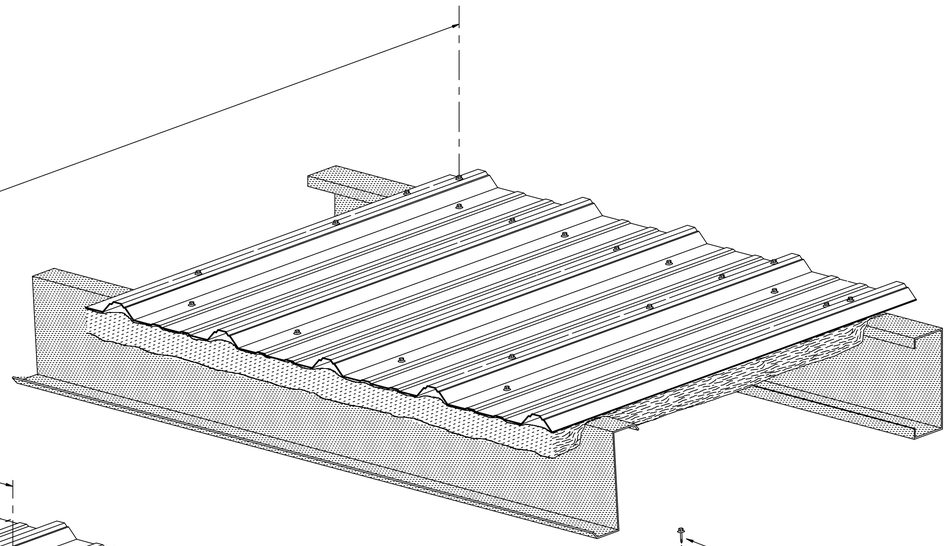

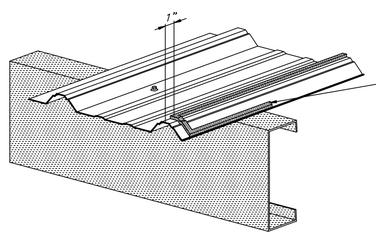


DETAIL "B"

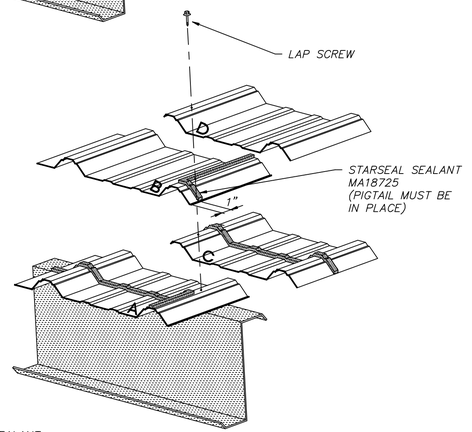


DETAIL "A"
TYPICAL LAP DETAIL

NOTE:

1. THE FASTENER SPACINGS SHOWN ON THIS DRAWING ARE NOT INTENDED FOR UL–90 RATED ROOFS. IF THE ROOF IS SPECIFIED AND ORDERED AS UL–90, USE FASTENER SPACING SHOWN ON DRAWING 35.04, TITLED "STAROOF–90 CONSTRUCTION DETAILS".
2. STAR BUILDING SYSTEMS IS NOT RESPONSIBLE FOR FASTENER SHORTAGES CAUSED BY USING THE WRONG FASTENER SPACING.
3. ROOF AND WALL PANELS SHOULD BE CLEANED OF ANY DRILL SHAVINGS OR FIELD CUTTING FILINGS AT THE END OF EACH DAY TO PREVENT RUSTING OF THESE PARTICLES.
4. DURA–RIB ROOF PANEL MUST BE ATTACHED TO PURLIN STRUTS INDICATED —X— OR ⟷ WITH THE SAME SPACING AS USED ON STANDARD ROOF PURLINS.

| REVISIONS | | BY | | DATE |
|---|---|---|---|---|
| 3 | NO CHANGE, REDRAWN ON CAD | LEC | RB | |
| 4 | REVISES NOTE 4 | | RGB | |

NOTES

THIS DRAWING IS NOT TO SCALE

* UNDERWRITERS LABORATORIES CLASSIFIED 30 FOR WIND UPLIFT RESISTANCE ONLY.

DRN. BY LEC DATE

CHK. BY DATE

STAR BUILDING SYSTEMS

a Robertson Ceco company

STAROOF–30 * CONSTRUCTION DETAILS FOR SINGLE SLOPE BUILDINGS

35.03.04

11/29/98