FILE_NAME: J:_Commercial\Prestige Fitness Gym, Diamond, Hwy\Drawings\Working Drawings\E00 – E102 – Lighting Plan.dwg, E102 PLOT DATE & TIME: Thursday, April 21, 2022 9:13:13 AM

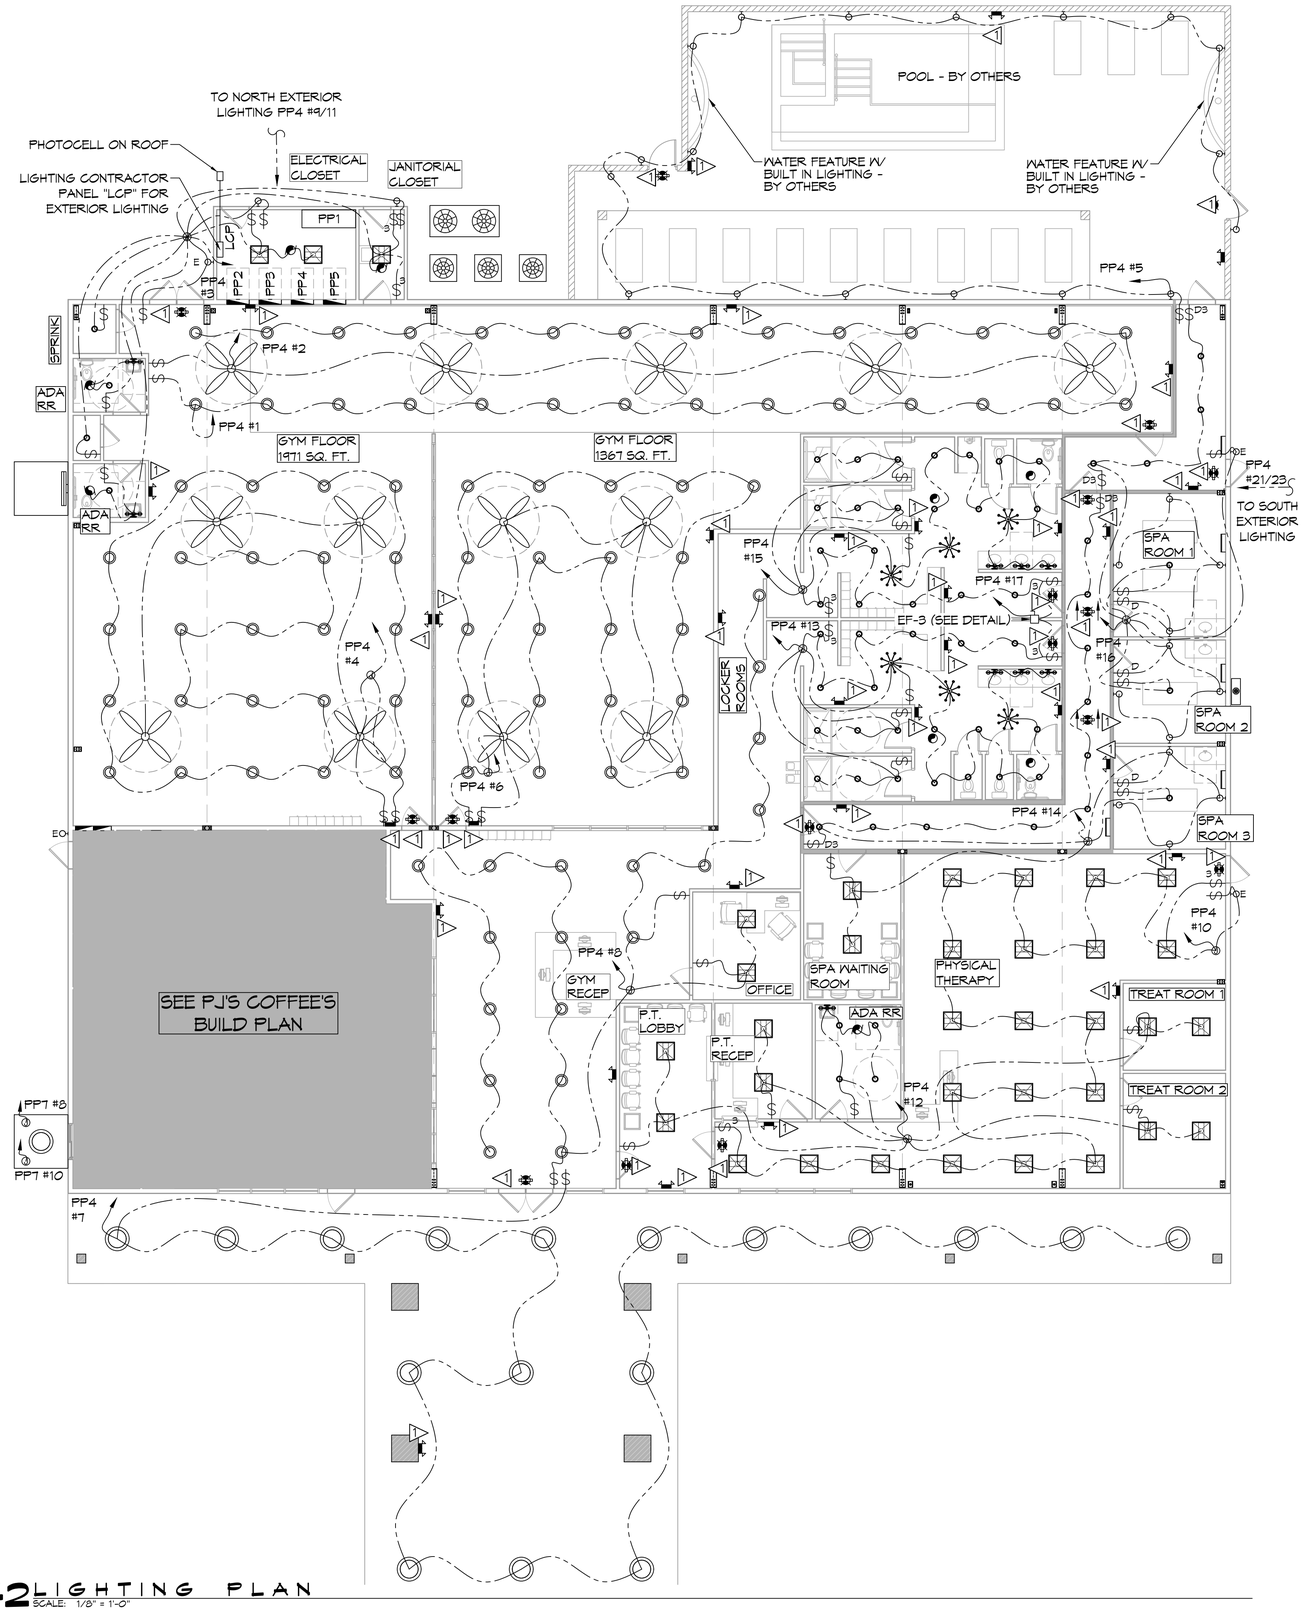

42 LIGHTING PLAN
SCALE: 1/8" = 1'-0"

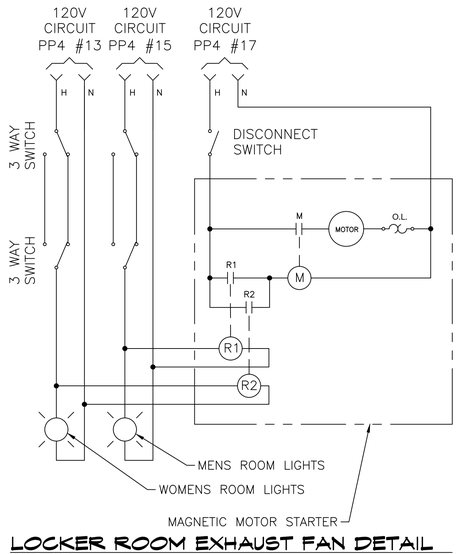

LOCKER ROOM EXHAUST FAN DETAIL
SCALE: N.T.S.

GENERAL LIGHTING NOTES

1. ALL WORK SHALL COMPLY WITH APPLICABLE NATIONAL, STATE, AND LOCAL CODES, RULES, REGULATIONS, AND REQUIREMENTS OF THE SERVICE UTILITY COMPANY.
2. GENERAL CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY IF ANY CONFLICTS OCCUR BETWEEN LIGHTING AND ANY OTHER TRADE. DO NOT PROCEED WITH INSTALLATION IN THAT AREA UNTIL CONFLICT HAS BEEN RESOLVED TO THE SATISFACTION OF THE ARCHITECT AND ENGINEER.
3. REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING INSTRUCTIONS FOR ALL LIGHT FIXTURES. NOTIFY THE ARCHITECT AND ENGINEER OF ANY DISCREPANCIES BETWEEN THESE PLANS AND THE ARCHITECTURAL PLANS RELATING TO QUANTITY, TYPE AND LOCATION OF DEVICES AND/OR FIXTURES.
4. WHEN SPECIFIC LIGHT FIXTURE HAS BEEN SPECIFIED IN THE FIXTURE SCHEDULE, ELECTRICAL CONTRACTOR SHALL PROVIDE COMPLETE ASSEMBLY INCLUSIVE ALL PARTS AND HARDWARE TO INSURE PROPER FUNCTIONING FIXTURE.
5. ALL CONDUCTORS SHALL BE A MINIMUM OF #12 AWG UNLESS NOTED OTHERWISE.
6. ALL 120V RUNS LONGER THAN 60 FEET SHALL BE #10 AWG AND 277V RUNS LONGER THAN 150 FEET SHALL BE #10 AWG UNLESS NOTED OTHERWISE.
7. ALL CONDUCTORS SHALL BE COPPER.
8. WHERE CONDUCTOR SIZES ARE NOTED ON DRAWINGS, THAT WIRE SIZE SHALL BE THROUGH THE ENTIRE RUN UNLESS OTHERWISE NOTED.
9. MOUNTED LIGHT SWITCHES 48" AFF UNLESS NOTED OTHERWISE ON ARCHITECTURAL DRAWINGS.
10. WHERE MORE THAN ONE SWITCH OCCURS IN THE SAME LOCATION, THEY SHALL BE INSTALLED IN A GANG TYPE BOX UNDER ONE COVER PLATE. ALL GANGED SWITCHES SHALL HAVE A COMMON SEAMLESS FACEPLATE. EACH MULTI-GANGED BOX SHALL BE NO MORE THAN SIX (6) SWITCHES WIDE. WHERE MORE THAN SIX (6) SWITCHES ARE SHOWN AT ONE (1) LOCATION, ADDITIONAL MULTI-GANGED BOXES SHALL BE STACKED VERTICALLY AND THE WIDTH OF THE MULTI-GANGS SHALL BE AS EVEN AS POSSIBLE.
11. EACH DIMMER SWITCH SHALL HAVE A WATTAGE RATING 25% HIGHER THAN THE TOTAL WATTAGE OF AL LIGHTS TO BE CONTROLLED BY THE DIMMER. DIMMER SIZES 600, 1000, 1500, AND 2000 WATTS, LUTRON NOVA T-STAR. WHERE SWITCHES ARE GANGED WITH DIMMERS, THE SWITCHES SHALL ALSO BE LUTRON NOVA T-STAR. FLUORESCENT AND LOW VOLTAGE DIMMERS SHALL BE LUTRON NOVA T-STAR.
12. ALL EMERGENCY EXIT LIGHT FIXTURES SHALL HAVE 90 MINUTE BATTERY BACKUP WITH INTEGRAL TEST BUTTON AND SHALL BURN CONTINUOUSLY.
13. ALL FLUORESCENT FIXTURES THAT UTILIZE DOUBLE-ENDED LAMPS AND CONTAIN BALLASTS SHALL BE PROVIDED WITH A DISCONNECTING MEANS IN ACCORDANCE WITH NEC 410.73G.

KEY NOTES

1. PROVIDE CONNECTION TO UN-SWITCHED HOT OF LIGHTING CIRCUIT AND SHALL HAVE 90 MINUTE EMERGENCY BATTERY BACKUP.

LIGHTING LEGEND

SYM	DESCRIPTION
	EXHAUST FAN
	EXHAUST VENT (WITHOUT BUILT IN FAN)
	EXIT LIGHT
	EMERGENCY WALL LIGHT
	LED FLUORESCENT LIGHT FIXTURE
	MIRROR LIGHT
	RECESSED LIGHT
	SUSPENDED LIGHT
	EXTERIOR LIGHT
	DECORATIVE PENDENT LIGHT
	TRACK LIGHT
	WALL SCONCE
E	EXTERIOR WALL SCONCE WITH 90 MINUTE EMERGENCY BATTERY BACKUP
	CHANDELIER
	CEILING FAN
J	JUNCTION BOX
	DISCONNECT
$	SINGLE POLE LIGHT SWITCH
$3	3-WAY LIGHT SWITCH
$D	DIMMER LIGHT SWITCH
$D3	3-WAY DIMMER LIGHT SWITCH
	HOME RUN

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
5555 Corporate Blvd. Suite 201
Baton Rouge, LA 70808
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
bmistich@dammonengineering.com

#	DESCRIPTION	REVISIONS	DATE

SEAL:

Missing or in
File: P:\Stam
Sheet: 1

NEW ATHLETIC CLUB
PRESTIGE FITNESS CLUB AND SPA
4422 KALANI DRIVE
HANCOCK COUNTY, MISSISSIPPI

JOB No:	DATE:	02-24-2022
DRAWN BY:	CHECKED BY:	BAM

The plans, ideas and designs contained in these plans are the property of Dammon Engineering, Inc. and are not to be used in whole or in part for any other project without the written permission of Dammon Engineering, Inc. and shall remain the property of Dammon Engineering, Inc. whether the project for which they were prepared is executed or not. Visual contact with these plans shall constitute prima facie evidence of the acceptance of these restrictions. Copyright © 2022 Dammon Engineering, Inc. All rights reserved.

SHEET TITLE:
LIGHTING PLAN

DRAWING NUMBER:
E102

SHEET No: 20 of 22