



1 FOUNDATION PLAN
SCALE: 1/2" = 1'-0"


FOUNDATION

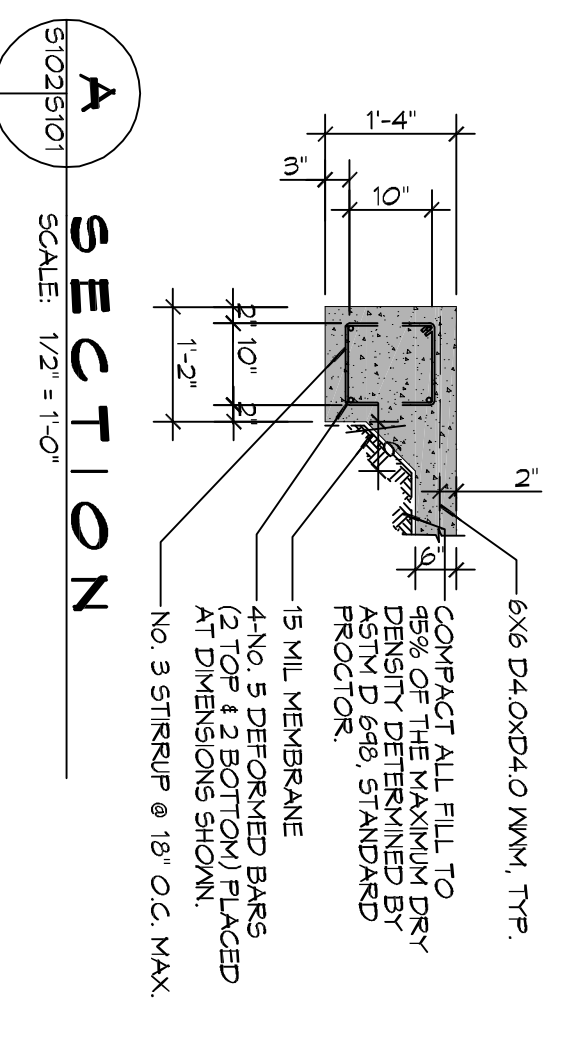

A SECTION
SCALE: 1/2" = 1'-0"

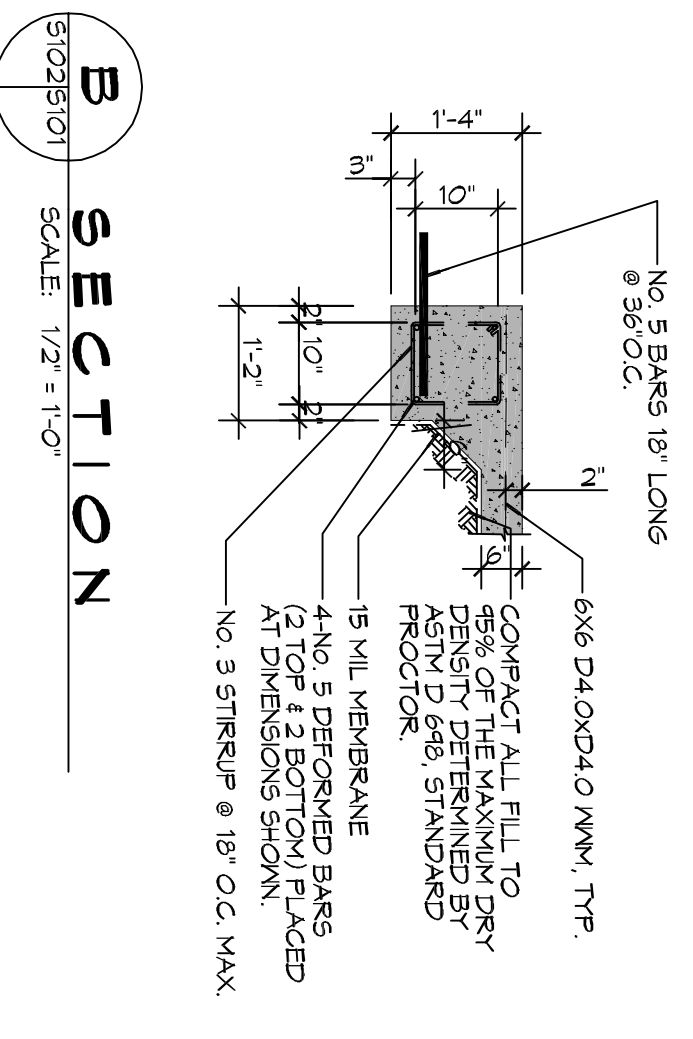


B SECTION
SCALE: 1/2" = 1'-0"

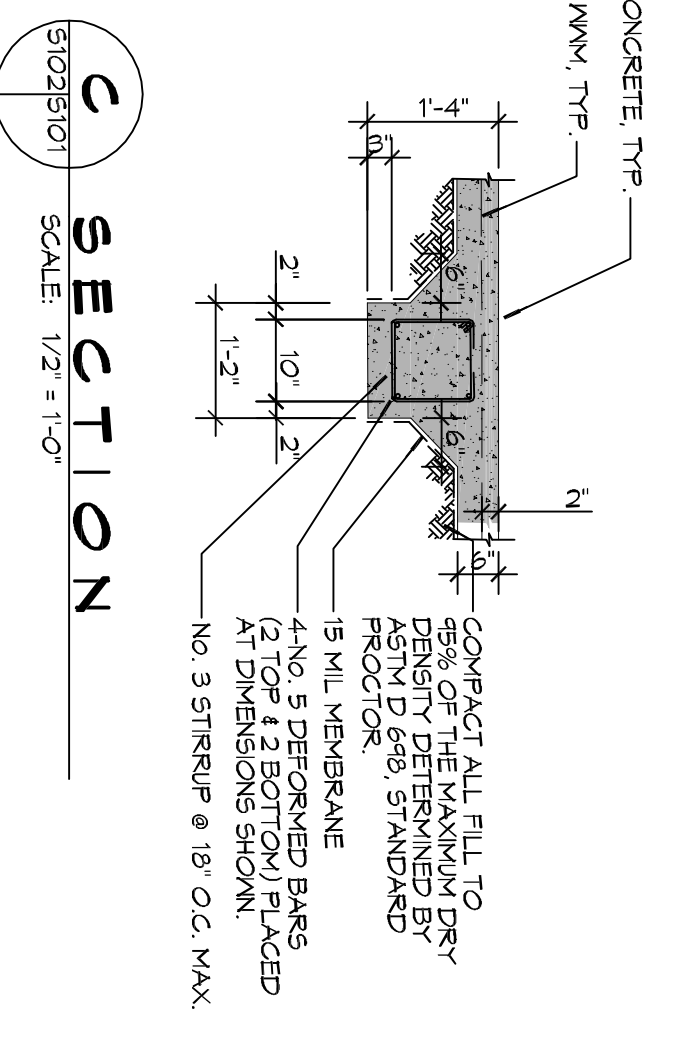

C SECTION
SCALE: 1/2" = 1'-0"

- ### FOUNDATION NOTES
- ALL DIMENSIONS ARE EDGE OF CONCRETE (EOC) TO EDGE OF CONCRETE (EOC) UNLESS NOTED OTHERWISE.
 - VERIFY ALL PLUMBING ROUGH-IN LOCATIONS ON ARCHITECTURAL DWGS.
 - CONCRETE MIX SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSF AT 28 DAYS. CONCRETE MIX SHALL BE IN ACCORDANCE WITH ACI-318.
 - ALL CONVENTIONAL REINFORCING STEEL SHALL MEET ASTM-A615 (GRADE 60).
 - ONE LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE. VAPOR RETARDER TO BE MINIMUM 10 MIL THICKNESS; ASTM E THIS CLASS A PERMEANCE LESS THAN 0.01 PERMS, EQUAL TO STEGO INDUSTRIES STEGO MEMAP ECO-SHIELD-15 MIL BY ERRO, OR ROYBAR 15 BY FLATIRON FILMS. PROVIDE APPROPRIATE ACCESSORIES FOR A COMPLETE SYSTEM.
 - ALL REINFORCING STEEL AND KEEL SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING CONCRETE PLACEMENT.
 - THE CONTRACTOR SHALL VERIFY ALL DROPS, OFFSETS, BRICK LEDGES, DIMENSIONS, AND FINISHES. CONTRACTOR MUST BE RESPONSIBLE FOR SAME.
 - GRADE BEAM DIMENSIONS MAY VARY BY -5% -20%.
 - ALL SOIL BELOW SLAB SHALL RECEIVE TERSITE TREATMENT.

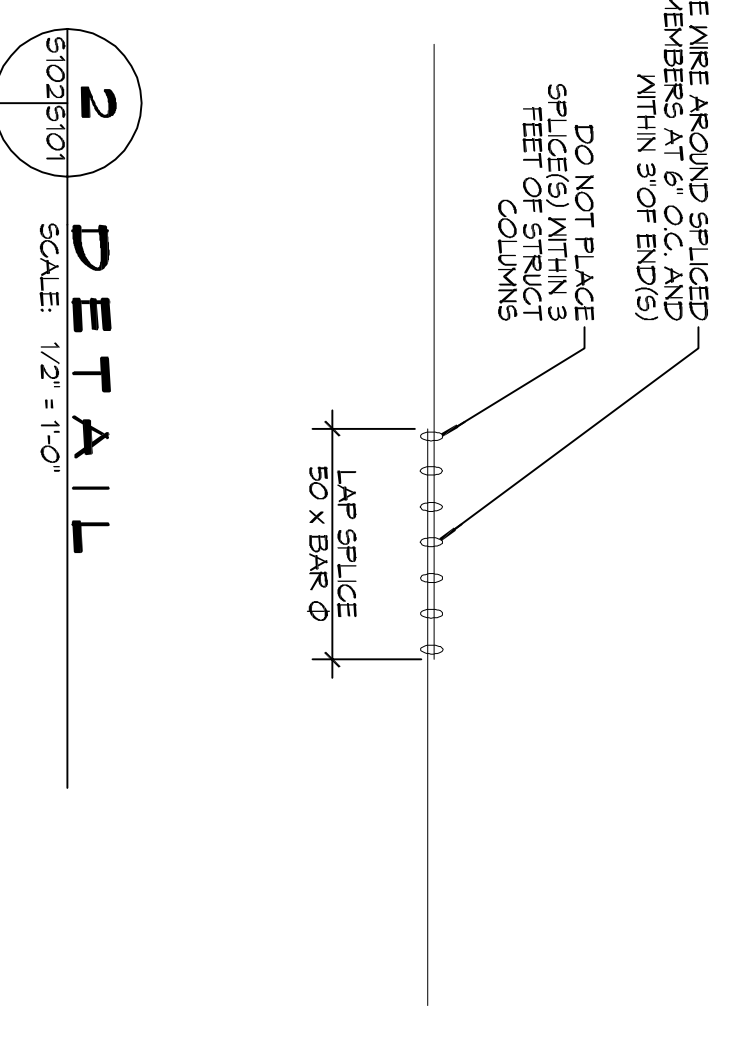

2 DETAIL
SCALE: 1/2" = 1'-0"



554 Old Spanish Trail
Slidell, LA 70458
PH: 985.649.5832

www.dammonengineering.com
info@dammonengineering.com
Fax: 985.641.5950

REVISIONS		DATE
#	DESCRIPTION	

SHEET TITLE: FOUNDATION PLAN		DRAWING NUMBER: S101	
JOB No: 2251		DATE: 10-11-16	FOR OTHER DRAWINGS AND SPECIFICATIONS, SEE THE APPROPRIATE REVISIONS IDENTIFYING AND THAT REMAINS THE PROPERTY OF DAMMON ENGINEERING, AND NO PART THEREOF SHALL BE COPIED, REPRODUCED, OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT THE WRITTEN CONSENT OF DAMMON ENGINEERING. VISUAL CONTACT WITH THESE DRAWINGS OR SPECIFICATIONS SHALL CONSTITUTE A WAIVER OF ACCEPTANCE OF THESE DRAWINGS.
DRAWN BY: CKD	CHECKED BY: BAM		