FILE NAME: J:\...Foundations_Only\Scott Lindsly Airport Roof\working folder\S101 - Foundation Plan.dwg PLOT DATE & TIME: Wednesday, July 11, 2018 10:45:57 AM

LEGEND

- SINGLE TENDON
- DOUBLE TENDON (STACKED VERTICALLY)

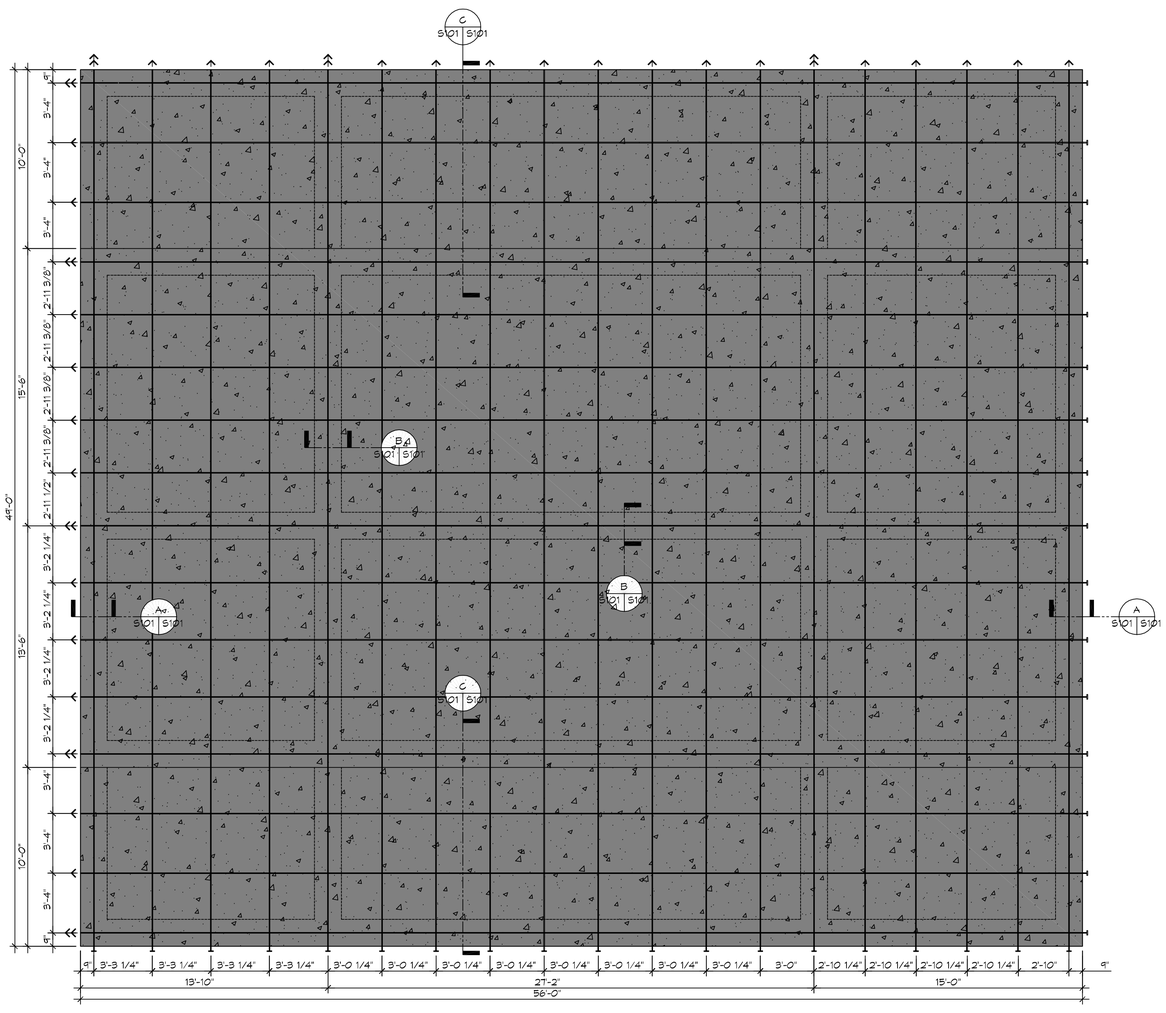

1 S101 | S101 **FOUNDATION PLAN**
SCALE: 1/4" = 1'-0"

POSTENSION NOTES

1. THE INTENT OF THIS PLAN IS TO PROVIDE INFORMATION FOR PLACEMENT OF POST TENSION SYSTEM TENDONS, ONLY. IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO VERIFY ALL DIMENSIONS, LEDGES, BLOCK OUTS, OFFSETS, ETC., SHOWN ON THESE PLANS.
2. BEAM SIZES AND LOCATIONS SHALL NOT BE CHANGED WITHOUT APPROVAL OF THE ENGINEER, EXCEPT THAT BEAM DEPTH MAY BE EXTENDED TO REACH UNDISTURBED SOIL.
3. ALL SOIL BELOW SLAB SHALL RECEIVE TERMITE TREATMENT.
4. ONE LAYER OF POLYETHYLENE VAPOR BARRIER SHALL BE PLACED UNDER ALL CONCRETE, EXTEND VAPOR BARRIER INTO BOTTOM OF GRADE BEAMS. OVERLAP ALL SPLICES WITH MINIMUM OF 12" AND TAPE ALL SPLICES. VAPOR RETARDER TO BE MINIMUM 15 MIL. THICKNESS, ASTM E 1745 CLASS A, PERMEANCE LESS THAN 0.01 PERMS, EQUAL TO STEGO INDUSTRIES STEGO WRAP, ECOSHIELD-E 15 MIL BY EPRO, OR IRONBAR 15 BY FLATIRON FILMS. PROVIDE APPROPRIATE ACCESSORIES FOR A COMPLETE SYSTEM.
5. IT IS RECOMMENDED THAT A CURING COMPOUND BE USED TO CONTROL SHRINKAGE.
6. WHERE ADDITIONAL REINFORCEMENT WITH REBAR IS USED IN FOOTINGS, IT SHALL CONFORM TO ASTM A615 AND SHALL BE DETAILED AND ACCESSORIES PROVIDED IN ACCORDANCE WITH THE LATEST A.C.I. MANUAL OF STANDARD PRACTICE FOR DETAILING REINFORCED CONCRETE STRUCTURES. WOVEN WIRE FABRICS SHALL CONFORM TO ASTEM A185.
7. TENDONS AND BARS SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING PLACING OF CONCRETE.
8. ALLOW 8" CENTERED CLEARANCE ON TENDON AXIS BY 36" LENGTH FOR STRESSING EQUIPMENT CLEARANCE.
9. CONCRETE SHALL BE WELL CONSOLIDATED ESPECIALLY IN THE VICINITY OF TENDON ANCHORAGES.
10. CONCRETE DESIGN IS BASED UPON A CONCRETE MIX HAVING A MINIMUM OF 5.3 SACKS OF CEMENT PER CUBIC YARD AND A MAXIMUM OF 30 GALLONS OF FREE AND ADDED WATER PER CUBIC YARD. SUCH A MIX SHOULD GIVE A MINIMUM COMPRESSION STRENGTH OF 4,000 P.S.I. AT 28 DAYS. CONCRETE DESIGN MIX SHALL BE IN ACCORDANCE WITH THE A.C.I. BUILDING CODE REQUIREMENTS.
11. POST-TENSION SYSTEM SHALL BE FURNISHED, PLACED, AND STRESSED BY A FIRM SPECIALIZING IN POST-TENSION SYSTEMS. POST-TENSION SUPPLIER SHALL BE PTI CERTIFIED. POST-TENSION CONTRACTOR SUPERVISOR AND 50% OF THE INSTALLATION PERSONNEL MUST BE CERTIFIED AS HAVING COMPLETED THE PTI LEVEL 1 - FIELD FUNDAMENTALS PROGRAM. ALSO, ALL PERSONNEL INVOLVED IN THE STRESSING OPERATION MUST BE CERTIFIED AS HAVING COMPLETED THE PTI LEVEL 1 - FIELD FUNDAMENTALS PROGRAM.
12. ALL PRESTRESSING STEEL SHALL CONSIST OF SEVEN-WIRE STRESS RELIEVED STRAND CONFORMING TO ASTM A-416. MINIMUM ULTIMATE TENSILE STRENGTH SHALL BE 270,000 P.S.I.. STRANDS SHALL BE COATED WITH A PERMANENT RUST PREVENTIVE LUBRICANT AND A PLASTIC SHEATH. TENDONS SHALL BE SECURELY SUPPORTED TO PREVENT BOTH VERTICAL AND HORIZONTAL MOVEMENT DURING PLACING OF CONCRETE. NO TENDON SHALL BE UNSUPPORTED FOR MORE THAN 5 FEET.

POSTENSION NOTES

13. REINFORCEMENT SHALL HAVE 3" COVER IN GRADE BEAM BOTTOMS, 2" COVER IN BEAM SIDES AND TOPS, 1-1/2" COVER IN SLAB TOPS AND BOTTOMS, UNLESS OTHERWISE SHOWN.
14. THE TENDON LOCATION AT THE END OF A GRADE BEAM IS TO BE A MINIMUM OF 6" FROM THE TOP OF THE SLAB TO THE CENTER OF GRAVITY OF THE TENDONS.
15. THE FINISH OF THE SLAB SHALL BE A LIGHT BROOM FINISH.
16. FORMWORK SHALL BE STRIPPED NO LATER THAN 6 DAYS AFTER PLACEMENT OF CONCRETE.
17. TENDONS TO BE STRESSED NO EARLIER THAN 7 DAYS AND NOT LATER THAN 14 DAYS AFTER PLACEMENT OF CONCRETE. CONCRETE TO HAVE A MINIMUM COMPRESSIVE STRENGTH OF 1500 P.S.I. AT THE TIME OF STRESSING. LOADING OF SLAB PRIOR TO TENSIONING SHALL NOT BE DONE WITHOUT THE APPROVAL AND DIRECTION OF THE SUPERVISING ENGINEER.
18. STRESSING:
    A) 1/2" TENDON SHALL BE ANCHORED AT 28.9K PER STRAND, BUT SHALL BE INITIALLY STRESSED TO 33.0K PER STRAND.
    B) 3/8" TENDON SHALL BE ANCHORED AT 16.1K PER STRAND, BUT SHALL BE INITIALLY STRESSED TO 18.4K PER STRAND.
    C) DOUBLE LIVE END TENDONS SHALL BE FULLY STRESSED AT THE INITIAL END. NO ADDITIONAL STRESSING REQUIRED IF PROPER ELONGATION HAS BEEN ACHIEVED.
19. TENDON FINISHING: AFTER WRITTEN ACCEPTANCE OF THE TENDON ELONGATION REPORT, TENDONS SHALL BE CUT BEYOND THE FACE OF THE SLAB. TENDONS WITH LESS THAN ¾" MAY BE COVERED WITH A PLASTIC TENDON SLEEVE. STRESSING POCKET SHALL BE PROMPTLY GROUTED WITH NON-SHRINK CEMENT BASED GROUT.
20. SLAB MUST BE FLOODED TO EXPOSE BIRDBATHS (AREAS THAT HOLD WATER). FLOOD SLAB, THEN ALLOW SLAB TO DRAIN FOR ONE (1) HOUR. MARK ALL BIRDBATHS THAT ARE GREATER THAN 1/8" (NICKEL DEPTH). ALL BIRDBATHS MUST BE PATCHED USING THE PATCH BINDER MIX. ALL AREAS THAT NEED PATCHING SHALL BE PRIMED FIRST. ADEQUATE PARTS OF PATCH BINDER, SILICA SAND, AND PORTLAND SHALL BE BLENDED TOGETHER AND APPLIED FOR A RESILIENT PATCH. ALL PATCHES SHALL BLEND INTO EXISTING SLAB. SOME SANDING MAY BE REQUIRED FOR BLENDING. FILL ALL CRACKS WITH APPROVED CRACK FILLER. BAD CRACKS MAY NEED TO BE COATED WITH ACRYLIC.

NOTE:
FLUSH CONCRETE MORTAR PATCH AT ALL CABLE ANCHORS AFTER FINAL TIGHTENING.

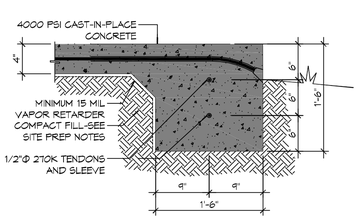

A S101 | S101 **SECTION**
SCALE: 1" = 1'-0"

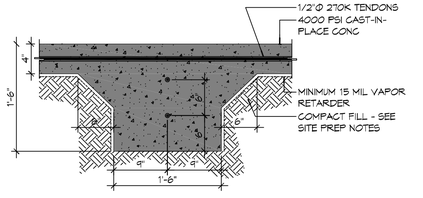

B S101 | S101 **SECTION**
SCALE: 1" = 1'-0"

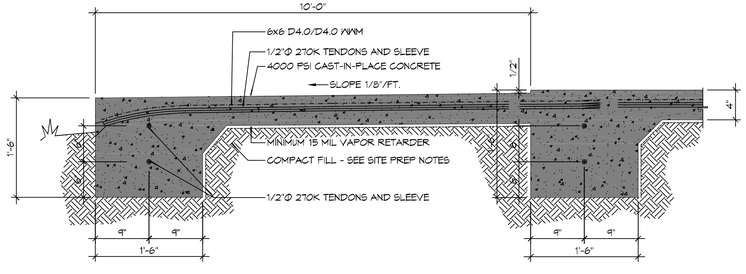

C S101 | S101 **SECTION**
SCALE: 1" = 1'-0"

DAMMON ENGINEERING, INC.
LOUISIANA & MISSISSIPPI
www.dammonengineering.com
info@dammonengineering.com
PH: 985.649.5832
Chief Engineer: Brian Mistich, PE
554 Old Spanish Trail
Slidell, LA 70458

#	DESCRIPTION	DATE
	REVISIONS	

SEAL:

PROJECT: SCOTT LINDSLY
FOUNDATION PLAN
LOT B-A, SECTION 30-1-6S, R-14-E
ST. TAMMANY PARISH, LA.

JOB No:	2018
DRAWN BY:	CKD
DATE:	07-11-2018
CHECKED BY:	BAM

The ideas and designs incorporated herein, as an instrument of service, are and shall remain the property of Dammon Engineering and are not to be used in any way without the written permission of Dammon Engineering. These plans are not to be changed or copied in any form or manner whatsoever nor are they to be assigned to any third party without first obtaining the expressed written permission and consent of Dammon Engineering.

SHEET TITLE:
FOUNDATION PLAN AND SECTIONS

DRAWING NUMBER:
S101

SHEET No: 1 of # 1