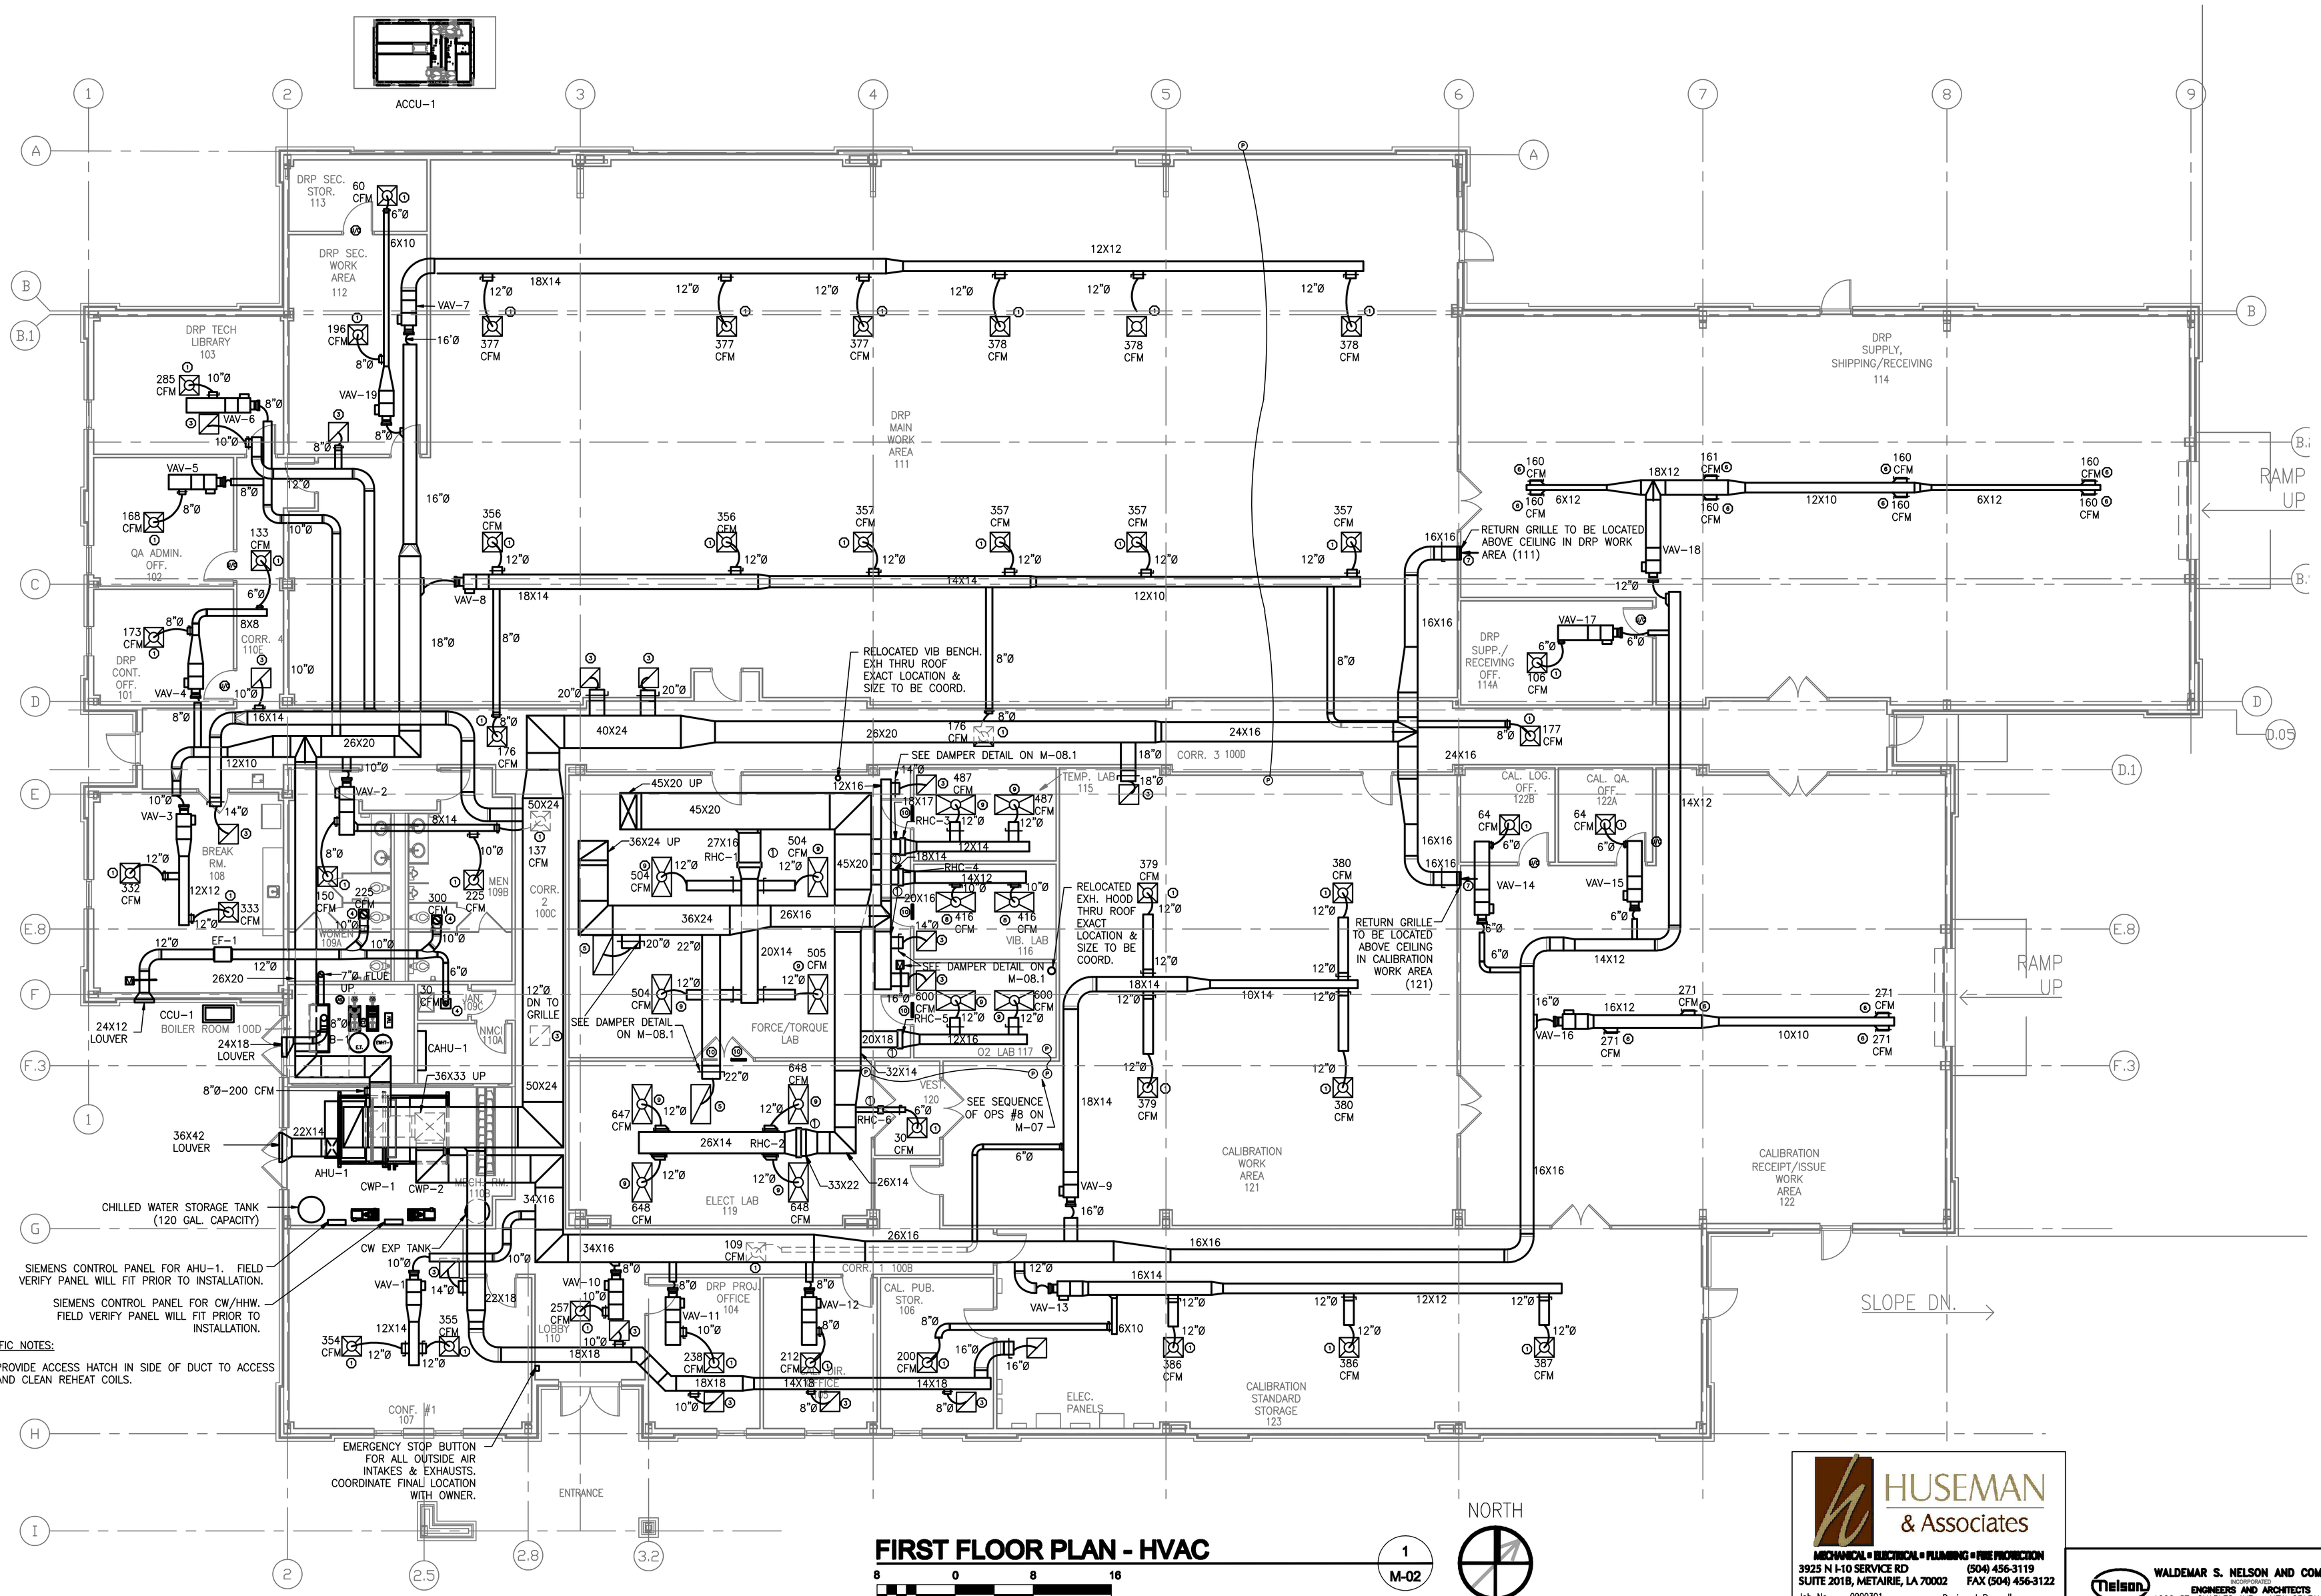

SPECIFIC NOTES:

1. PROVIDE ACCESS HATCH IN SIDE OF DUCT TO ACCESS AND CLEAN REHEAT COILS.

FIRST FLOOR PLAN - HVAC

1 / M-02

8 0 8 16

SCALE1/8" = 1'-0"

HUSEMAN & Associates
MECHANICAL • ELECTRICAL • PLUMBING • FIRE PROTECTION
3925 N I-10 SERVICE RD (504) 456-3119
SUITE 201B, METAIRIE, LA 70002 FAX (504) 456-3122
Job No. 0900301 Designed By JL
Drawn By RP Checked By CB

WALDEMAR S. NELSON AND COMPANY
INCORPORATED
ENGINEERS AND ARCHITECTS
1200 ST. CHARLES AVE NEW ORLEANS, LA.

BROADMOOR BUILDING by DESIGN
BROADMOOR, L.L.C.
2740 North Arnoult Road
Metairie, Louisiana 70002
www.broadmoorllc.com

DRAWING REVISIONS

REV.	DESCRIPTION	PREP BY	DATE	APPRVD.
0	FINAL DESIGN	RP	10/29/09	CB

Belle Chasse, Louisiana
NAS JRB New Orleans

NAVAIRSEFAC CALIBRATION BLDG.
HVAC FIRST FLOOR PLAN

DATE: AUGUST 22, 2008
APPROVED
EFD FOR COMMANDER, NAVFAC

NAVFAC
Naval Facilities Engineering Command
Southeast Division, Jacksonville, FL

STATE OF LOUISIANA
CHARLES W. BOYLE, JR.
REG. NO. 18480
REGISTERED PROFESSIONAL ENGINEER IN MECHANICAL ENGINEERING

RECORD DRAWING DATE 10/29/2009
CODE I.D. NO. –
DRAWING SIZE: D
SPEC. NO.08– –
CONSTRN. CONTR. NO. –
NAVFAC DRAWING NO. 15030933
SHEET 4 OF 15
M–02