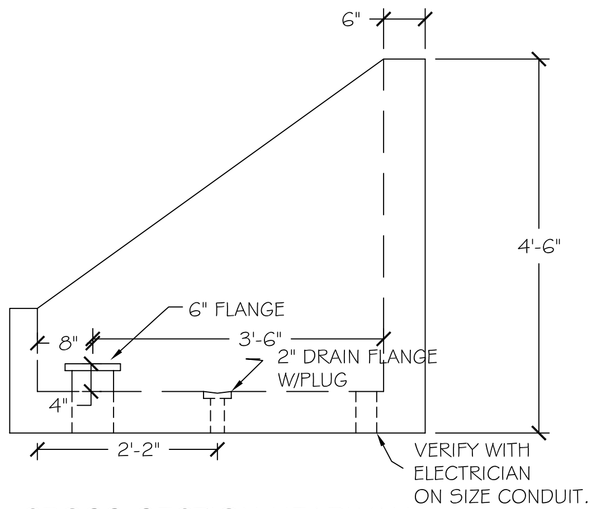

CROSS-SECTION HEADWALL

N.T.S.

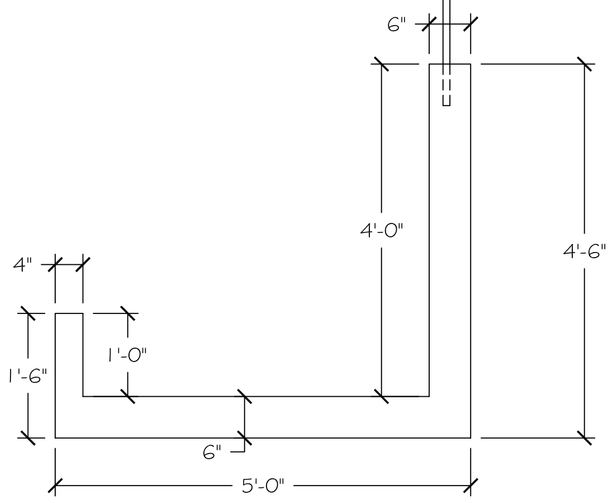

CROSS-SECTION HEADWALL

N.T.S.

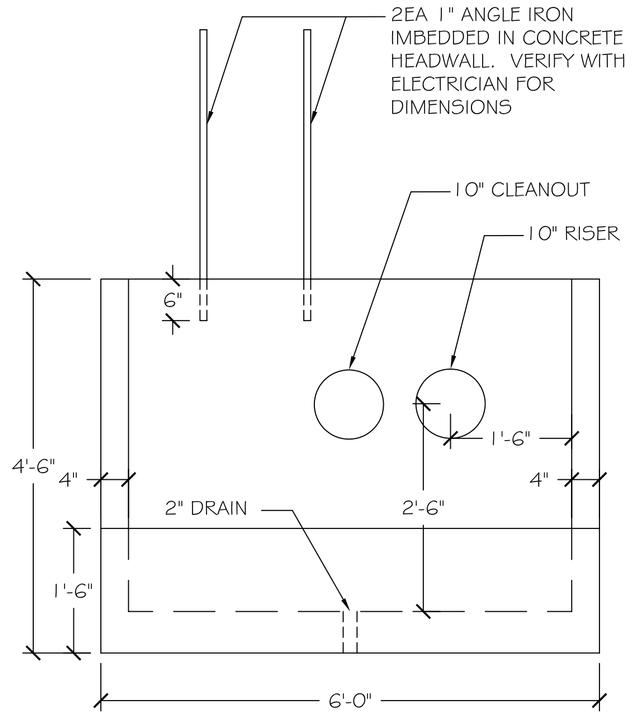

HEADWALL FRONT ELEVATION

N.T.S.

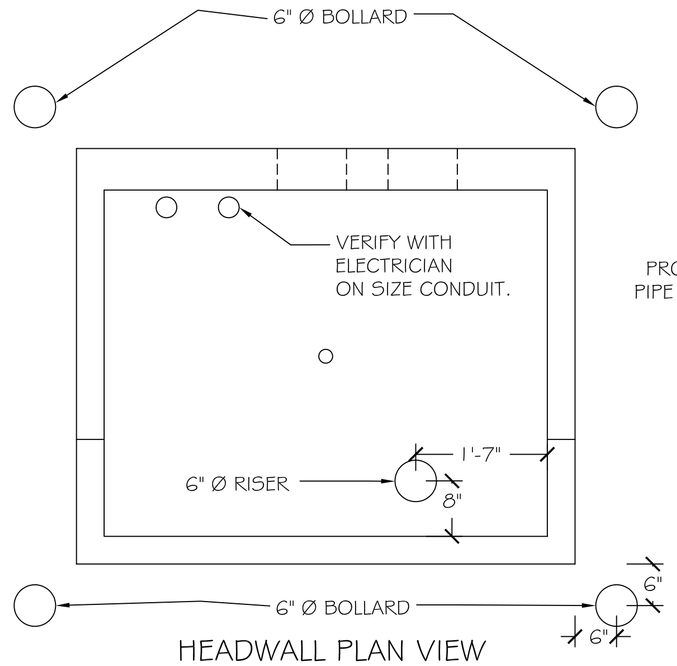

HEADWALL PLAN VIEW

N.T.S.

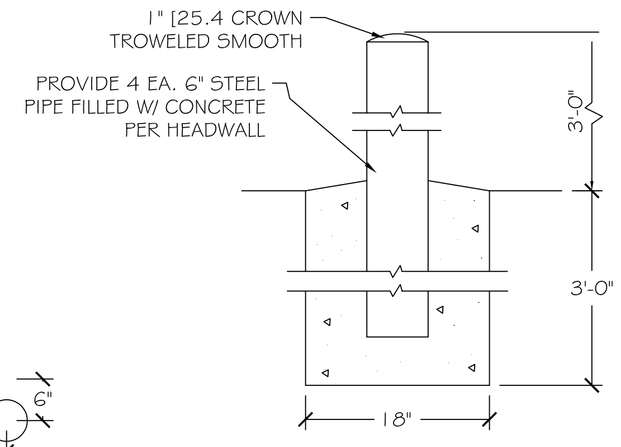

PIPE BOLLARD DETAIL

N. T. S.

HEADWALL NOTE: CONTRACTOR SHALL USE 4,000 psi CONCRETE, #5 BARS CONTINUOUS 12" O.C., ALL EDGES SHALL HAVE A CHAMFERED EDGE.

HEADWALL DETAIL

N.T.S.

MATERIAL LIST

#	ITEM
1	6" SDR-11 CAP
2	6" SDR-11 FLANGE W/CI RING
3	6" SDR-11 90 ° ELL
4	6" SDR-11 TEE
5	6" X 2" HDPE SADDLE
6	2" POLYCAM TRANSITION HDPE TO STAINLESS
7	2" STAINLESS COLLAR
8	2" STAINLESS BALL VALVE W/ MALE PIPE THREADS
9	2" STAINLESS CAMLOCK DISCONNECT (FEMALE) W/HDPE CONNECTION
10	2" STAINLESS CAMLOCK DISCONNECT (MALE) W/FEMALE PIPE THREADS
11	6" STAINLESS BALL OR GATE VALVE WITH FLANGE
12	6" CAMLOCK STAINLESS (MALE) W/FEMALE PIPE THREADS
13	2" SDR-11 90 ° ELL
14	2" SDR-11 FLANGE W/PLUG
15	10" SDR-11 CAP
16	REDUCER 2" X 1 ¼" STAINLESS
17	6" POLYETHYLENE GASKET
18	6" BLIND FLANGE

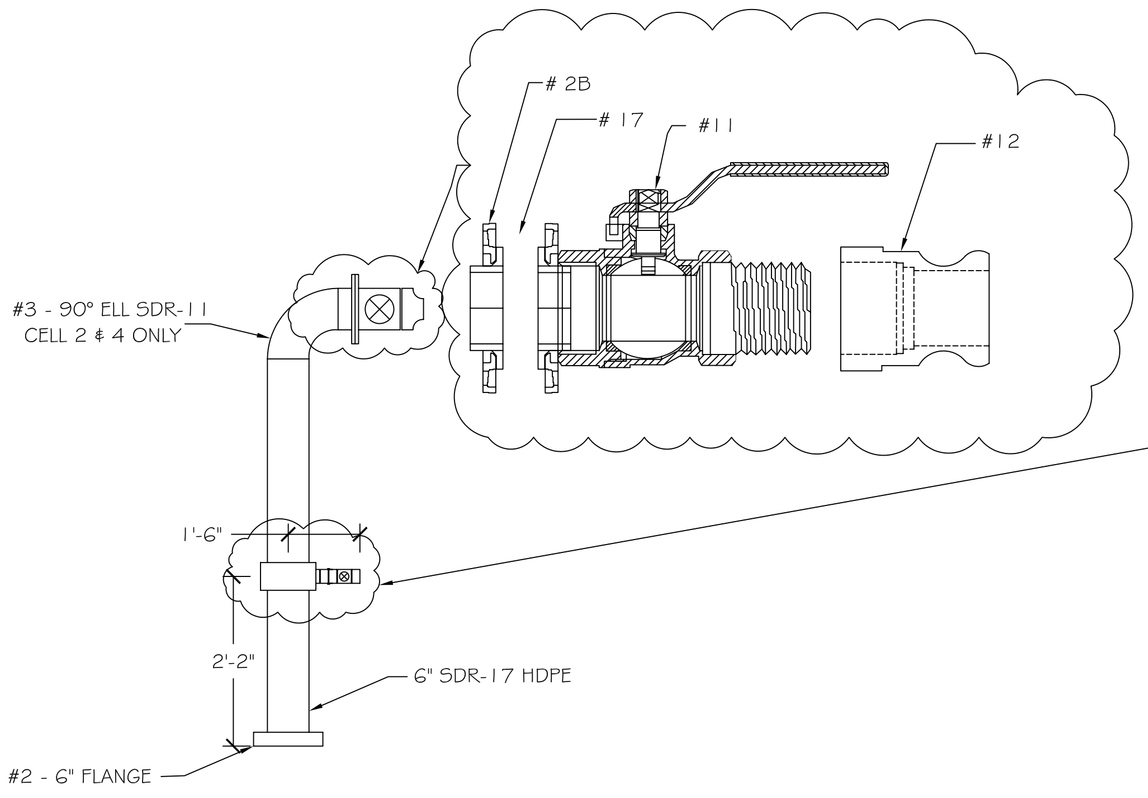

HEADWALL 2, 4 ONLY

N.T.S.

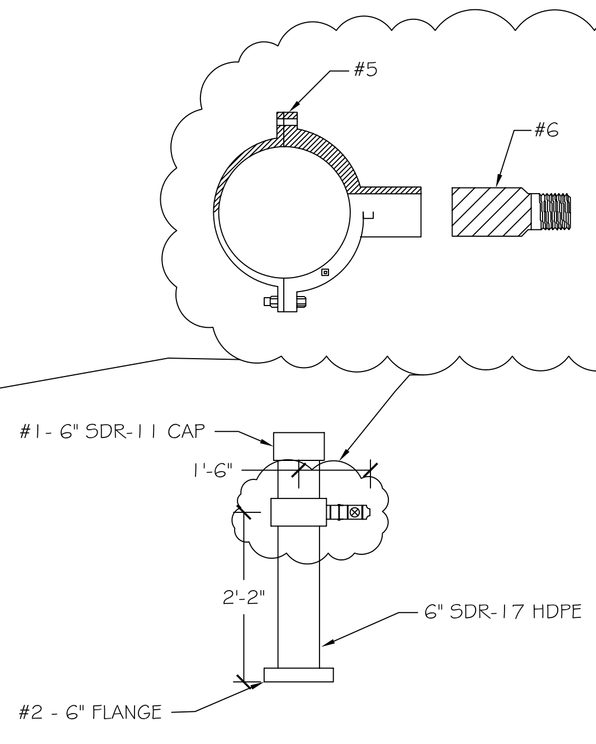

HEADWALL 1, 3, 5 ONLY

N.T.S.

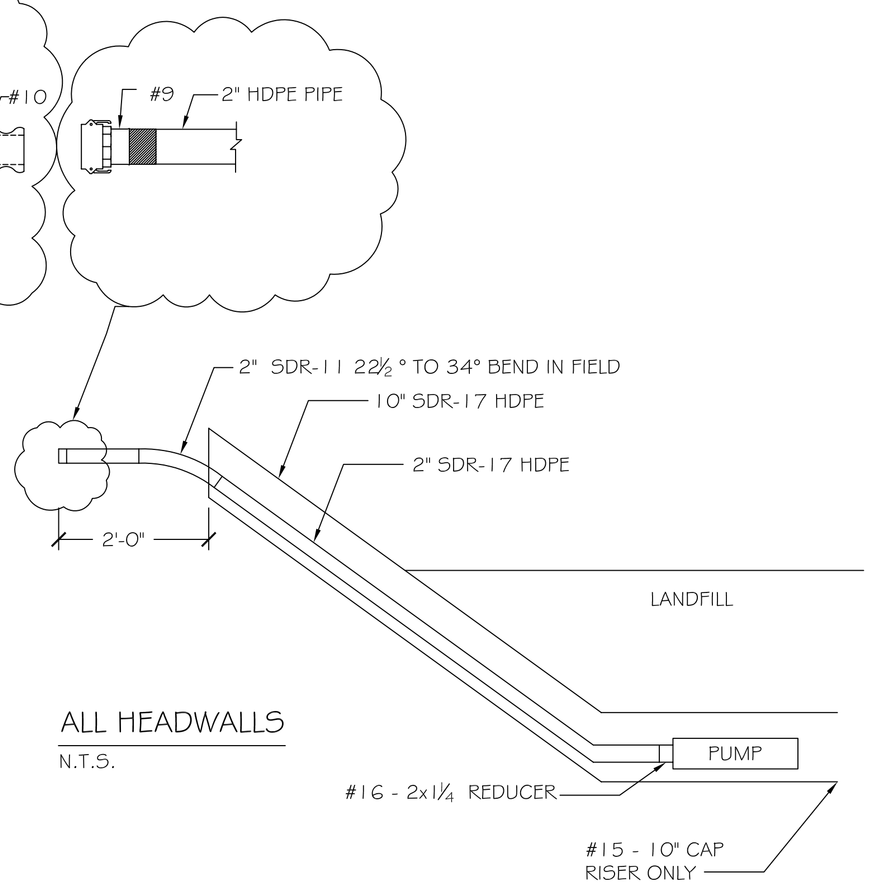

ALL HEADWALLS

N.T.S.

DAMMON ENGINEERING, INC.
EMMETT DAMMON
ARCHITECT ROBERT WILTSE
1095 FLORIDA AVENUE
SLIDELL, LA. 70458
985-649-5832
WEBSITE: WWW.DAMMONENGINEERING.COM
EMAIL: DAMMONENG@BELLSOUTH.NET

ARCHITECTURE

ENGINEERING

STUDIES

PLANNING

INVESTIGATION

EXPERT WITNESS

TANGIPAHOA PARISH LANDFILL

TANGIPAHOA
CELL 12- PHASE II(WEST)
LEACHATE & FORCE MAIN
PIPING SYSTEM

DETAIL #1

REV:

SCALE: AS NOTED

JOB#: 2067

DATE: 7-12-2010

SHEET

M-2

OF