1 TYPICAL ELEVATION

(ELEVATION DOES NOT REPRESENT EXACT CEILING CAVITY CONFIGURATIONS. ELEVATION SERVES AS A GUIDE TO EXPECTED WORKMANSHIP THROUGHOUT THE BUILDING'S LEASE SPACE TENANT IMPROVEMENT WORK.)

NO SCALE

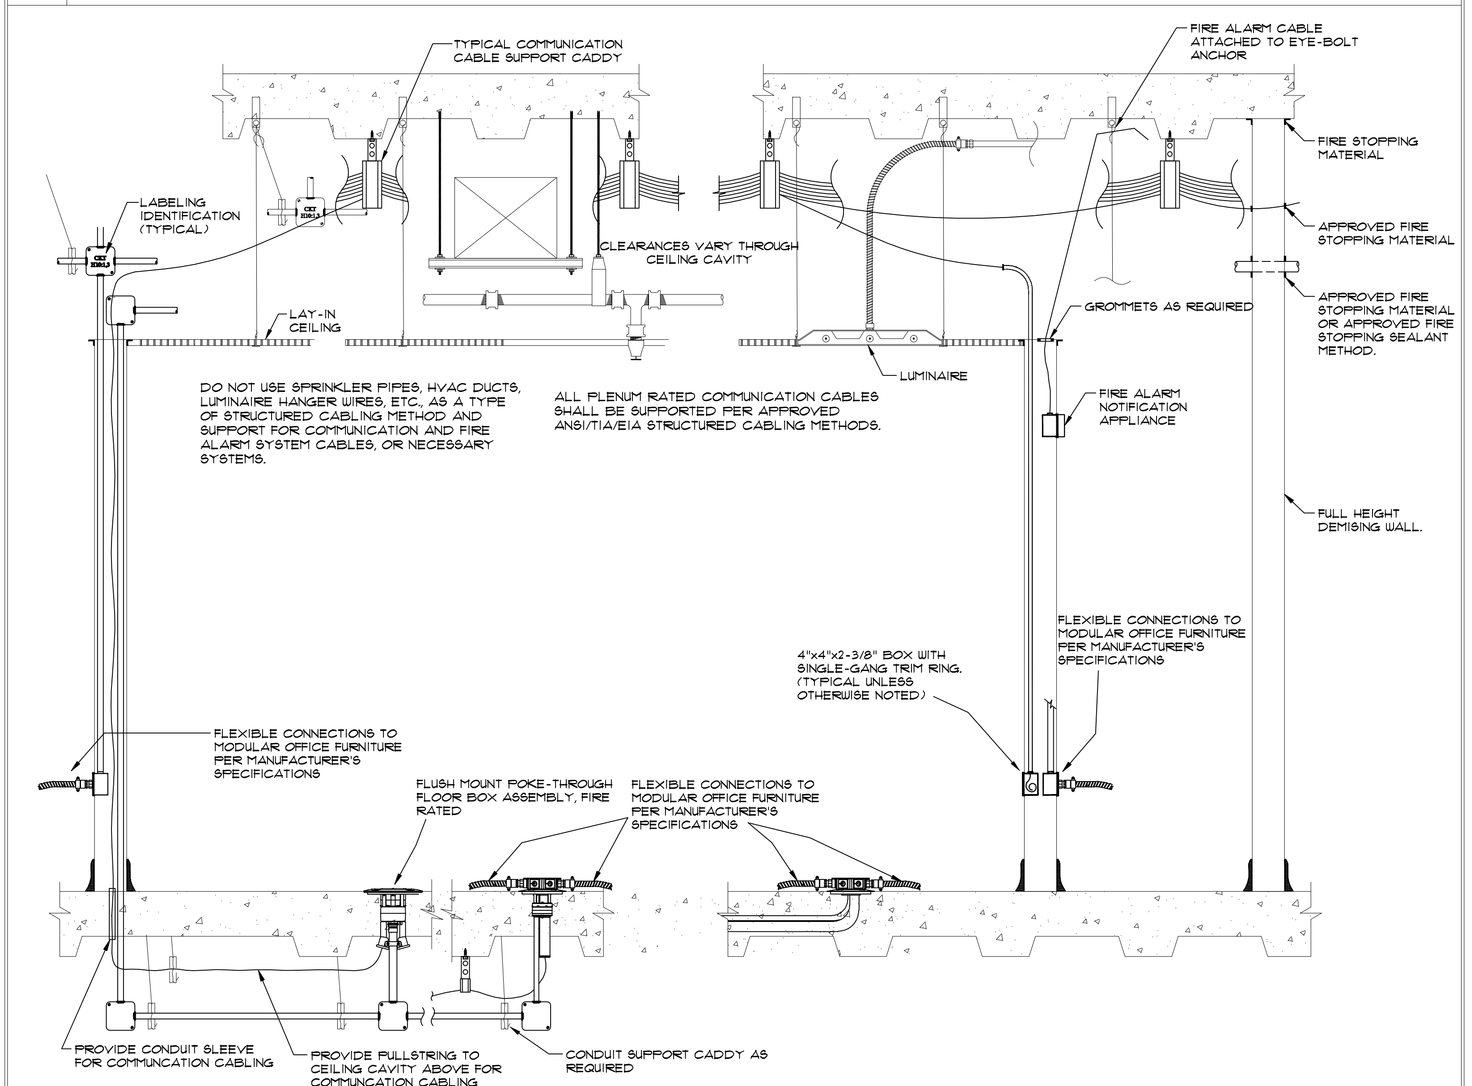

ELEVATION NOTES:

1. CONTRACTOR SHALL COORDINATE INSTALLATION OF ALL LIGHT FIXTURES THAT ARE RELOCATED OR NEW TO ENSURE THAT THE LIGHT FIXTURES DO NOT INTERFERE WITH ANY STRUCTURAL, MECHANICAL, OR PLUMBING COMPONENTS AND EQUIPMENT. RELOCATE ANY NEW OR RELOCATED LIGHT FIXTURES DUE TO INTERFERENCES WITH STRUCTURAL, MECHANICAL, OR PLUMBING COMPONENTS AND EQUIPMENT. COORDINATE RELOCATION WITH ARCHITECT.

2. ALL ABANDONED RACEWAY SYSTEMS, RACEWAY SYSTEM FITTINGS, RACEWAY SYSTEM BODIES, RACEWAY SYSTEM SUPPORT HARDWARE AND ACCESSORIES, RACEWAY SYSTEM REFUSE, CONDUCTOR REFUSE, COMMUNICATION CABLES, COMMUNICATION CABLE REFUSE, ETC., SHALL BE COMPLETELY REMOVED, DISCONNECTED AND PROPERLY DISPOSED. ALL COMMUNICATION CABLES SHALL BE COMPLETELY REMOVED FROM THE COMMUNICATION PLYWOOD BACKBOARD TO THE COMMUNICATION OUTLET OR OTHER POINT OF SERVICE PER ANSI/EIA/TIA STANDARDS AND PRACTICES.

3. FURNISH AND INSTALL A U.L. LISTED/CLASSIFIED FIRE STOPPING SYSTEM PER CONSTRUCTION TYPE USING AN APPROVED FIRE STOPPING SYSTEM MATERIAL FOR ALL CONDUIT PENETRATIONS, INCLUDING BUT NOT NECESSARILY LIMITED TO SLEEVES, THIMBLES, ETC., THROUGH FIRE RATED WALLS, PARTITIONS AND FLOOR/CEILING ASSEMBLIES. SUBMIT SPECIFICATION SHEET FOR THE FIRE STOPPING SYSTEM MATERIAL FOR APPROVAL. CONTRACTOR SHALL USE A FIRE STOPPING SYSTEM PERSON QUALIFIED TO PERFORM AND INSTALL FIRE STOPPING SYSTEM MATERIAL. COORDINATE AND CONSULT WITH THE ARCHITECT FOR CONSTRUCTION TYPE.

5 DEVICE AND EQUIPMENT LABELING DETAIL

NO SCALE

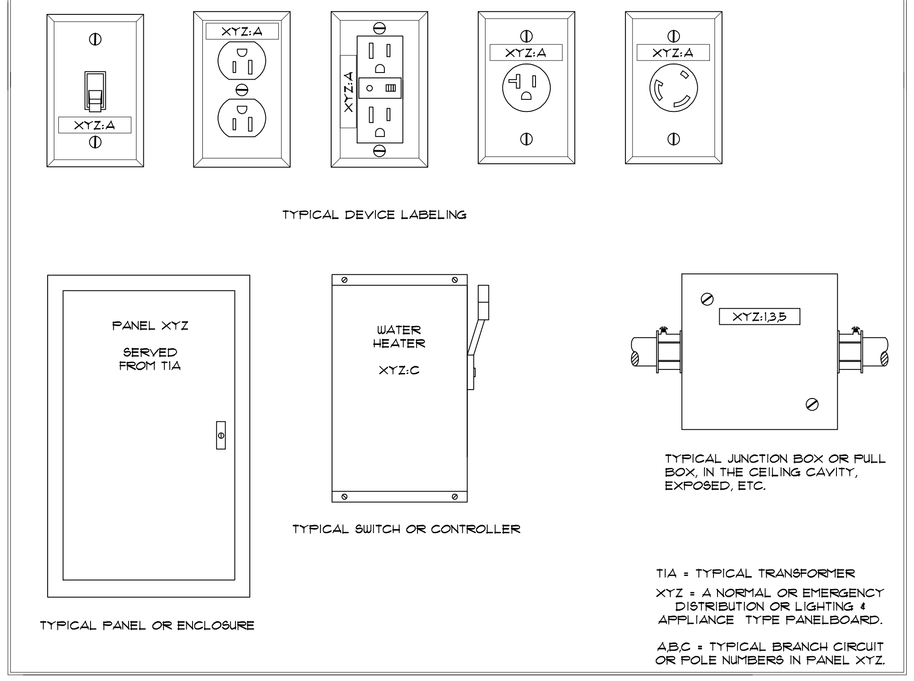

T1A = TYPICAL TRANSFORMER

XYZ = A NORMAL OR EMERGENCY DISTRIBUTION OR LIGHTING & APPLIANCE TYPE PANELBOARD.

A,B,C = TYPICAL BRANCH CIRCUIT OR POLE NUMBERS IN PANEL XYZ.

6 ROOF PENETRATION DETAIL

NO SCALE

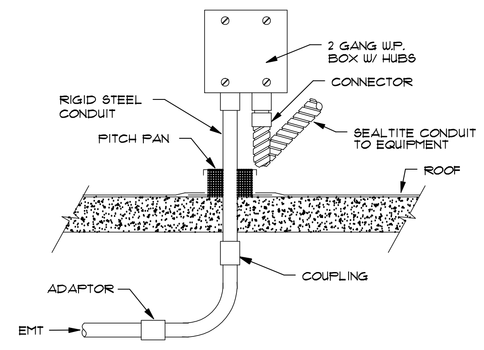

2 TYPICAL COMMUNICATION DEVICE LABELING

NO SCALE

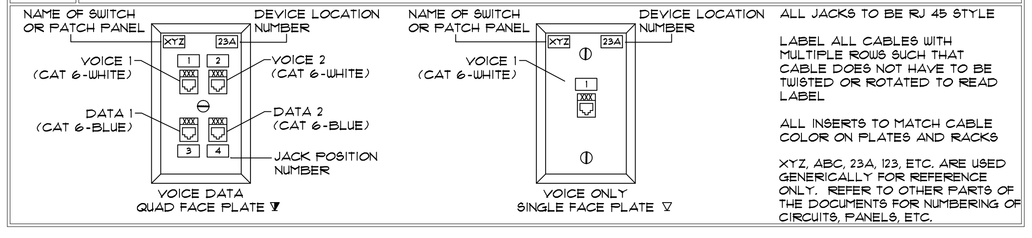

ALL JACKS TO BE RJ 45 STYLE

LABEL ALL CABLES WITH MULTIPLE ROWS SUCH THAT CABLE DOES NOT HAVE TO BE TWISTED OR ROTATED TO READ LABEL

ALL INSERTS TO MATCH CABLE COLOR ON PLATES AND RACKS

XYZ, ABC, 23A, 123, ETC. ARE USED GENERICALLY FOR REFERENCE ONLY. REFER TO OTHER PARTS OF THE DOCUMENTS FOR NUMBERING OF CIRCUITS, PANELS, ETC.

7 CATV DEVICE LABELING

NO SCALE

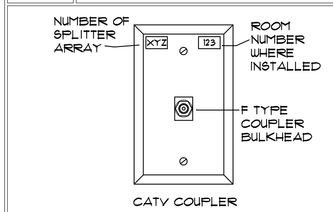

XYZ, ABC, 23A, 123, ETC. ARE USED GENERICALLY FOR REFERENCE ONLY. REFER TO OTHER PARTS OF THE DOCUMENTS FOR NUMBERING OF CIRCUITS, PANELS, ETC.

3 OUTLET FINISH COLOR DETAIL

NO SCALE

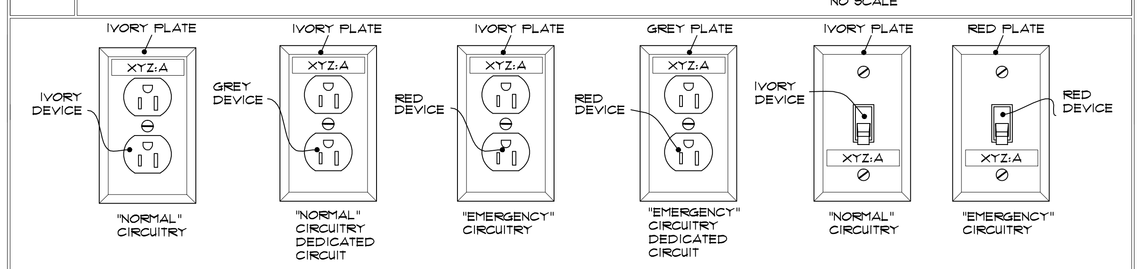

XYZ, ABC, 23A, 123, ETC. ARE USED GENERICALLY FOR REFERENCE ONLY. REFER TO OTHER PARTS OF THE DOCUMENTS FOR NUMBERING OF CIRCUITS, PANELS, ETC.

4 FLOOR BOX DETAIL

NO SCALE

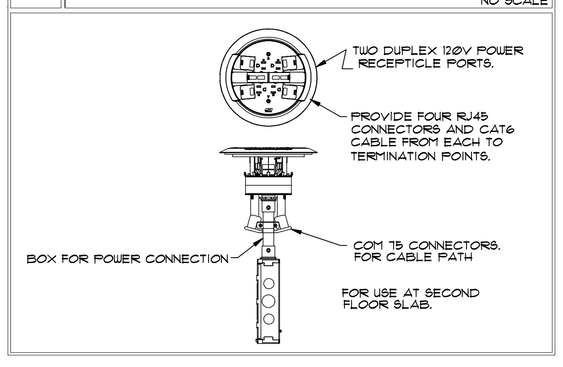

8 STAIR DETAIL

NO SCALE

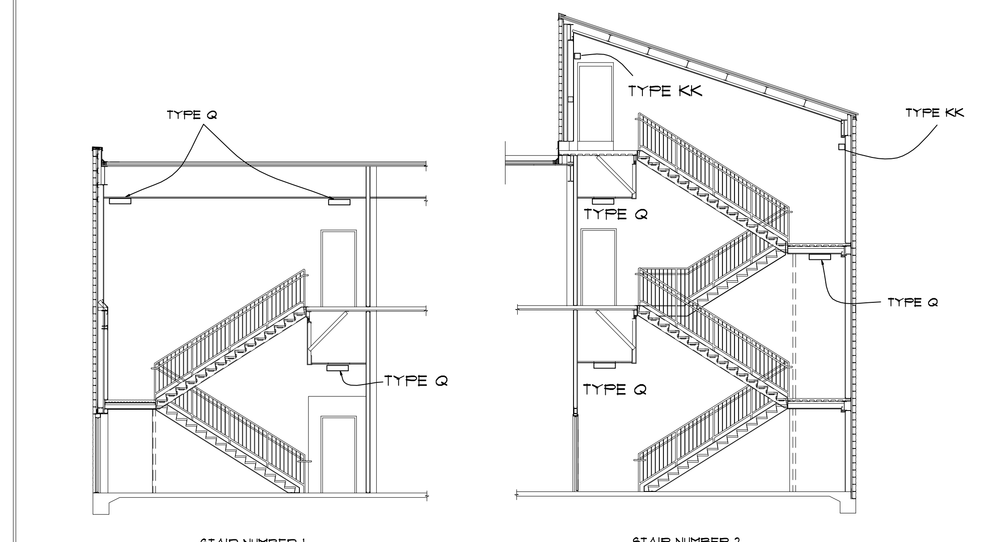

RCL CONSULTANTS, L.L.C.
Planning • Architecture • Engineering • Construction Management

RICHARD C. LAMBERT CONSULTANTS, L.L.C.
521 N. Causeway Blvd.
Mandeville, LA 70448
985-727-4440
Fax: 985-727-4467

#1 Poydras St., Ste. 1400 (P10)
New Orleans, LA 70130
504-837-7940

This drawing and design is the exclusive property of Richard C. Lambert Consultants, LLC and may not be reproduced or used without authorization and written permission. © 2007

RCLC Project Number: 0687

Date Issued: 05/15/07
Drawn By: EDA
Checked By: EDA

Revisions:

ST. TAMMANY PARISH SHERIFF'S OFFICE

BROWNSWITCH ROAD
SLIDELL, LOUISIANA

CONSTRUCTION DOCUMENTS

ELECTRICAL DETAILS

Sheet Number:

E4.0

EDA Project #173

Engineering Design Associates, L.L.C.
Consulting Engineers
3350 Ridgelake Drive Suite 190 Metairie, Louisiana 70002
504 836 3889 - 504 836 3887 (facsimile) - eda@engineeringdesignassoc.com

Copyright © 2007

Copyright 2007