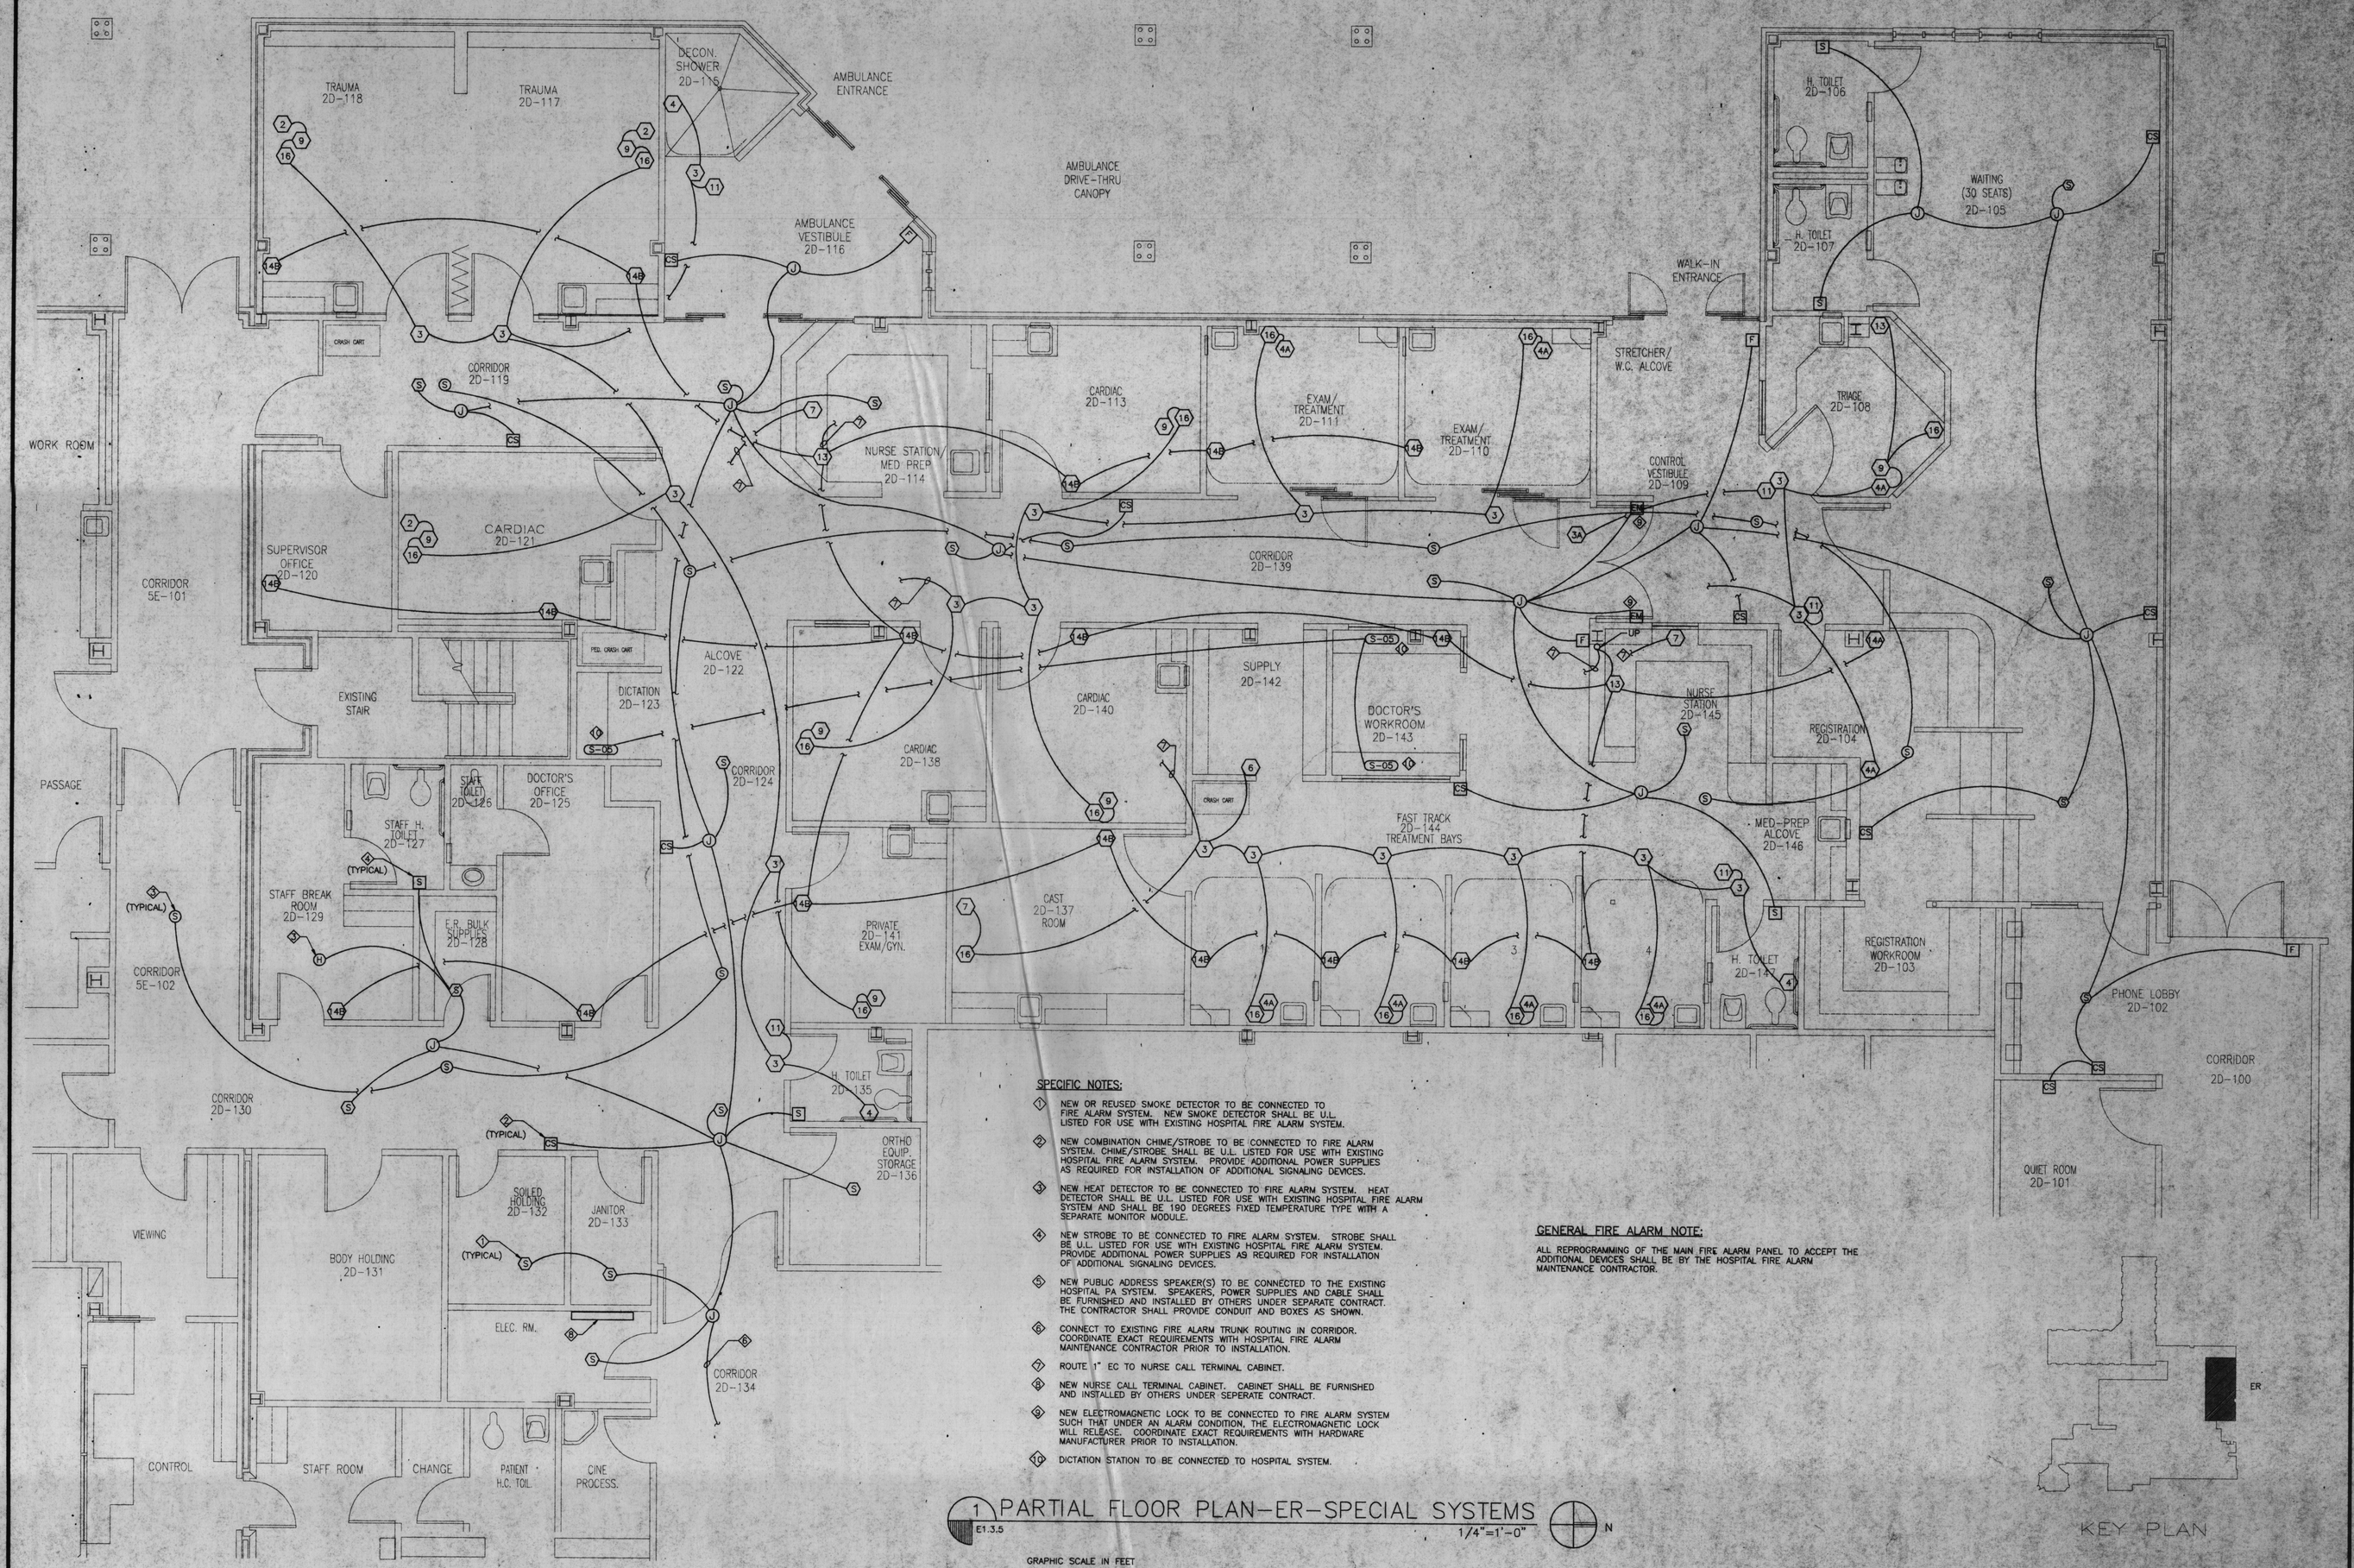

SPECIFIC NOTES:

1. NEW OR REUSED SMOKE DETECTOR TO BE CONNECTED TO FIRE ALARM SYSTEM. NEW SMOKE DETECTOR SHALL BE U.L. LISTED FOR USE WITH EXISTING HOSPITAL FIRE ALARM SYSTEM.
2. NEW COMBINATION CHIME/STROBE TO BE CONNECTED TO FIRE ALARM SYSTEM. CHIME/STROBE SHALL BE U.L. LISTED FOR USE WITH EXISTING HOSPITAL FIRE ALARM SYSTEM. PROVIDE ADDITIONAL POWER SUPPLIES AS REQUIRED FOR INSTALLATION OF ADDITIONAL SIGNALING DEVICES.
3. NEW HEAT DETECTOR TO BE CONNECTED TO FIRE ALARM SYSTEM. HEAT DETECTOR SHALL BE U.L. LISTED FOR USE WITH EXISTING HOSPITAL FIRE ALARM SYSTEM AND SHALL BE 190 DEGREES FIXED TEMPERATURE TYPE WITH A SEPARATE MONITOR MODULE.
4. NEW STROBE TO BE CONNECTED TO FIRE ALARM SYSTEM. STROBE SHALL BE U.L. LISTED FOR USE WITH EXISTING HOSPITAL FIRE ALARM SYSTEM. PROVIDE ADDITIONAL POWER SUPPLIES AS REQUIRED FOR INSTALLATION OF ADDITIONAL SIGNALING DEVICES.
5. NEW PUBLIC ADDRESS SPEAKER(S) TO BE CONNECTED TO THE EXISTING HOSPITAL PA SYSTEM. SPEAKERS, POWER SUPPLIES AND CABLE SHALL BE FURNISHED AND INSTALLED BY OTHERS UNDER SEPARATE CONTRACT. THE CONTRACTOR SHALL PROVIDE CONDUIT AND BOXES AS SHOWN.
6. CONNECT TO EXISTING FIRE ALARM TRUNK ROUTING IN CORRIDOR. COORDINATE EXACT REQUIREMENTS WITH HOSPITAL FIRE ALARM MAINTENANCE CONTRACTOR PRIOR TO INSTALLATION.
7. ROUTE 1" EC TO NURSE CALL TERMINAL CABINET.
8. NEW NURSE CALL TERMINAL CABINET. CABINET SHALL BE FURNISHED AND INSTALLED BY OTHERS UNDER SEPERATE CONTRACT.
9. NEW ELECTROMAGNETIC LOCK TO BE CONNECTED TO FIRE ALARM SYSTEM SUCH THAT UNDER AN ALARM CONDITION, THE ELECTROMAGNETIC LOCK WILL RELEASE. COORDINATE EXACT REQUIREMENTS WITH HARDWARE MANUFACTURER PRIOR TO INSTALLATION.
10. DICTATION STATION TO BE CONNECTED TO HOSPITAL SYSTEM.

GENERAL FIRE ALARM NOTE:

ALL REPROGRAMMING OF THE MAIN FIRE ALARM PANEL TO ACCEPT THE ADDITIONAL DEVICES SHALL BE BY THE HOSPITAL FIRE ALARM MAINTENANCE CONTRACTOR.

1 PARTIAL FLOOR PLAN-ER-SPECIAL SYSTEMS
E1.3.5
1/4"=1'-0"

N

GRAPHIC SCALE IN FEET
1/4"=1'-0" 4 0 4 8

MARRERO COUVILLON & ASSOCIATES, INC.
CONSULTING ENGINEERS
BATON ROUGE-NEW ORLEANS-LAFAYETTE
JOB NO. SM194.012 DWG. N203 S16 T044

LIFE SAFETY PHASE 1C LAB/ER RENOVATIONS
SLIDELL MEMORIAL HOSPITAL
1001 GAUSE BLVD. SLIDELL, LA.

JOHN T. CAMPO & ASSOCIATES, INC.
ARCHITECTS • PLANNERS
THE LINCOLN CENTER, SUITE 2815 · 300 POYDRAS STREET
NEW ORLEANS, LA. 70130 · (504) 568-9912

ISSUE DATES

DATE	ISSUED TO	USE
11/23	CLIENT	FOR REVIEW

REVISIONS

DATE	BY	DESCRIPTION

☐ PROGRESS PRINT
NOT FOR CONSTRUCTION.

☐ PARTIAL RELEASE
ONLY TO EXTENT NOTED HEREON, PARTS OF THIS DRAWING ARE RELEASED BY THE ARCHITECT FOR CONSTRUCTION.

DATE

☒ FULL RELEASE
THIS DRAWING IS FULLY RELEASED BY THE ARCHITECT FOR CONSTRUCTION OF THIS PROJECT ONLY.

DATE NOVEMBER 23, 1994

ALL RIGHTS RESERVED NOT TO BE COPIED OR REPRODUCED WITHOUT EXPRESSED WRITTEN CONSENT OF JOHN T. CAMPO & ASSOCIATES, INC.

COPYRIGHT © JOHN T. CAMPO & ASSOCIATES, INC., 1993

JOB NUMBER
9215-16M

DRAWN BY
H.P.H.

CHECKED BY
S.S.S.

STATE OF LOUISIANA
JOHN N. COUVILLON
REG. No. 11860
REGISTERED PROFESSIONAL ENGINEER IN MECHANICAL ENGINEERING

SHEET
E1.3.5

SHEETS