PLUMBING FIXTURE SCHEDULE

MARK		FIXTURE	TYPE	SIZE	MANUFACTURER & MODEL NO.	COLOR	CARRIER	CONNECTIONS TRAP	SAN	VENT	CW	HW	REMARKS
NOT USED	WC1	WATER CLOSET	FLR MTD	STANDARD ELONG'D	TOTO DRAKE MODEL CST744S	WHITE	--	3"	4"	2"	1 1/2"	--	PROVIDE W/ WHITE CLOSED FRONT ELONGATED SEAT, CHURCH MODEL #130 (1.6 GAL. PER FLUSH). NOTE 1,2,10
WC-1	WC1H	H.C. WATER CLOSET	FLR MTD	H.C. ELONG'D	TOTO DRAKE MODEL CST744L	WHITE	--	3"	4"	2"	1 1/2"	--	PROVIDE W/ WHITE CLOSED FRONT ELONGATED SEAT, CHURCH MODEL #130 (1.6 GAL. PER FLUSH). NOTE 1,2,10,12
WC-2	WC1A	WATER CLOSET	FLR MTD F. VALVE	STANDARD ELONG'D	AMERICAN STANDARD 2234.015	WHITE	--	3"	4"	2"	1 1/2"	--	PROVIDE W/ OLSONITE MODEL #95-SS SEAT & SLOAN MODEL 111 YB FLUSH VALVE (1.5 GAL. PER FLUSH). NOTE 1,2,10
NOT USED	WC1AH	H.C. WATER CLOSET	FLR MTD F. VALVE	H.C. ELONG'D	AMERICAN STANDARD 3043.102	WHITE	--	3"	4"	2"	1 1/2"	--	PROVIDE W/ OLSONITE MODEL 95SS SEAT & SLOAN MODEL 111 REGAL XL FLUSH VALVE (1.5 GAL. PER FLUSH). NOTE 1,2,10,12
UR	UR1	URINAL	WALL HUNG	--	AMERICAN STANDARD ALLBROOK 1.0 6541.132	WHITE	WADE W-400	2"	3"	1 1/2"	1"	--	PROVIDE SLOAN ROYAL 186-1 FLUSH VALVE (1.0 GAL. PER FLUSH) NOTE 11
NOT USED	LV1	LAVATORY	DROP-IN	19 x 17	UNIVERSAL RUNDLE 4625 (VCR)	WHITE	--	1 1/4"	1 1/2"	1 1/4"	1/2"	1/2"	PROVIDE W/ AMERICAN STANDARD MODEL 2385.400 TRIM NOTES 2,3
L-2	LV1H	LAVATORY	DROP-IN	19 x 17	UNIVERSAL RUNDLE 4625 (VCR)	WHITE	--	1 1/4"	1 1/2"	1 1/4"	1/2"	1/2"	PROVIDE W/ AMERICAN STANDARD MODEL 2385.400 TRIM & FULLY MOLDED, P-TRAP, ANGLE VALVE INSULATION. NOTES 2,3
L-1	LV1AH	H.C. LAVATORY	WALL HUNG	20 x 18	AMERICAN STANDARD 0355.012	WHITE	--	1 1/4"	1 1/2"	1 1/4"	1/2"	1/2"	PROVIDE W/ AMERICAN STANDARD MODEL 2385.400 TRIM & FULLY MOLDED, P-TRAP, ANGLE VALVE INSULATION. NOTES 2,3
TUB	TB1	BATHTUB & SHOWER	--	60 x 30 x 16	BRIGGS MODEL 2208(RIGHT) BRIGGS MODEL 2209(LEFT)	WHITE	--	1 1/4"	1 1/2"	1 1/4"	1/2"	1/2"	PROVIDE W/ SYMMONS MODEL S-76-2-BF-X-LP & SLOAN ACT-O-MATIC AC-51. NOTES 2,6
TUB-1	TB1H	BATHTUB & SHOWER	--	60 x 30 x 16	A/S MODEL 0163.060(RIGHT) A/S MODEL 0165.060(LEFT)	WHITE	--	1 1/4"	1 1/2"	1 1/4"	1/2"	1/2"	PROVIDE W/ SYMMONS MODEL S-76-600-B30-X-LP & SLOAN ACT-O-MATIC AC-51. NOTES 2,6
SH	TB1AH	SHOWER FITTING	--	--	-- --	--	--	--	--	---	--	--	SYMMONS MODEL S-25-500-B30-X-LP SLOAN ACT-O-MATIC AC-51. NOTES 2,6
MS	SK1	LAUNDRY SINK	FLOOR MTD	22 x 21 x 13	AQUA GLASS MODEL ALT-LA	--	--	2"	2"	1 1/2"	1/2"	1/2"	PROVIDE W/ CHICAGO MODEL 891 TRIM
NOT USED	SK2	SERVICE SINK	TERRAZZO	24 x 24 x 12	STERM WILLIAMS MODEL SB-902	--	--	2"	2"	1 1/2"	1/2"	1/2"	PROVIDE W/ CHICAGO MODEL 897 ROUGH FINISH & STERN WILLIAMS MODEL T-35
NOT USED	SK3	DOUBLE BOWL	--	20 x 37	JUST MODEL DL-2037-A-GR	S.S.	--	3"	3"	1 1/2"	1/2"	1/2"	PROVIDE W/ AMERICAN STANDARD MODEL 4205.429 TRIN & ISE PRO-333 DISPOSER
S-3	SK4	TRIPLE BOWL	--	55 x 22	JUST MODEL TLXD-1949-A-GR	S.S.	--	3"	3"	1 1/2"	1/2"	1/2"	PROVIDE W/ (2) CHICAGO MODEL 527-HAB-E1-369 & JUST MODEL L35-316 TRIM & ISE PRO-333 DISPOSER
HS		HAND SINK	WALL MTD	15 x 12	UNIVERSAL RUNDLE MODEL 4551 (CONVOY)								
NOT USED		SINGLE BOWL	COUNTER TOP	15 x 15	JUST SB-1515-A-GR								
NOT USED	SK5	FOUNTAIN SINK	--	--	ELKAY MODEL LKTE-8	WHITE	--	2"	2"	1 1/2"	1/2"	1/2"	PROVIDE W/ AMERICAN STANDARD MODEL 2385.400 TRIM.
NOT USED	SK6	WASHER	--	--	SYMMONS MODEL W-600-X	S.S.	--	2"	2"	1 1/2"	1/2"	1/2"	PROVIDE W/ JUST MODEL JVGN-5 TRIM
D.F.						--	--			1 1/2"	1/2"		MOUNT AS A HANDICAP UNIT.
FD						--	--	2"		2"			

NOTES:
1. PROVIDE WITH BOLT CAPS.
2. PROVIDE WITH CHROME ANGLE STOP(S) AND SUPPLY(S).
3. PROVIDE 1 1/4" CHROME "P" TRAP.
4. PROVIDE 1 1/4" OFF-SET TAIL PIECE.
5. PROVIDE HANDI-CAP PIPE INSULATION KIT ON EXPOSED CW/HW AND WASTE PIPING, EQUAL TO TRUEBRO LAVGUARD #101 W/ #105 OFF-SET TAIL PIECE.
6. PROVDE 1 1/2" CHROME "P" TRAP.
7. MOUNT AT HANDICAPPED HEIGHT.
8. PROVIDE W/ DEEP SEAL "P" TRAP.
9. PROVIDE W/ TRAP PRIMER SYSTEM. INSTALL VALVE IN NEAREST PROPERLY SIZED CW LINE OF CONSISTENT USAGE. PROVIDE ACCESS TO VALVES FOR MAINTENANCE.
10. REFER SPECIFICATION SECTION 15450 FOR FURTHER TRIM INFORMATION.
11. MOUNT SHOWER HEAD @ 72" ABOVE SHOWER FLOOR.
12. REFER PLUMBING PLANS FOR RIGHT OR LEFT HAND CONFIGURATIONS.

NOTE: EACH WATER HEATER SHALL HAVE A CONTROL/TIMER, FURNISHED WITH UNIT. (SCHEMATIC FURNISHED BY HEATER MANUFACTURER.) CONNECT CONTROLS PER MANUFACTURERS INSTRUCTIONS.

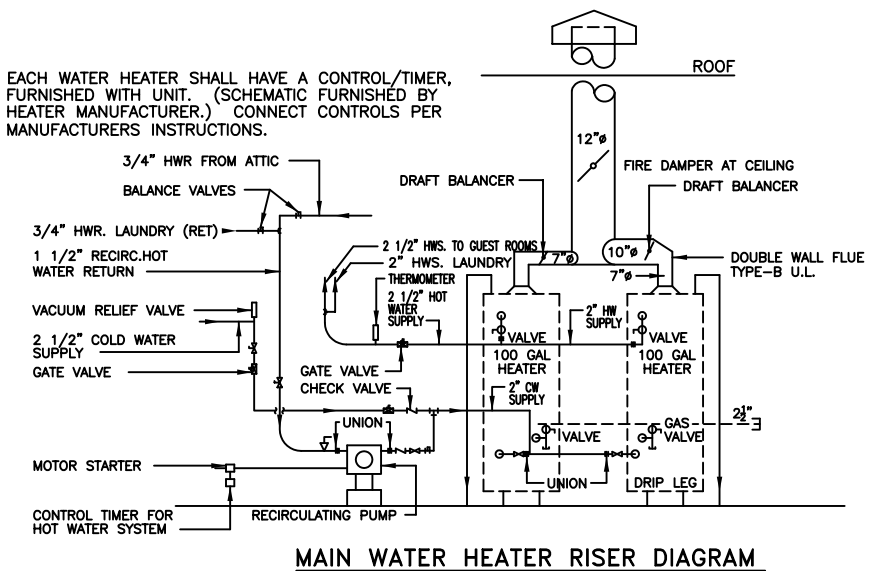

MAIN WATER HEATER RISER DIAGRAM
N.T.S.

NOTES:

1. ALL COLD AND HOT WATER LINES TO HAVE CIRCUIT SETTERS. PROVIDE SHOP DRAWINGS FOR BUILDING. WATER SYSTEM SHOWING ALL VALVES, CIRCUIT SETTERS, ETC.
2. CONTRACTOR SHALL PROVIDE FIRE SPRINKLER CONTRACTOR WITH 6" FLANGED STUB UP AT LOCATION TO BE DETERMINED IN FIELD.
3. INSULATE HOT WATER LINES FROM HOT WATER HEATER TO 2ND FLOOR.
4. INSULATE ALL HOT WATER LINES IN 2ND FLOOR CEILING.
5. INSULATE TOTAL COLD WATER SYSTEM.
6. PIPE INSULATION SHALL MEET ALL NATIONAL CODES FOR PRODUCT TYPE AND INSTALLATION PRACTICES.
7. EACH RISER SHALL BE FLOW CONTROLLED BY A BRASS CIRCUIT SETTER BALANCING VALVE. (ON RETURN LINE BACK TO HEATER)
8. SHUT OFF VALVES AT EACH RISER.
9. NO PIPING TO PENETRATE EXHAUST CHASE.

SPRINKLER SYSTEM NOTES:

1. SPRINKLER SYSTEM CONTRACTOR SHALL BE LICENSED IN STATE OF LOUISIANA.
2. SPRINKLER SYSTEM DESIGN SHALL INCLUDE ATTIC AREAS. COORDINATE WITH ELECTRICAL CONTRACTOR TO PROVIDE HEAT FOR ATTIC TO PREVENT ATTIC TEMPERATURE FROM DROPPING BELOW 40° F WHEN OUTSIDE TEMPERATURE IS 20° F.
3. RISER DIAGRAM IS DRAWN DIAGRAMMATICLY.

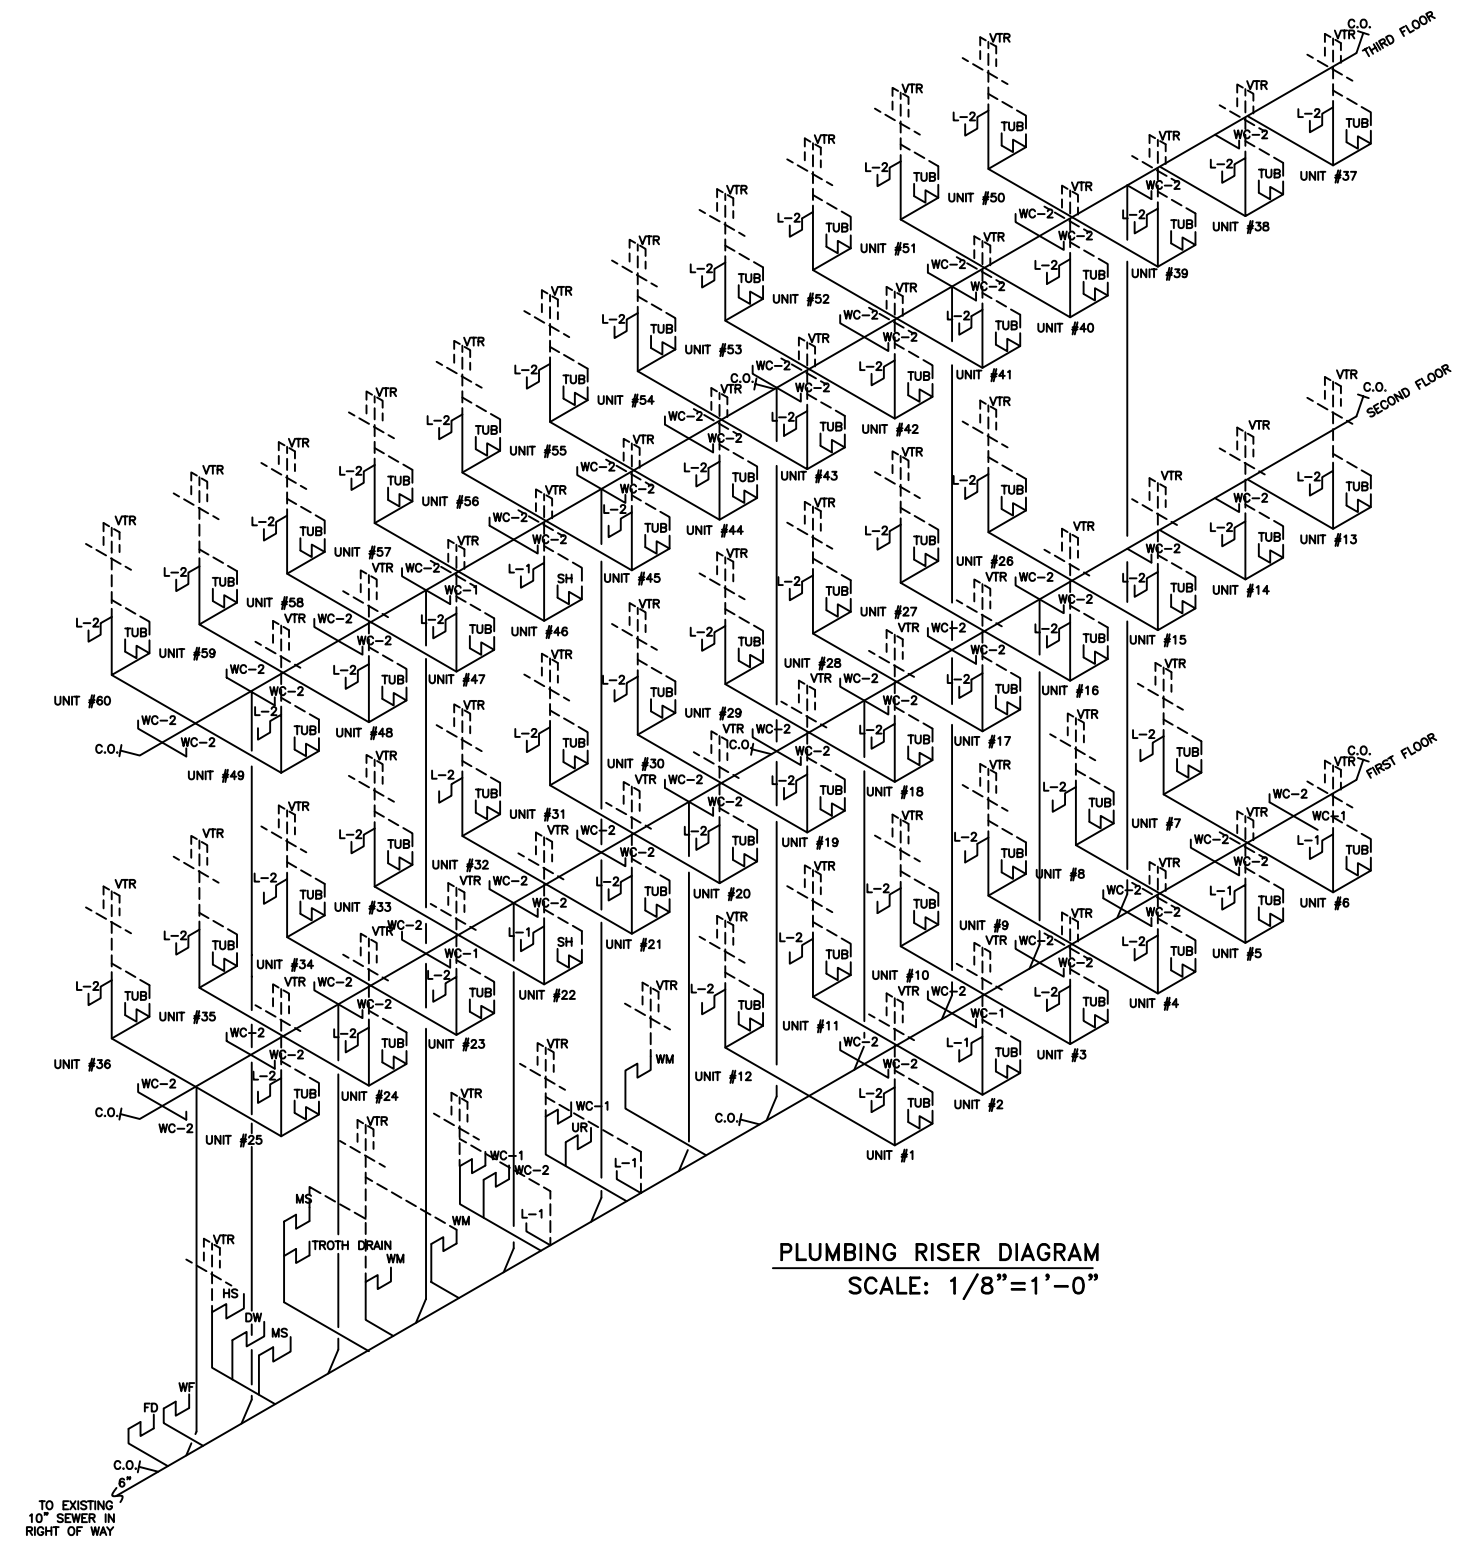

PLUMBING RISER DIAGRAM
SCALE: 1/8"=1'-0"

PLUMBING RISER DIAGRAM

LA QUINTA INN & SUITES #12
HOLIDAY BOULEVARD
SLIDELL, LOUISIANA

LA QUINTA INN & SUITES #12

DAMMON ENGINEERING, INC.
1095 FLORIDA AVENUE 985-649-5832 SLIDELL, LA. 70458
DAMMONENGINEERING.COM

SCALE:AS NOTED
FILE:
JOB NO. 1828
DATE: 2-15-07
SHEET 33
P-2
OF 33