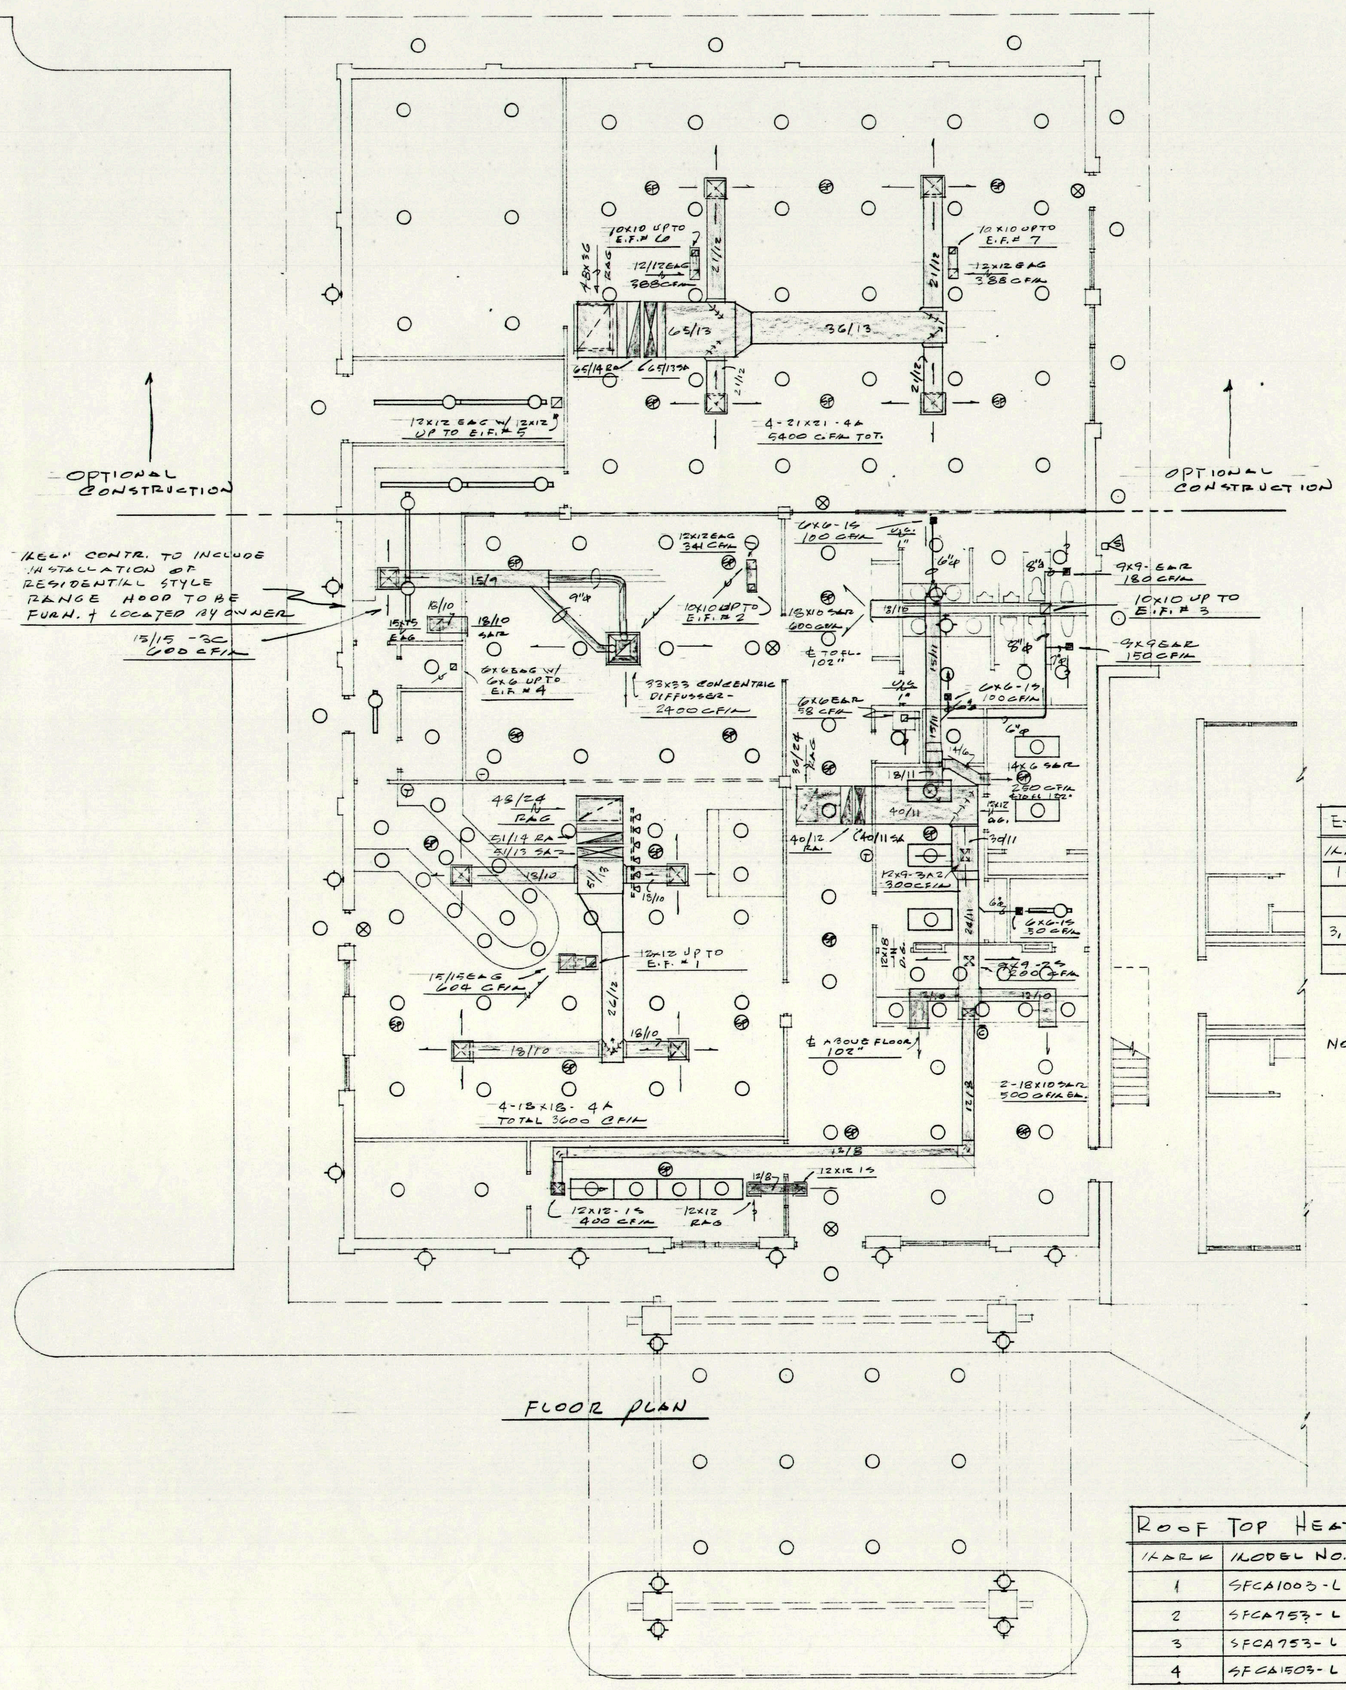

FLOOR PLAN

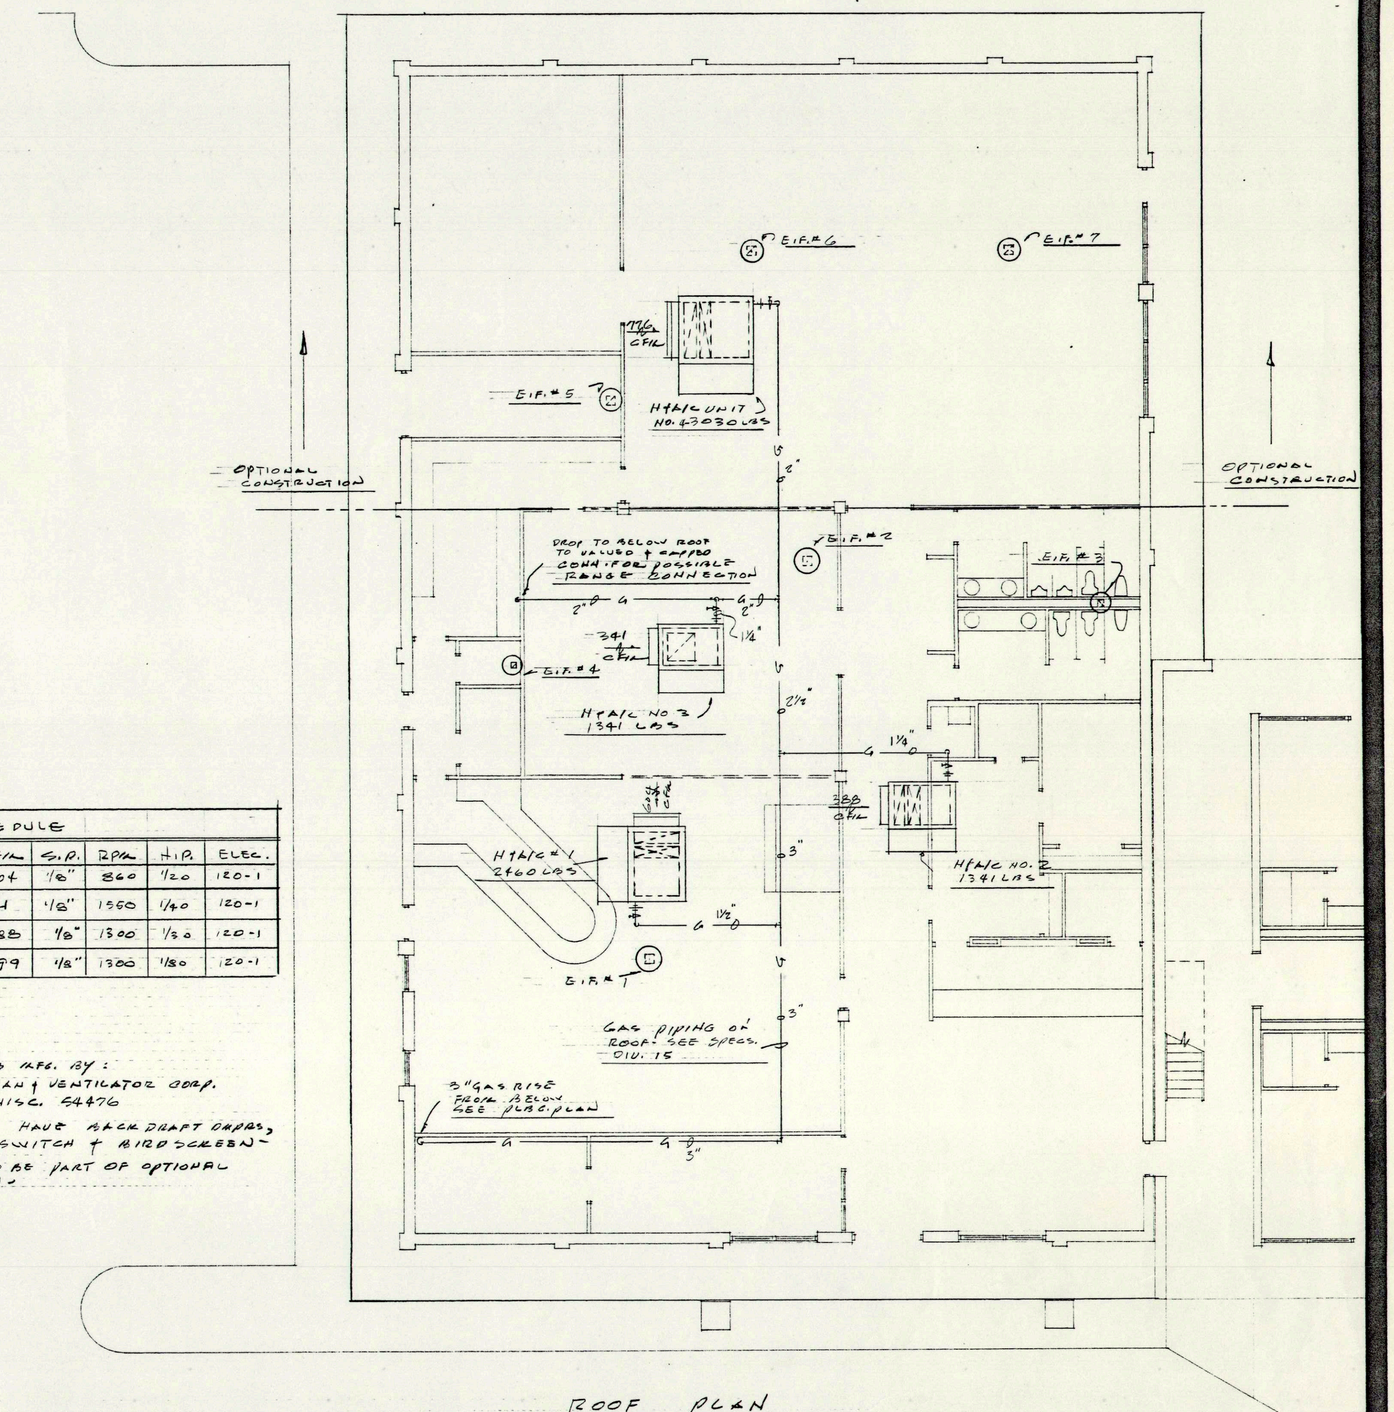

ROOF PLAN

EXHAUST FAN SCHEDULE						
MARK	MODEL No.	CFM	S.P.	RPM	H.P.	ELEC.
1 & 5	CE-10-G	604	1/8"	860	1/20	120-1
2	CE-7.5-D	341	1/8"	1560	1/40	120-1
3, 6 & 7	CE-8-G	388	1/8"	1300	1/30	120-1
4	CE-6-G	99	1/8"	1300	1/80	120-1

NOTES:
1. FANS TO BE AS MFG. BY: GREEN HECK FAN & VENTILATOR CORP. SCHOFIELD, WISC. 54476
2. ALL FANS TO HAVE BACK DRAFT DAMPERS, DISCONNECT SWITCH & BIRD SCREEN.
3. FANS 5, 6 & 7 TO BE PART OF OPTIONAL CONSTRUCTION.

H.V. & A/C PLANS

SCALE 1/8" = 1'-0"

ROOF TOP HEATING & AIR CONDITIONING UNIT SCHEDULE - MFG. TRANE CO.							
MARK	MODEL No.	NOM. COOLING CAPY	CFM TOT	O.A.	HEATING INPUT	HEATING OUTPUT	F.L.A. @ 208/3
1	SFCA1003-L	10 TONS	3600	604	200M-BTUH	150M BTUH	66.9
2	SFCA753-L	7½ TONS	3000	388	150M-BTUH	113M BTUH	41.2
3	SFCA753-L	7½ TONS	3000	341	150M-BTUH	113M BTUH	41.2
4	SFCA1503-L	15 TONS	5400	776	300M-BTUH	225M BTUH	99.5

NOTES:
ALL UNITS TO BE EQUIPPED W/ FACTORY ROOF CURB, MAN. OA. DMPR. & ACCESSORY T'STAT.
UNIT NO. 3 TO BE EQUIPPED W/ CONCENTRIC DIFFUSER & DUCT PACKAGE
UNIT NO. 4 TO A PART OF OPTIONAL CONSTRUCTION.

BASE BID FOR THE ABOVE BLDG. SHALL BE COMPLETE AS SHOWN WITH AN ALTERNATE DEDUCT FOR OMITTING THE PART SHOWN AS OPTIONAL CONSTRUCTION.

PROVIDE MANUAL RESET FIRESTATS, SETTING NOT TO EXCEED 130° F., IN R.A. OF EACH H&A/C SYSTEM

DRAWN	DESCRIPTION	CHECK
	FIRESTAT NOTE - 6-27-78	

A MOTEL
FOR
SLIDELL, LOUISIANA

THESE PLANS ARE THE PROPERTY OF THE ARCHITECT. THEY SHALL ONLY BE USED FOR THE CONSTRUCTION OF THE BUILDING SO DESIGNATED IN THE TITLE BLOCK. NO CHANGES, ABSOLUTELY NONE, WILL BE MADE WITHOUT THE APPROVAL OF THE ARCHITECT, AND UPON COMPLETION OF THE JOB, ALL PLANS AND SPECIFICATIONS SHALL BE RETURNED TO THE ARCHITECT.

ARCHEON
ARCHITECTS · ENGINEERS
2930 AIRWAYS • MEMPHIS, TENNESSEE 38116

COMM. NO. 75274
DATE
SHEET NO. M-1