GAS REQUIREMENT SCHEDULE

DOMESTIC WATER HEATER	720,000 BTUH
LAUNDRY DRYERS (2 @ 260,000 EA.)	520,000
ROOF-TOP HTG. & A/C UNITS	800,000
KITCHEN USE (APPROX.)	300,000
TOTAL	2,340,000 BTUH

DEMAND: 2,340 CFH OF 2,000 BTU/CU.FT OF NATURAL GAS AT 6oz. DISTRIBUTION PRESS. FROM GAS METER. PIPE SIZES SHOWN ON PLAN ARE BASED ON 600' FT. EQUIVALENT LENGTH OF RUN.

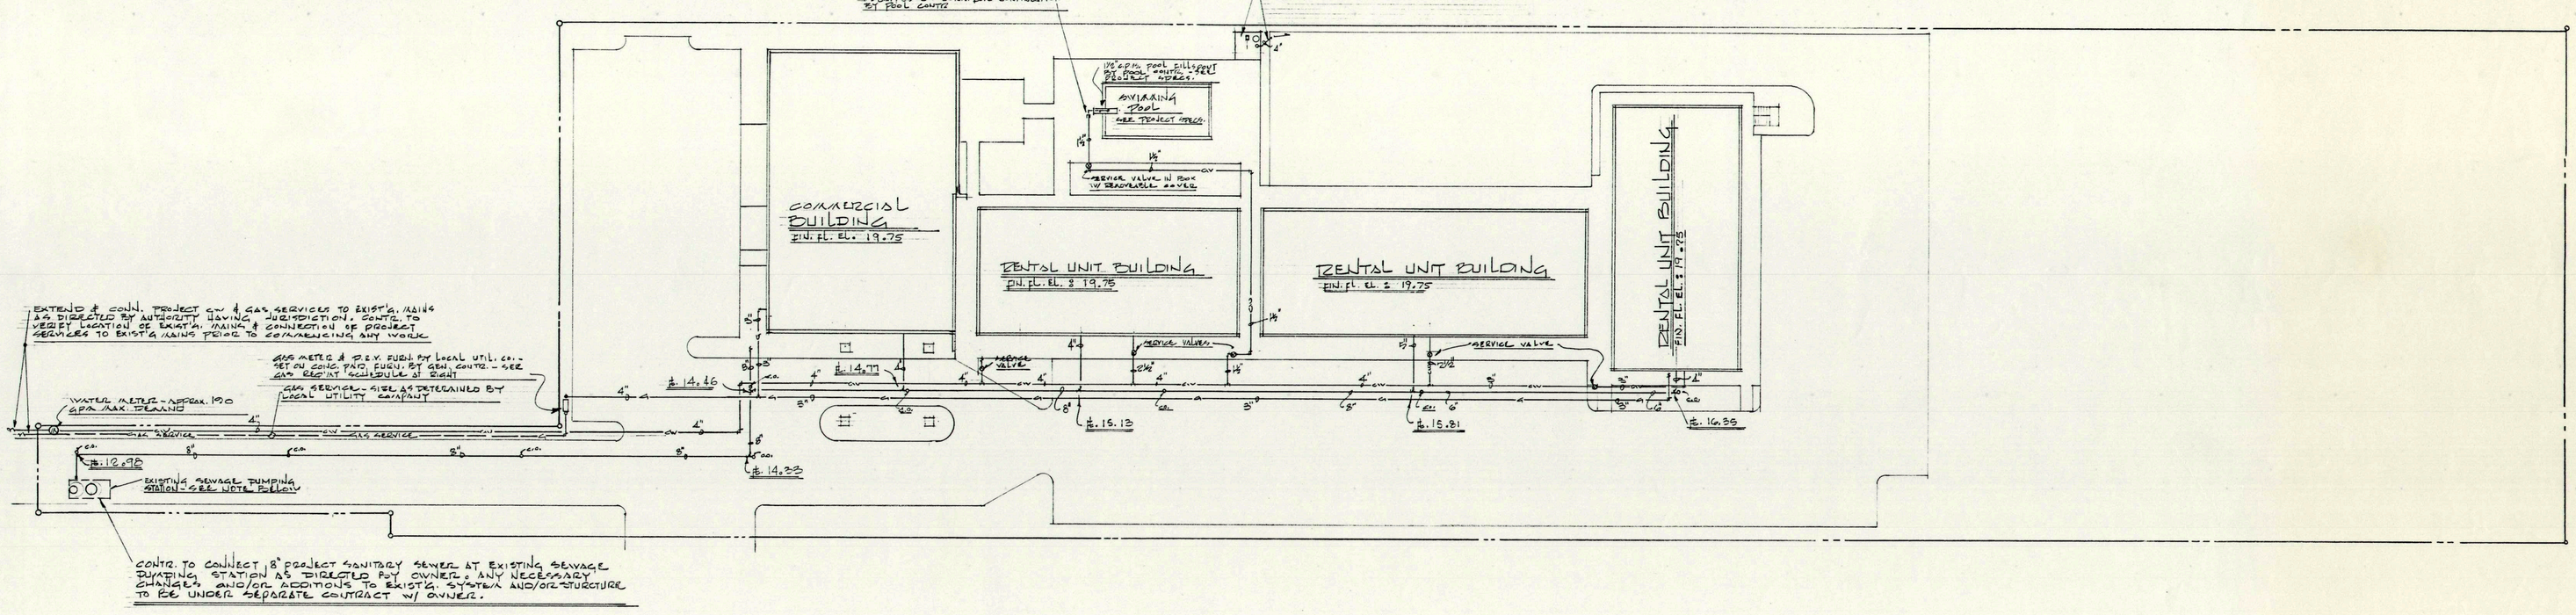

PLUMBING PLOT PLAN

SCALE: 1" = 30'-0"

DRAWN	DESCRIPTION	CHECK

A MOTEL
FOR
SLIDELL, LOUISIANA

COMM. NO. 75274

DATE

SHEET NO. P-1

BRUNING 40-107 17858 FORM #4