General Notes:

1. See specs for lighting fixture schedule, supplemented by notes s/or schedules on drawings
2. Elec. clock outlet by E.C. — clock by owner.
3. ⊖ Denotes dimmer control switch, wattage as req'd — see specs.
4. See specs for piped music & paging system requirements — microphone @ P.B.X. area shall be rotary turret type, for selected area communications or for total system communications.
5. Piped music & paging system master amplifier.
6. Microphone outlet box & 2 gang music outlet boxes @ P.B.X. area — lobby-corridor speakers & pool horn shall be controlled @ this point.
7. Interior music speaker — see specs.
8. 4"x4"x2" W.P. outlet box for pool horn — locate as directed.
9. Volume control switch — "S" denotes selector switch.
10. Elec. devices in tel. equip. room shall be located as directed by telephone co.
11. E.C. shall furn. & install a call bell system from secret desk to porter station — system shall include push button, buzzer, low voltage wire, & all necessary conduit, poles, & wiring.
12. Base bid shall be for the entire building as shown, w/an alternate bid deduct for the portion shown as optional construction.

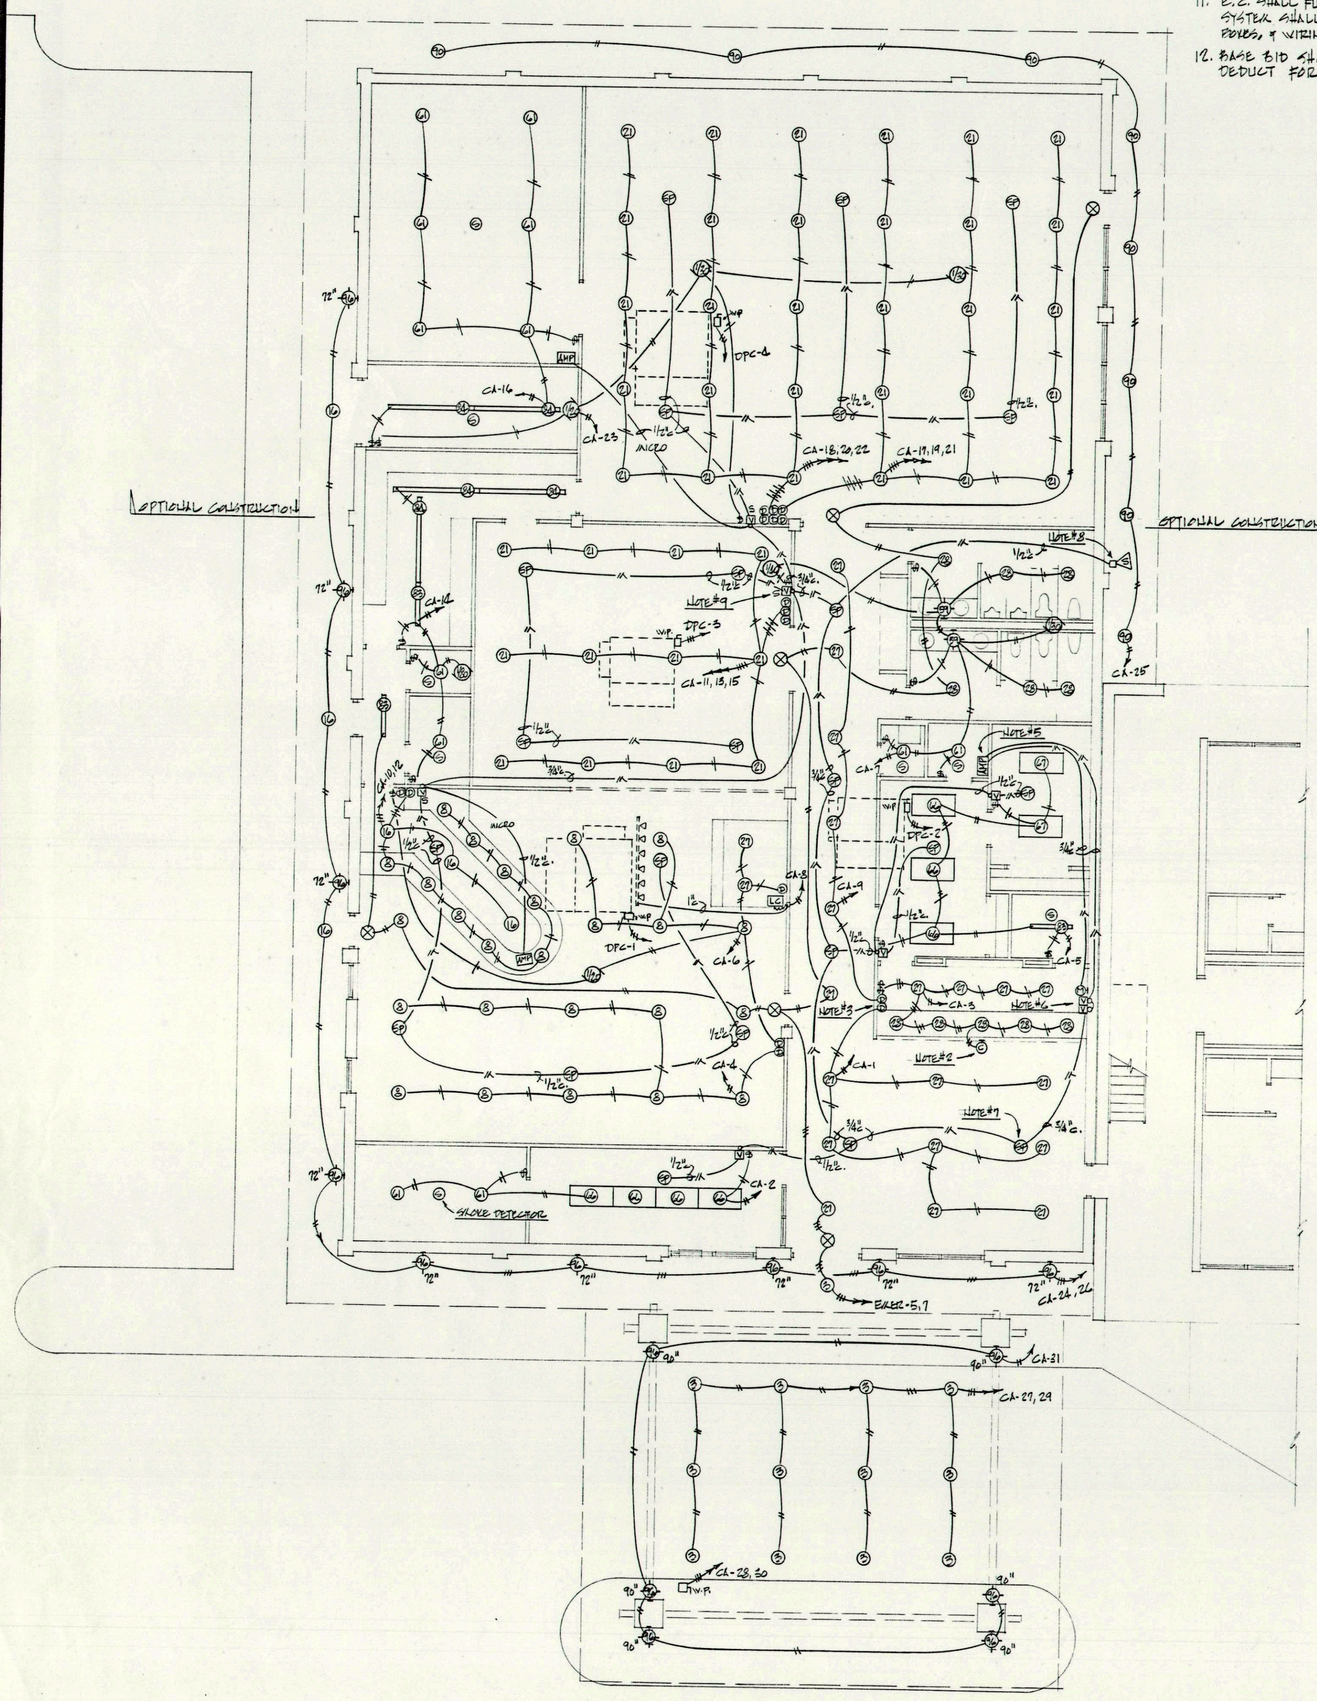

Commercial Bldg. Lighting Plan

Scale 1/8" = 1'-0"

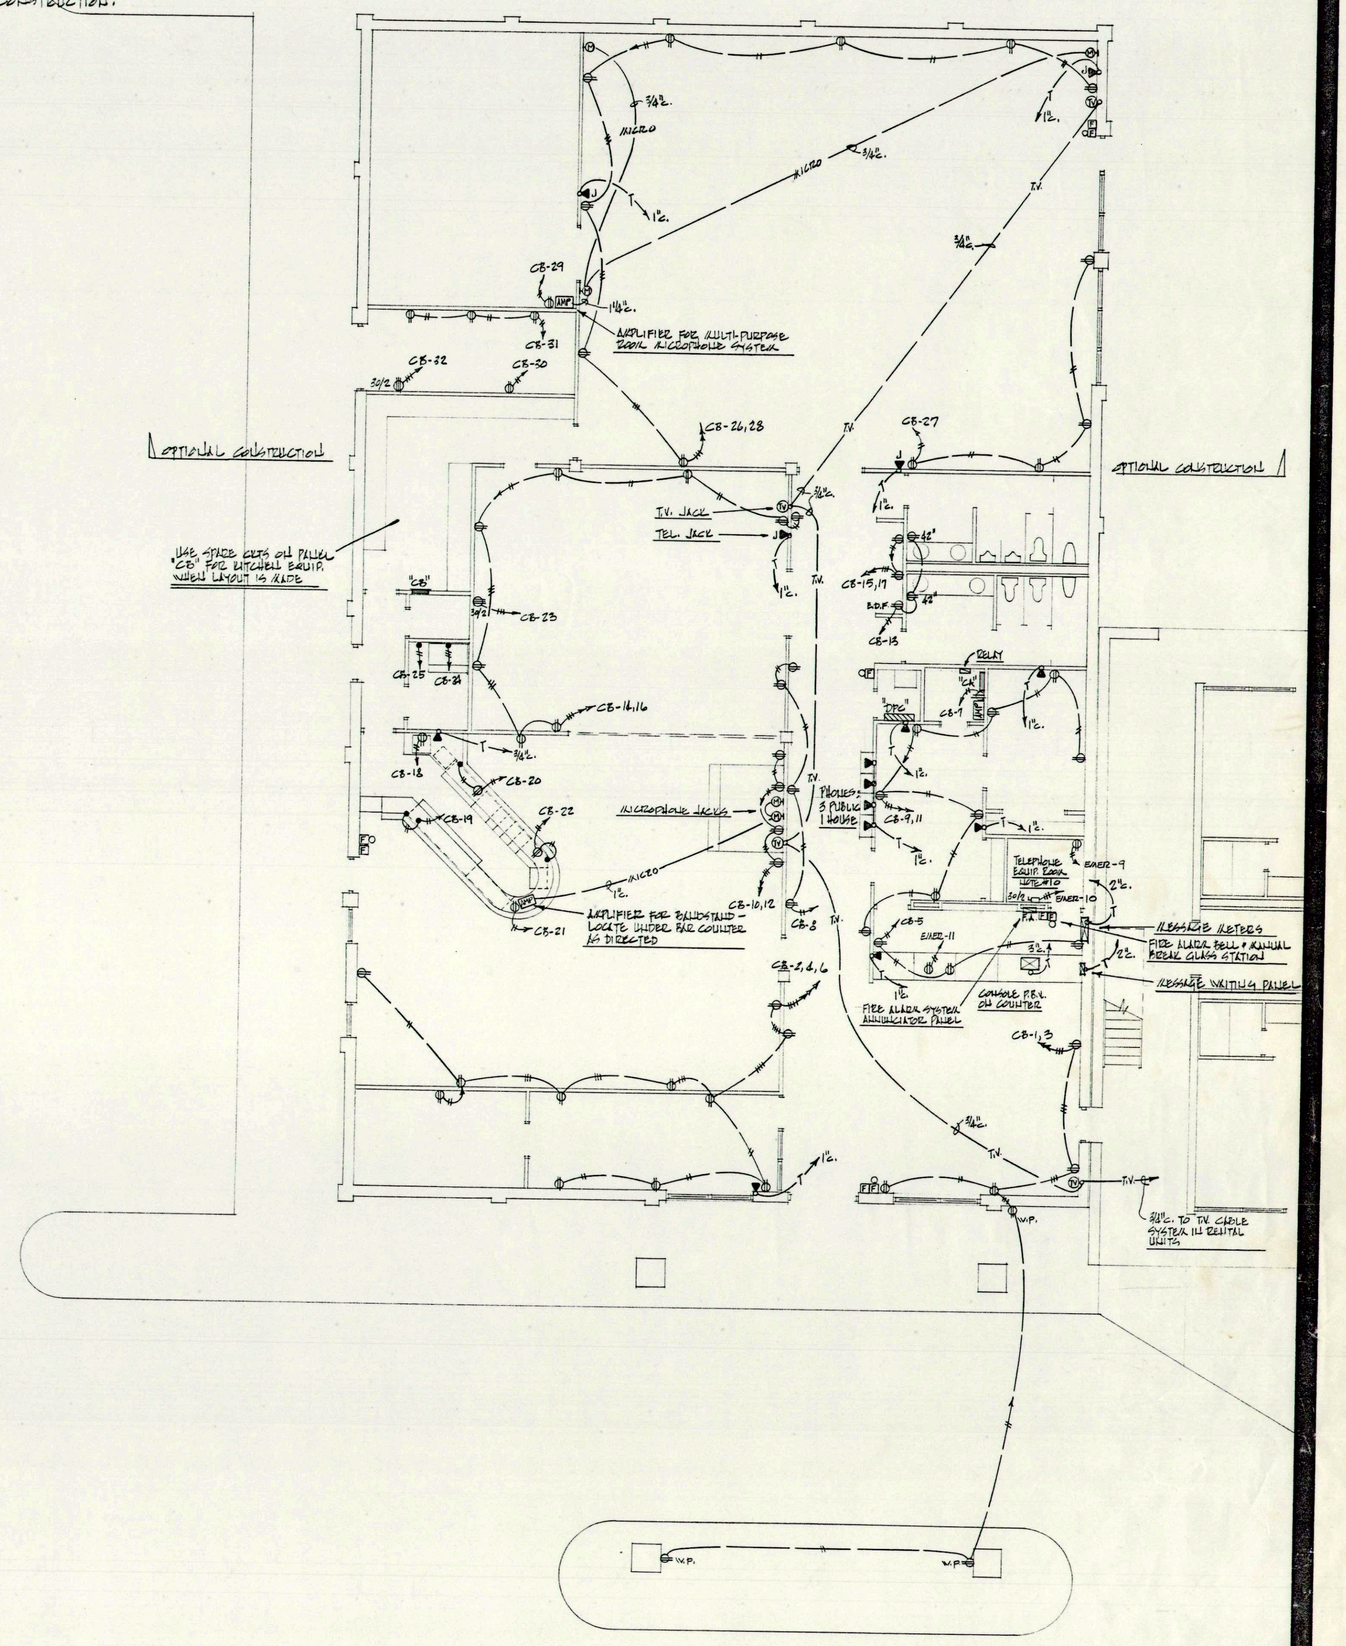

Commercial Bldg. Power Plan

Scale 1/8" = 1'-0"

DRAWN	DESCRIPTION	CHECK

A MOTEL
FOR
SLIDELL, LOUISIANA

THESE PLANS ARE THE PROPERTY OF THE ARCHITECT. THEY SHALL ONLY BE USED FOR THE CONSTRUCTION OF THE BUILDING SO DESIGNATED IN THE TITLE BLOCK. NO CHANGES, ABSOLUTELY NONE, WILL BE MADE WITHOUT THE APPROVAL OF THE ARCHITECT, AND UPON COMPLETION OF THE JOB, ALL PLANS AND SPECIFICATIONS SHALL BE RETURNED TO THE ARCHITECT.

ARCHEON
ARCHITECTS · ENGINEERS
2920 AIRWAYS · MEMPHIS, TENNESSEE 38118

COMM. NO. 75274

DATE

SHEET NO. E-3